

WBO CORR. 2016-0450


Motore IE6-	Tp. CH225P				
KW 148/140	Giri ¹²⁵⁰ 2400	V. Arm. 400	A. Arm. 400	V. Ecc. 220	A. Ecc. ^{41,25} 41,35

Campi di ARMATURA E COMPENSAZIONE

Passo.....

Spire.....

Sezione.....

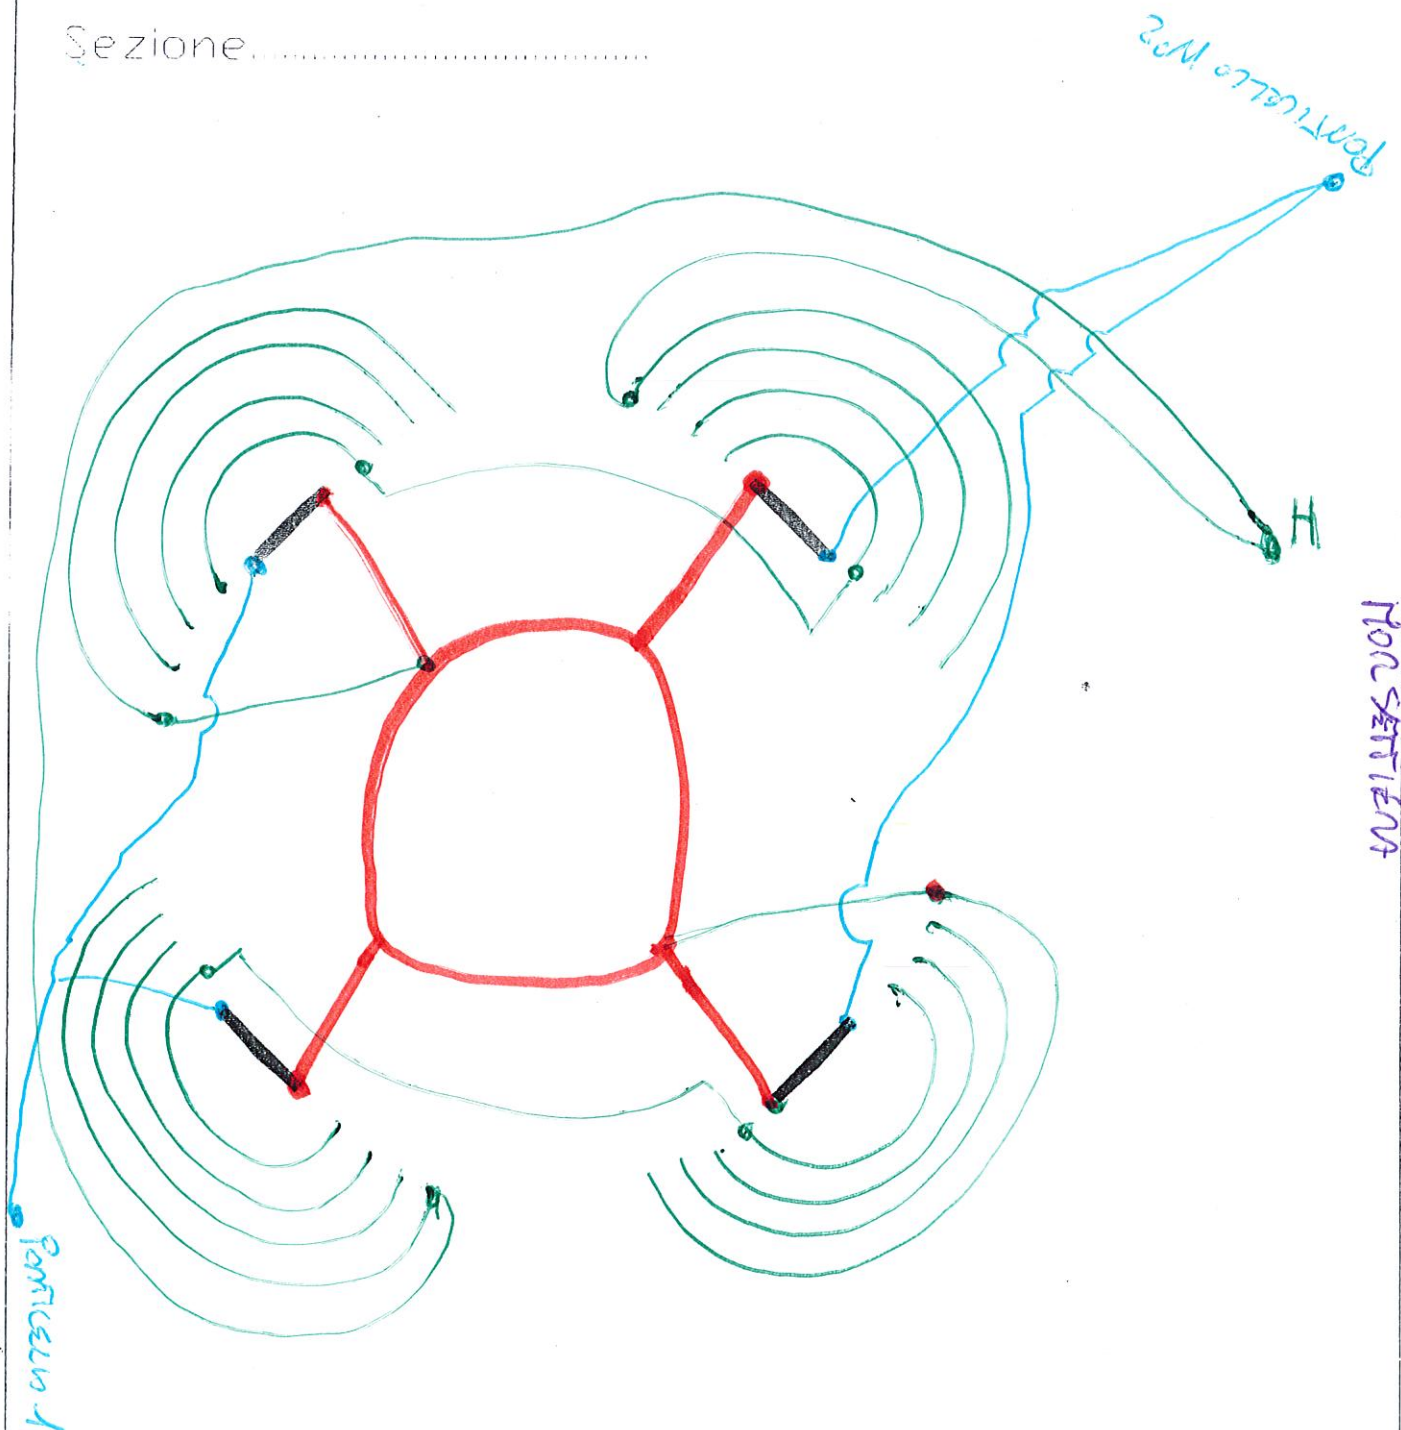

W/Bo CORR. 2016-0450


Motore IEG	Tp. CH225P
KW 118/110	Giri 1250
V. Arm. 2400	A. Arm. 400
V. Ecc. 400	A. Ecc. 1125

Campi di ECCITAZIONE

Passo

Spire

Sezione 1,80

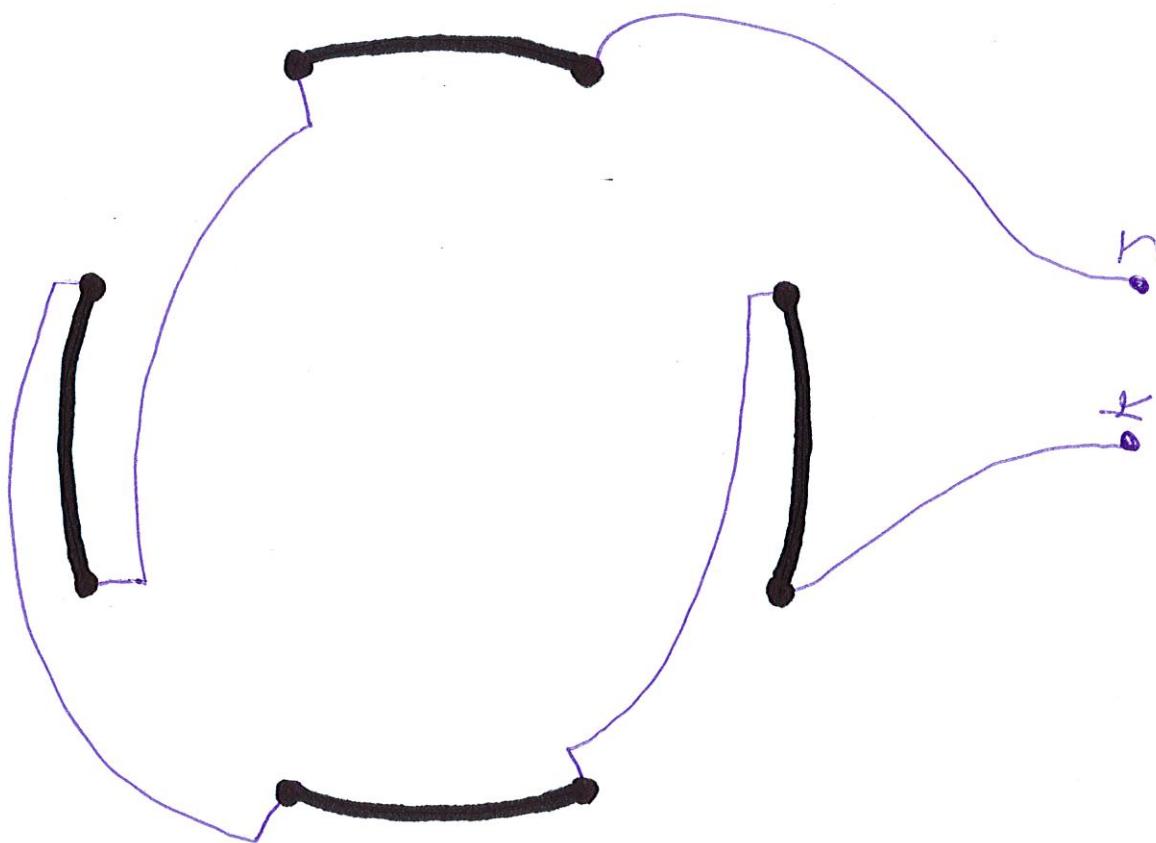

NON SENTIRE