

|        |                   |       |                       |
|--------|-------------------|-------|-----------------------|
| Motore | SIEMENS           | Tp    | 1G-H5222-1NE40-63U7-Z |
| KW     | 3,62/98,5         | Giri  | $\frac{1360}{1560}$   |
| V.Arm  | 400               | A.Arm | 268                   |
| V.Ecc  | $\frac{310}{200}$ | A.Ecc | $\frac{74}{56}$       |


Campi di ECITAZIONE

Passo

Spire 625

Sezione 1,32

UICITE

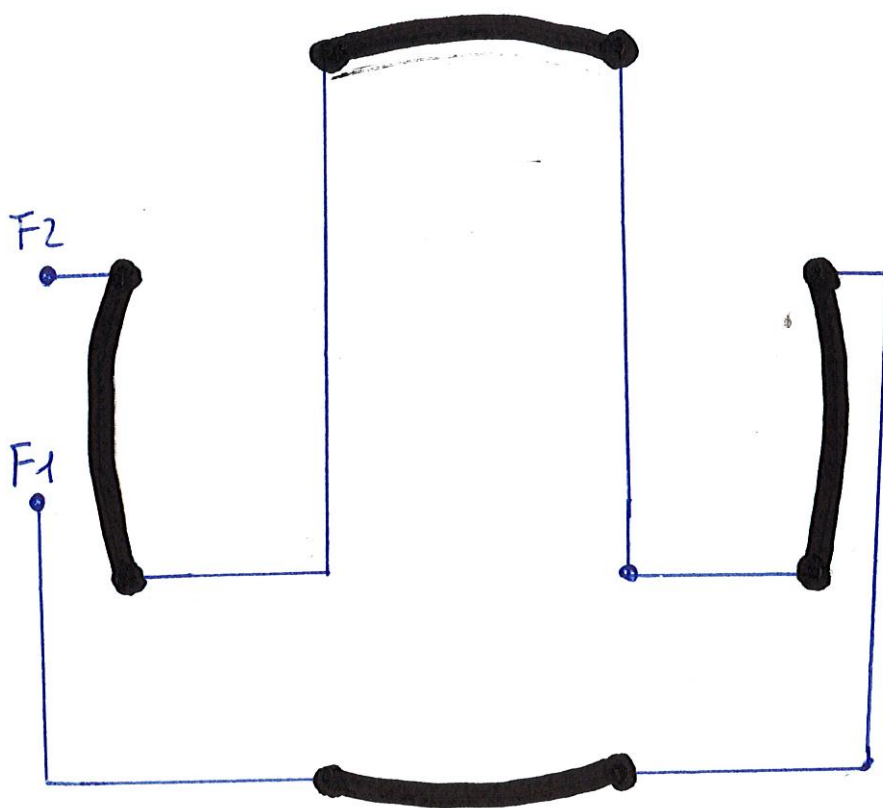

N. 187.832

|        |          |       |           |
|--------|----------|-------|-----------|
| Motore | SIEMENS  | Tp.   | 16A.5222  |
| KW     | 3,67-985 | giri  | 1360-1560 |
| V.Ar   | 40-100   | A.Ar  | 268       |
| V.Ecc  | 310-200  | A.Ecc | 7,4-5,6   |

Campi di ~~ADDITIONAL~~ COMPOUND


Passo

Spire 4

Sezione 9 x 1,90

4Kg.

PIANO D'ISOLAZIONE

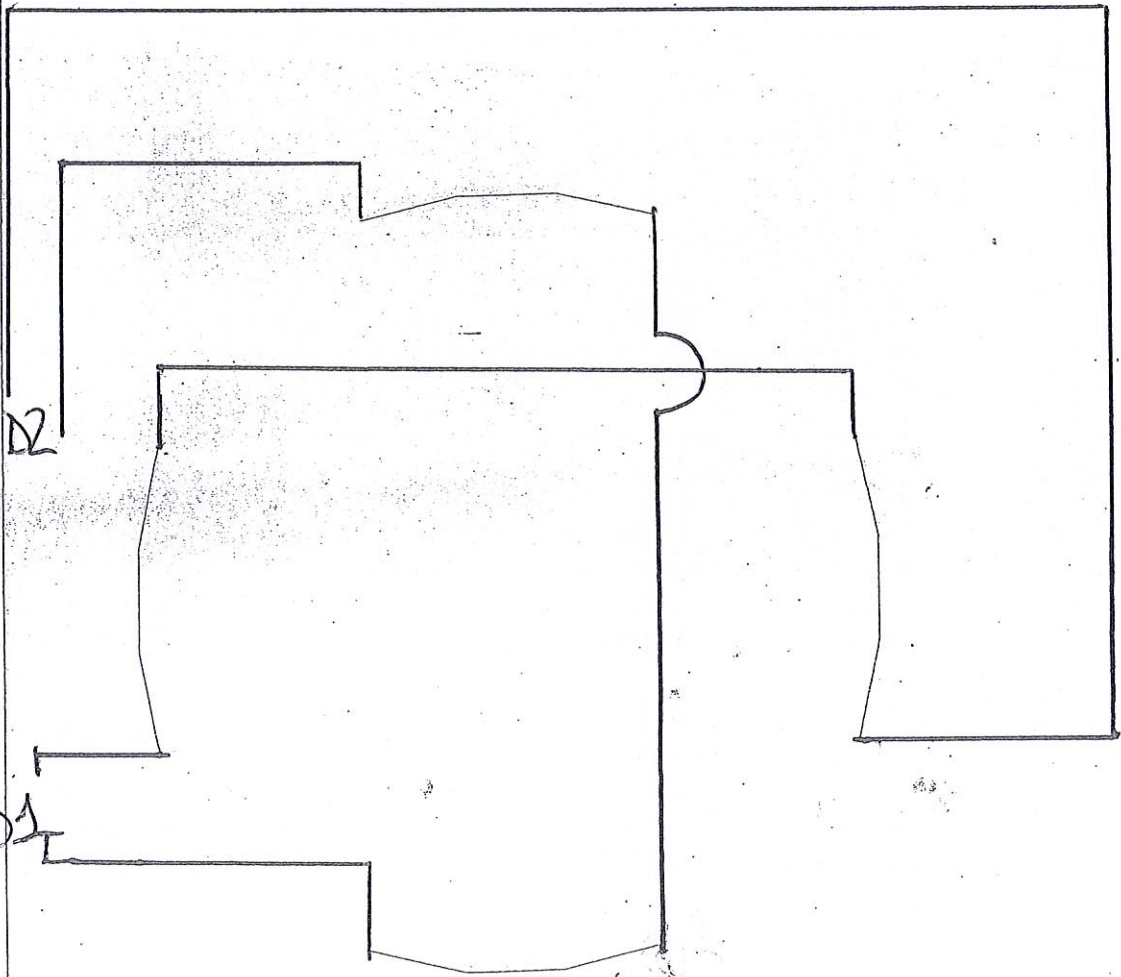



Motore SIEMENS Tp. 16A 5222  
 KW 367.85 Giri 1360-1560 V. Arm. 404.00 A. Arm. 268 V. Ecc. 310.200 A. Ecc. 76.56

Campi di... ECUTAZIONE

Passo.....

Spire... 625

Sezione... 1 x 1,32

28 Kg.

MURDO WIKI

