


1
—
2
—
3
—
4
—
5
—
6
—
7
—
8
—
9
—
10
—
11
—
12
—
13
—
14
—
15
—
16
—
17
—
18

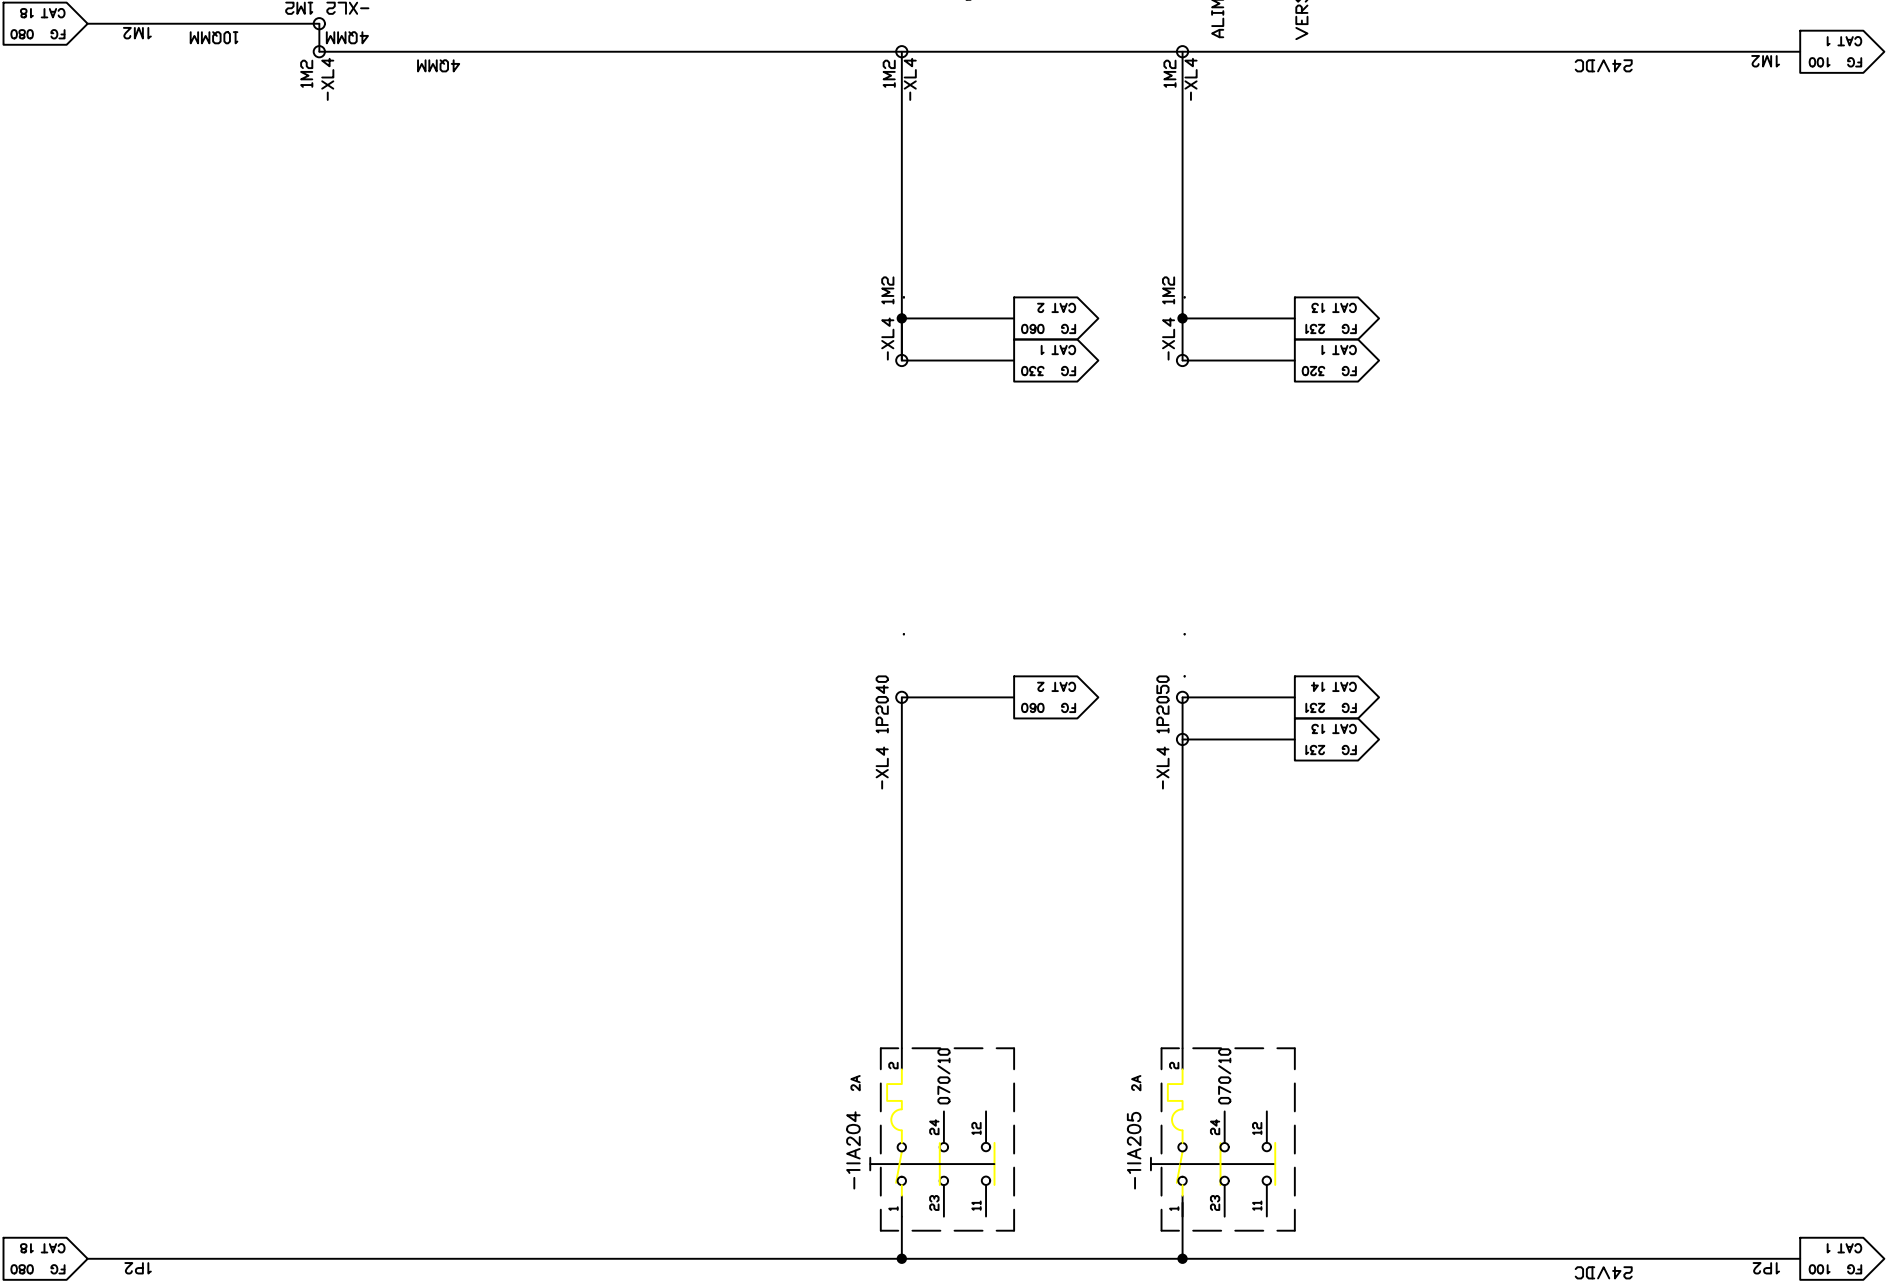

FMA	DIS. N.	31239,15815	MACCHINA/IMPIANTO :		FMA 453	ORDINE : 30.007629	TENS. DI COMANDO 24V DC		1M2	FG01D 090
	CAD	'Autocad 10	LAVORAZIONE :		ALBERO MOTORE		STEUERSPANNUNG 24V DC		UNITA 24B	SEGUE
	N. FILE	: 24B90	DENOMINAZIONE :		TRASFERITA	ESECUTORE : TP/BR				
	POS. ARCH.:		DATA : 14.12.92		AGG. : ^a				ARMADIO 1.1	