

1

—

2

—

3

—

4

—

5

—

6

—

7

—

8

—

9

—

10

—

11

—

12

—

13

—

14

—

15

—


16

—

17

—

18

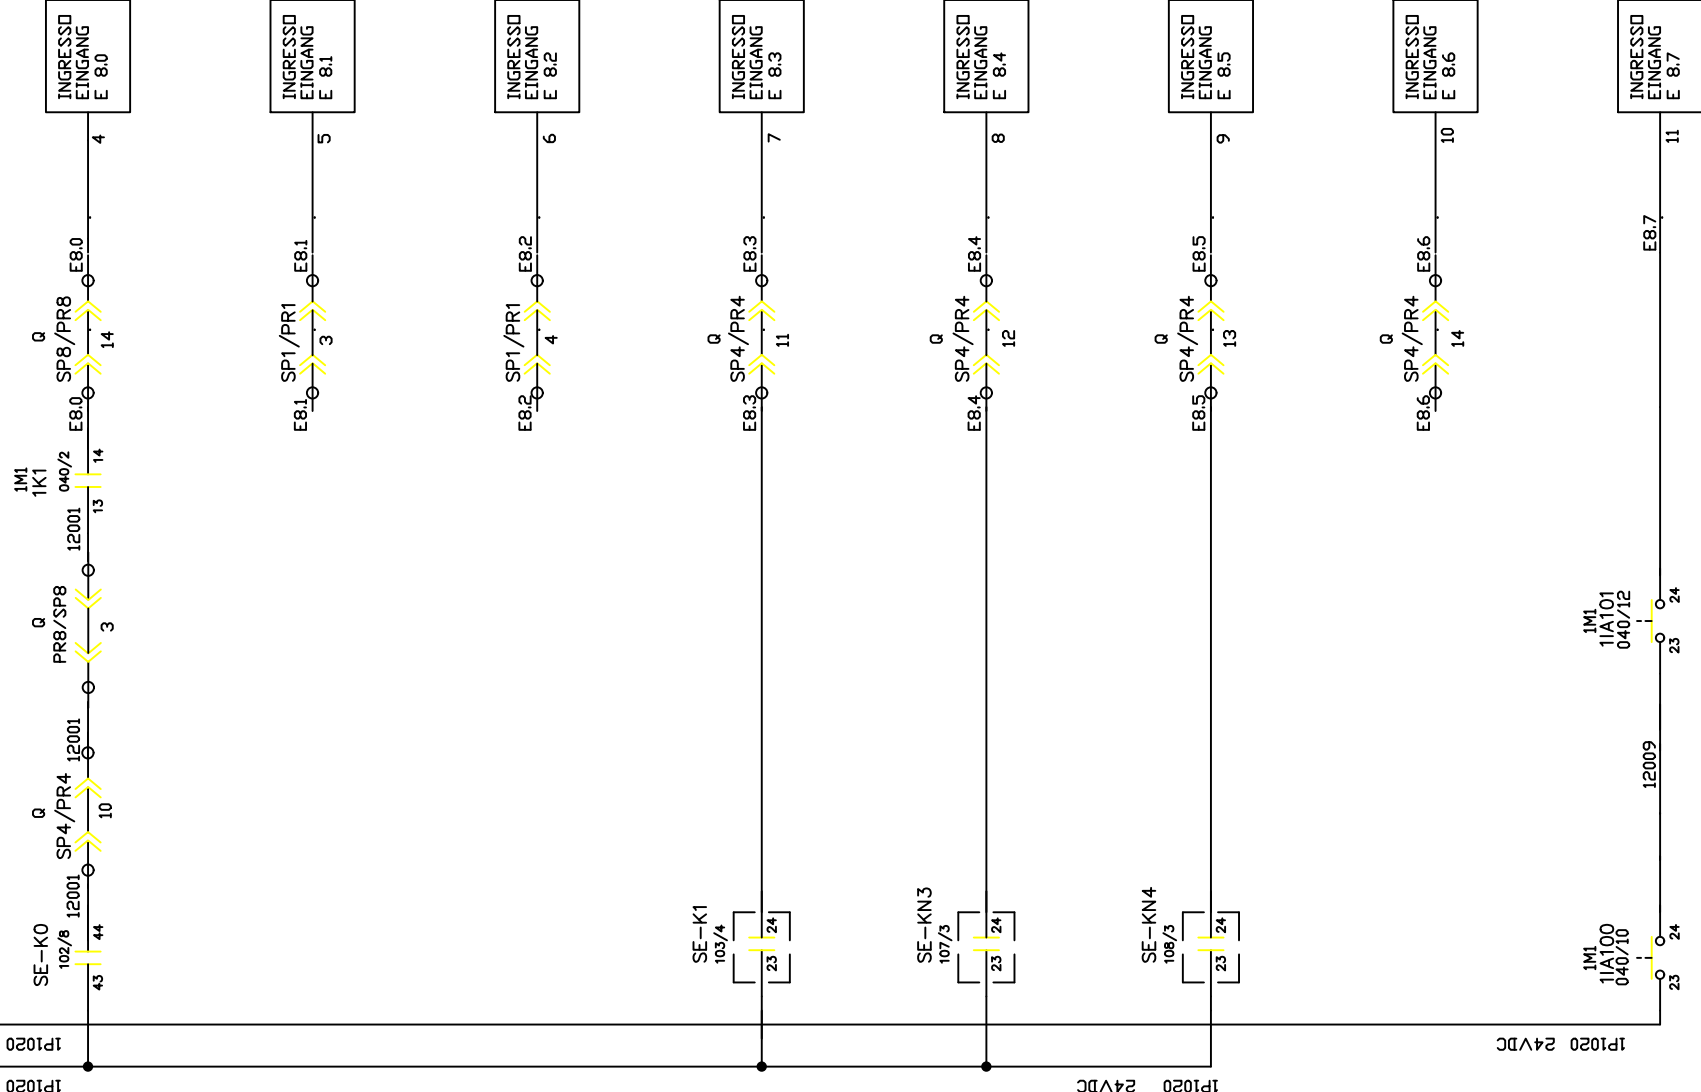

TENSIONE CMANDO
INSERTO
STEUERSpannung
EINGESCHALTET

RISERVA
RESERVE

RISERVA
RESERVE

CIRCUITO INSERTO
LASTSpannung
EINGESCHALTET

ARRESTO EMERGENZA DK
LATO A
NOT AUS I.D. SEITE A

ARRESTO EMERGENZA DK
LATO B
NOT AUS I.D. SEITE B

RISERVA
RESERVE

DIAGNOSTICA ALIM.
TENSIONE DK
DIAGNOSE Spannungs-
VERSorgung I.D.

FMA

DIS. N. : 31239.80017	MACCHINA/IMPIANTO : FMA 453	ORDINE : 30.007629	ALLGEMEINE EINGANGSSIGNALE	HP	FUGLID 120
CAD : AUTOCAD 10	LAVORAZIONE : ALBERO MOTORE	COMMESSA :	PARTE GENERALE INGRESSO	ARMADIO 7	SEGUE
N. FILE : F 453_120	DENOMINAZIONE : TRASFERITA	ESECUTORE :			
POS. ARCH.:	DATA : 07.04.1993	AGG. :			