


1
—
2
—
3
—
4
—
5
—
6
—
7
—
8
—
9
—
10
—
11
—
12
—
13
—
14
—
15
—
16
—
17
—
18

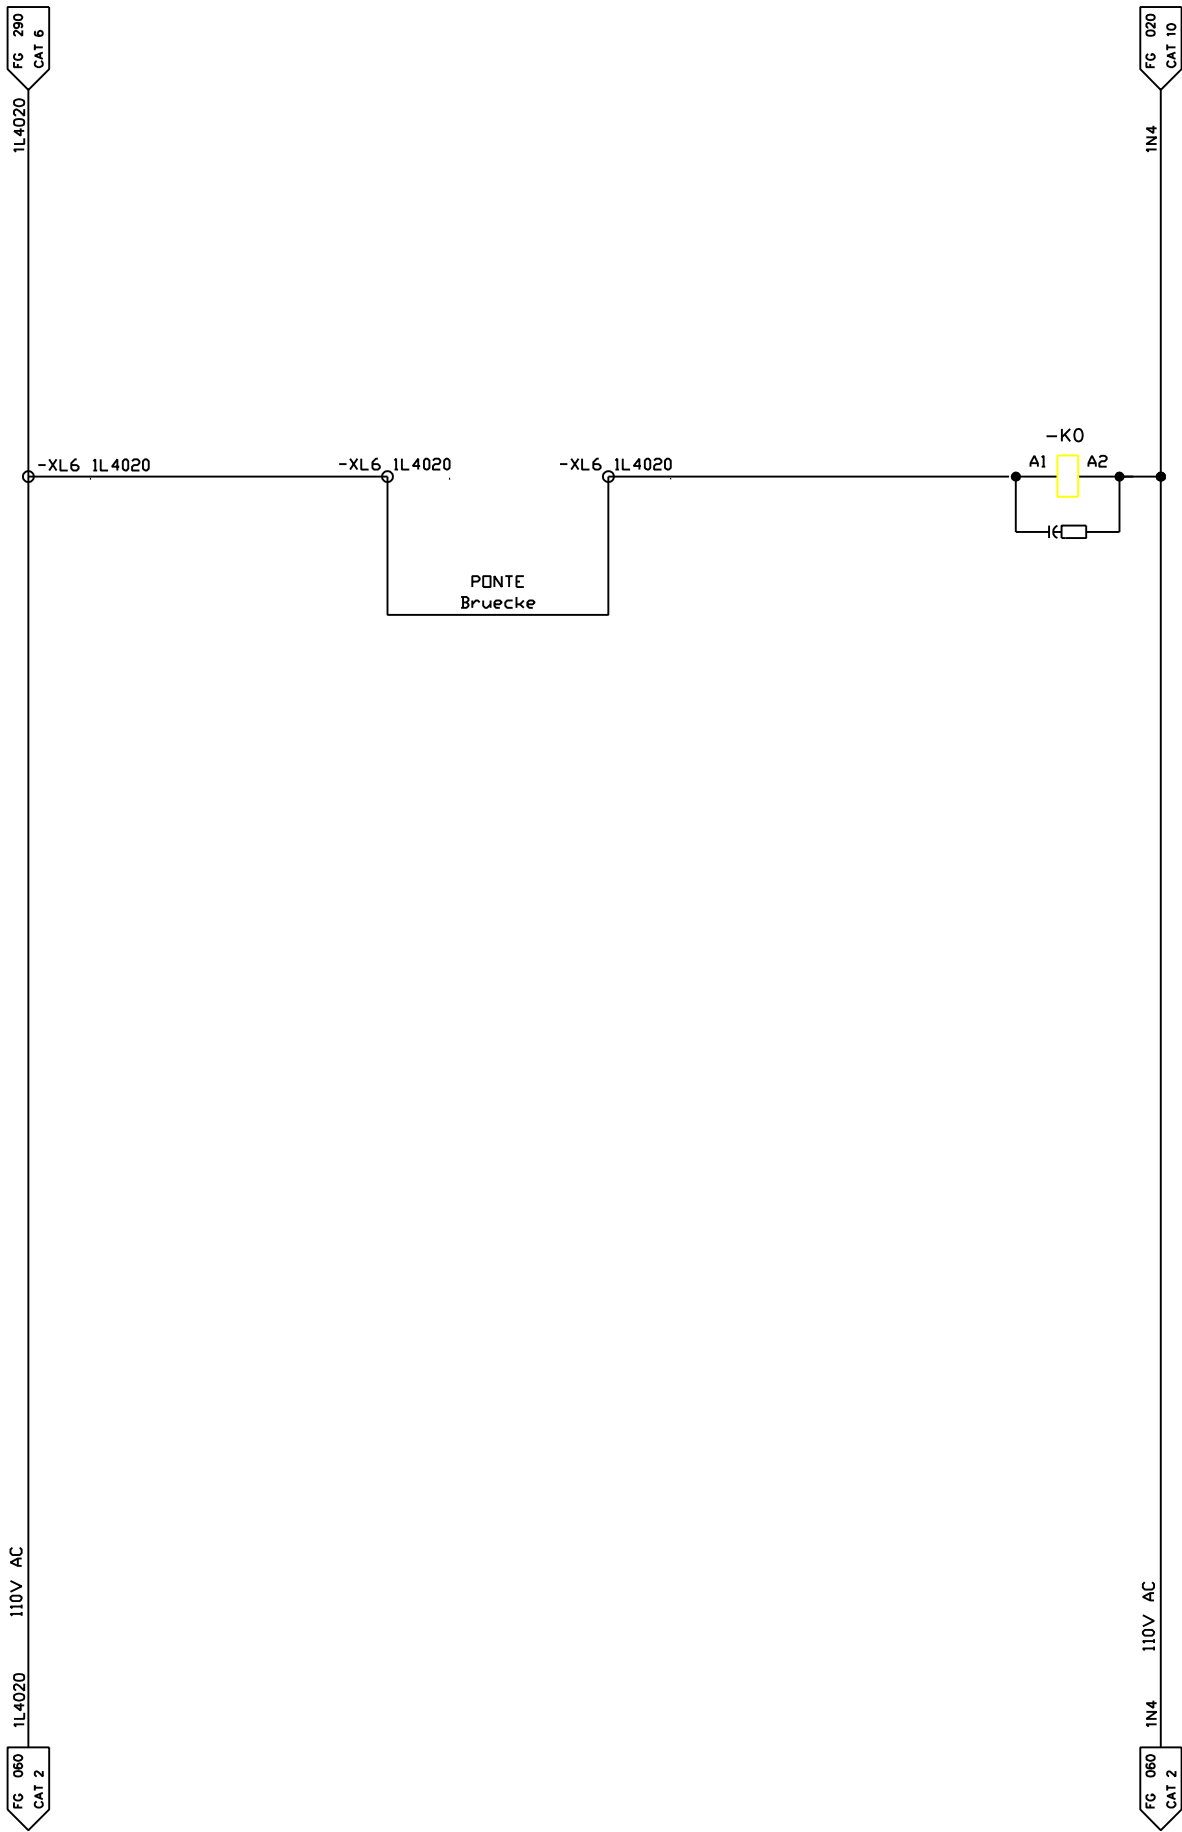

INSERIMENTO
TENSIONE COMANDO

STEUERSpannung EIN

NA	070/3	020/8	x	030/5
NC				
NA	x	x		
NC	x	x		

FMA	DIS. N.	31239.11814	MACCHINA/IMPIANTO :		FMA 453	ORDINE :	30.007629	INS.TENSIONE COMANDO STEUERSpannung EIN ARMADIO 1.1	SE UNITA 16B	FOGLIO 050 SEGUE
	CAD	:Autocad 10	LAVORAZIONE :		ALBERO MOTORE	COMMESSA :				
	N. FILE	: 16B50	DENOMINAZIONE :		TRASFERTA	ESECUTORE :	TP/BR			
	POS. ARCH.:		DATA : 10.12.92	AGG. :	^a ^b					