


1
—
2
—
3
—
4
—
5
—
6
—
7
—
8
—
9
—
10
—
11
—
12
—
13
—
14
—
15
—
16
—
17
—
18

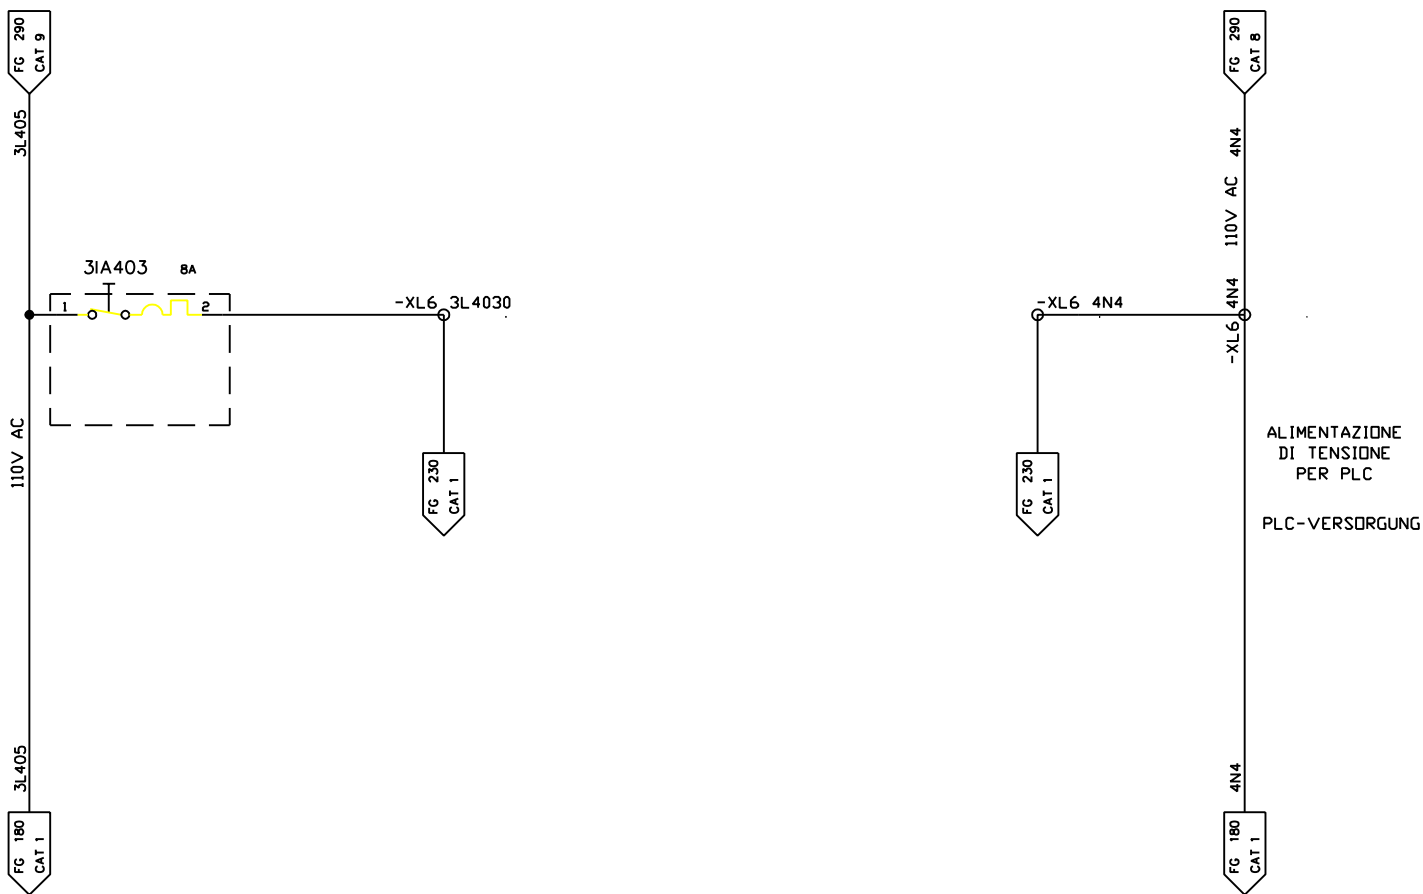

FMA	DIS. N. 31239.12812	MACCHINA/IMPIANTO : FMA 453		ORDINE : 30.007629	TENS. DI COMANDO 220V AC/110V AC	1N5	030
	CAD : Autocad 10	LAVORAZIONE : ALBERO MOTORE		COMMESSA :	STEUERSpannung 220V AC/110V AC		
	N. FILE : 20A30	DENOMINAZIONE : TRASFERTA		ESECUTORE : TP/BR	ARMADIO 1.2	UNITA 20A	SEGUE
	POS. ARCH.:	DATA : 11.12.92	AGG. : a b				