


1
—
2
—
3
—
4
—
5
—
6
—
7
—
8
—
9
—
10
—
11
—
12
—
13
—
14
—
15
—
16
—
17
—
18

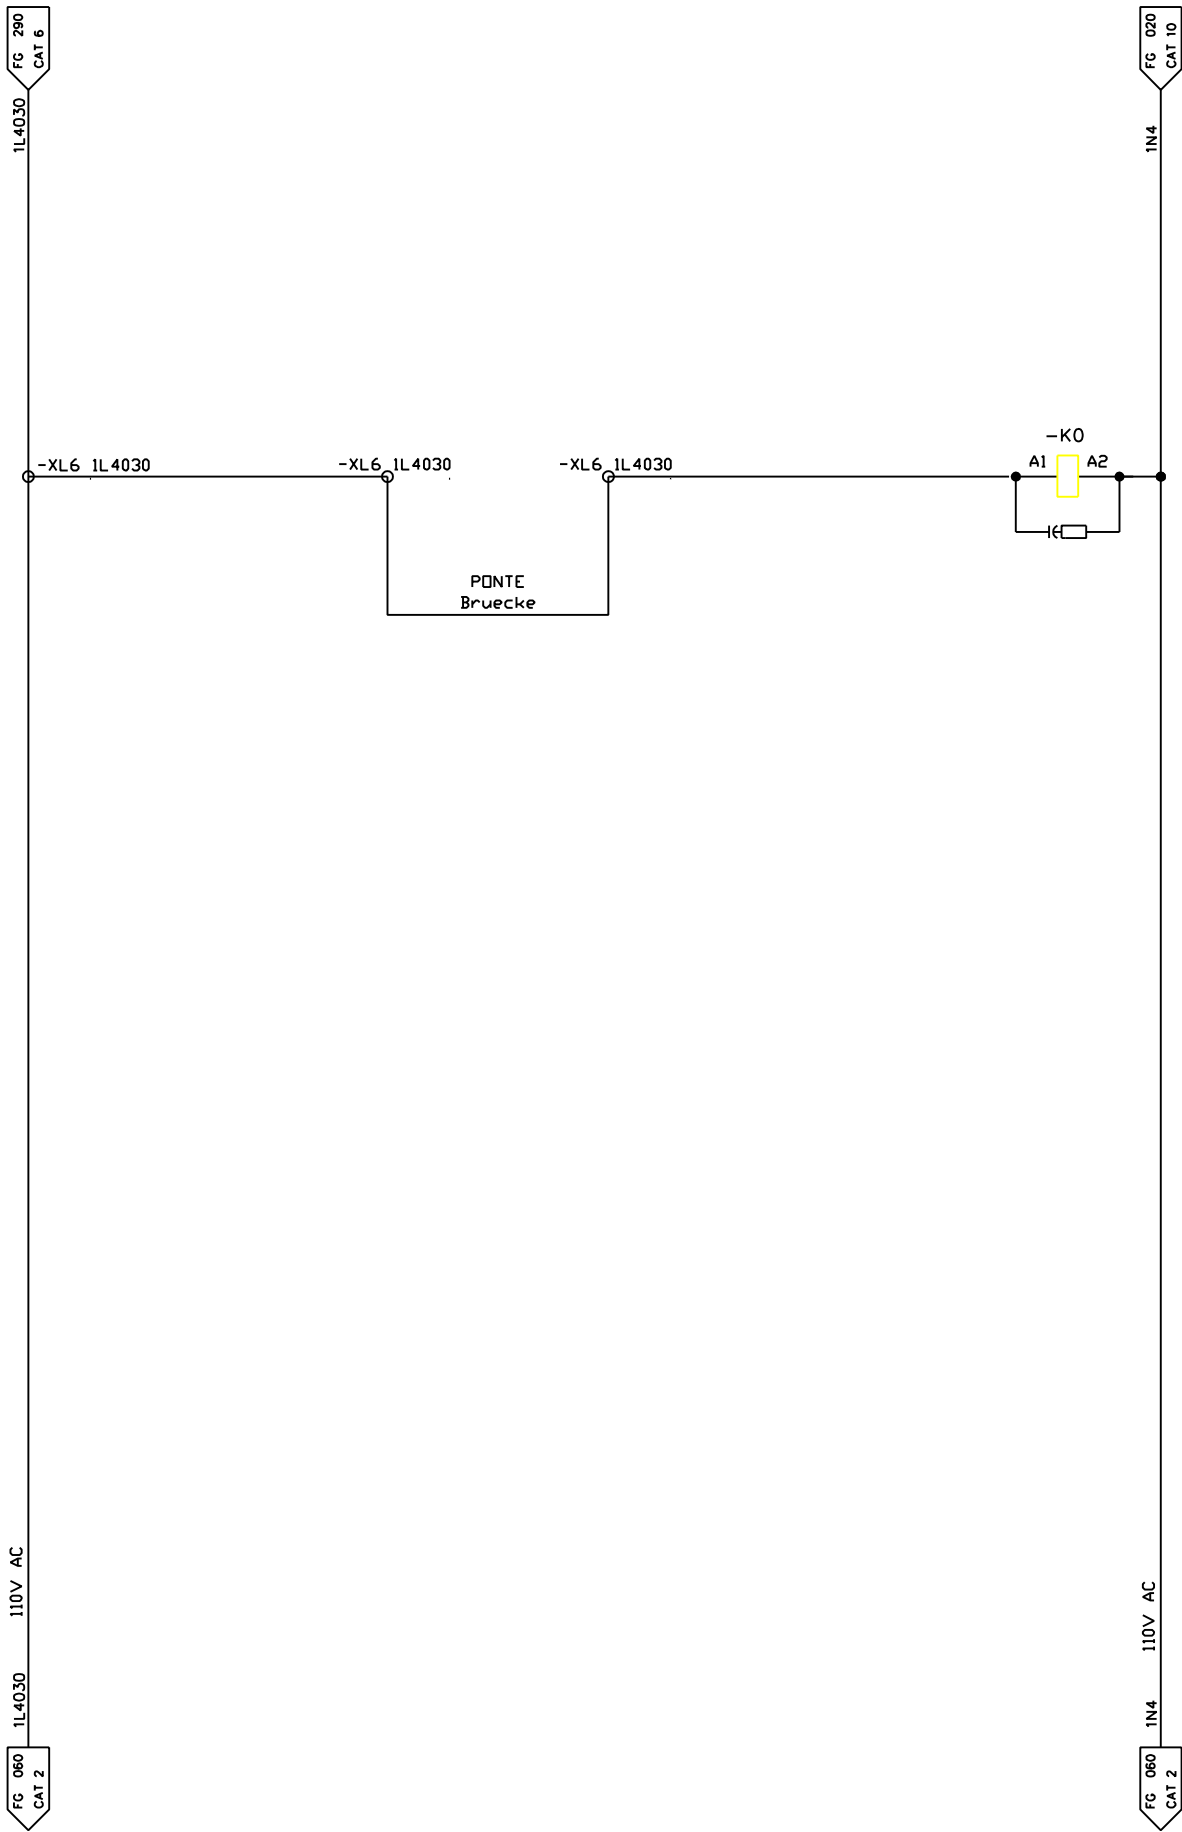

INSERIMENTO
TENSIONE COMANDO
STEUERSpannung EIN

NA	070/3	020/8	020/12	030/5
NC				
NA	x	x		
NC	x	x		

FMA	DIS. N. 31239.13810		MACCHINA/IMPIANTO : FMA 453			ORDINE : 30.007629		INS.TENSIONE COMANDO STEUERSpannung EIN ARMADIO 1.1	SE	FOGLIO 050
	CAD :Autocad 10		LAVORAZIONE : ALBERO MOTORE			COMMESSA :				
	N. FILE : 20B50		DENOMINAZIONE : TRASFERTA			ESECUTORE : HET				
	POS. ARCH.:		DATA : 10.12.92	AGG. ^a	^b					
									UNITA 20B	SEGUE