
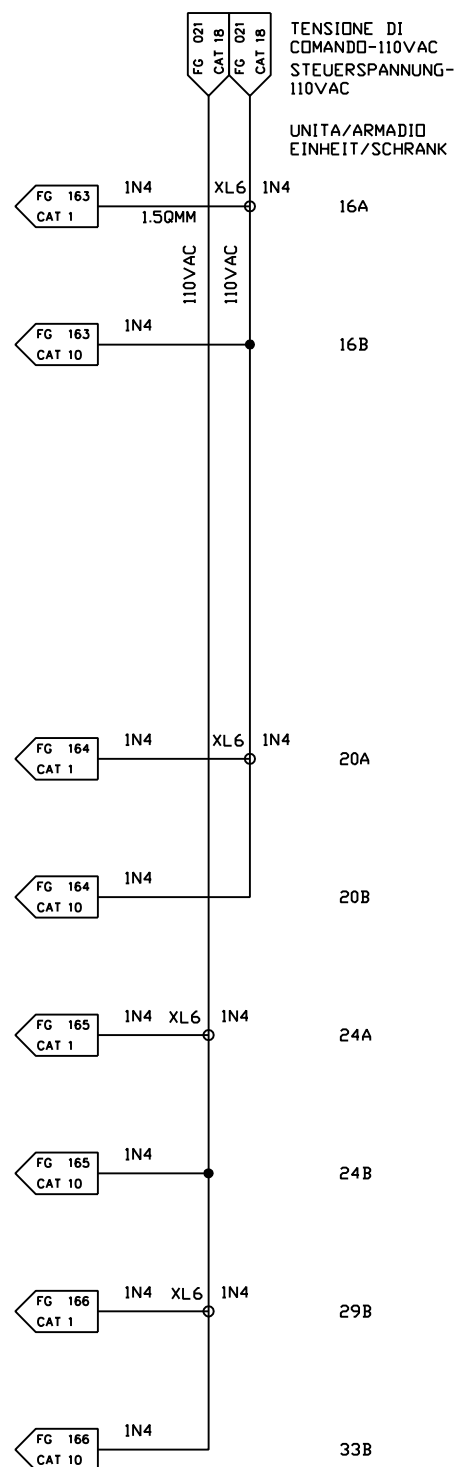


1
—
2
—
3
—
4
—
5
—
6
—
7
—
8
—
9
—
10
—
11
—
12
—
13
—
14
—
15
—
16
—
17
—
18

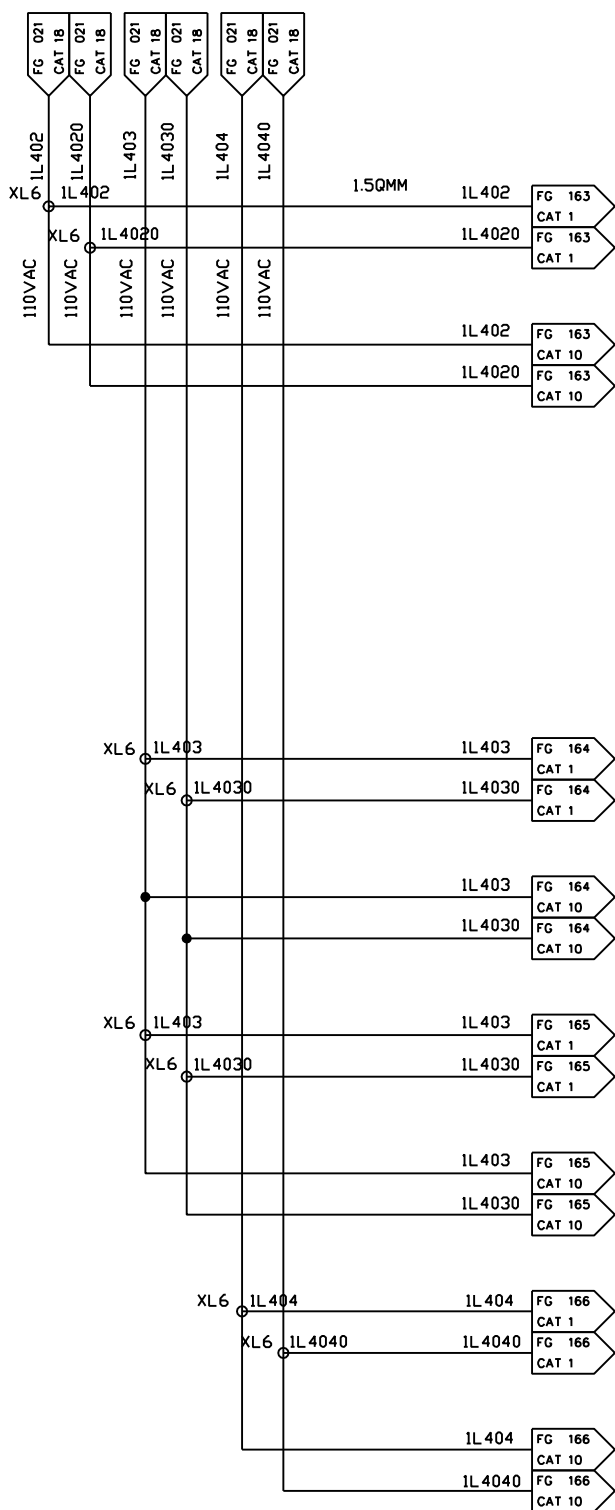

TENSIONE DI
COMANDO-110VAC
STEUERSPANNUNG-
110VAC
UNITA'/ARMADIO
EINHEIT/SCHRANK

FMA	DIS. N. : 31239.80017	MACCHINA/IMPIANTO : FMA 453		ORDINE : 30.007629	STEUERSPANNUNG 110VAC	1N4	022
	CAD : AUTOCAD 10	LAVORAZIONE : ALBERO MOTORE		COMMESSA :			
	N. FILE : F453_022	DENOMINAZIONE : TRASFERITA		ESECUTORE :	TENSIONE DI COMANDO 110VAC	ARMADIO 3	SEGUE
	POS. ARCH.:	DATA : 22.03.93	AGG. : ^a ^b				