


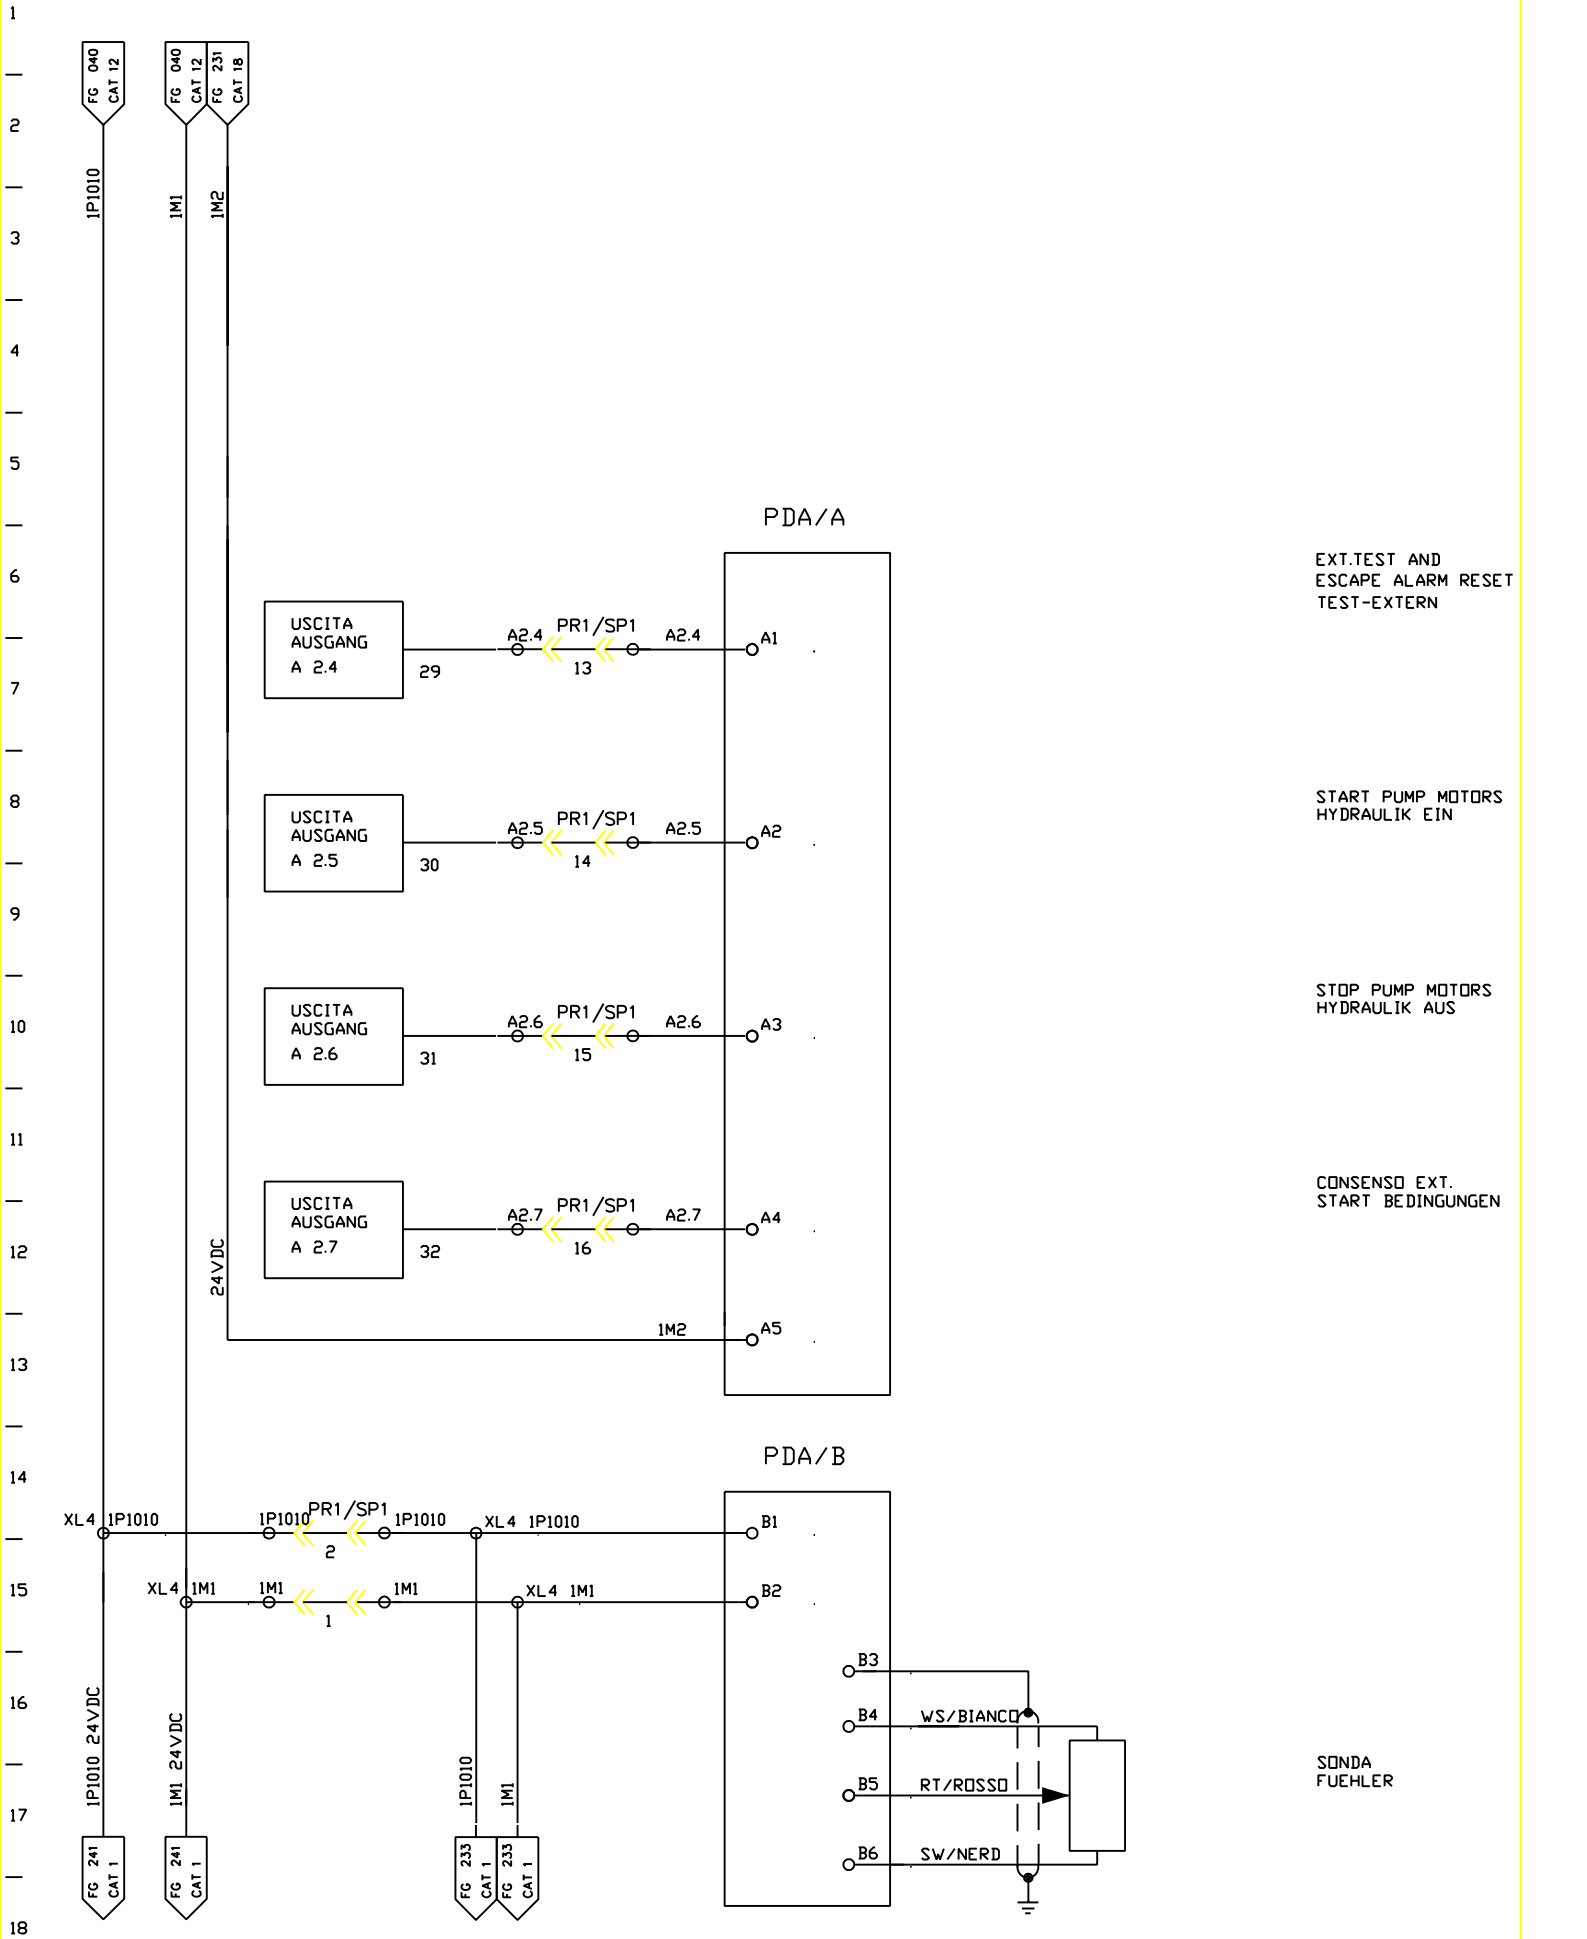

EXT.TEST AND
ESCAPE ALARM RESET
TEST-EXTERN

START PUMP MOTORS
HYDRAULIK EIN

STOP PUMP MOTORS
HYDRAULIK AUS

CONSENSO EXT.
START BEDINGUNGEN

SONDA
FUEHLER

FMA	DIS. N. : 31239.80017	MACCHINA/IMPIANTO : FMA 453		ORDINE : 30.007629	HYDRAULIK	HY	232
	CAD : AUTOCAD 10	LAVORAZIONE : ALBERO MOTORE		COMMESSA :			
	N. FILE : F453_232	DENOMINAZIONE : TRASFERTA		ESECUTORE :	IDRAULICO	ARMADIO 7	SEGUE
	POS. ARCH.:	DATA : 01.04.1993	AGG. : a b				