




Date/Time 20/09/2019 12:35:55

Page 1 of 2

Data e ora della misurazione 17/09/2019 15:41:01

REM\EQUILIBRATE\VENTILATORE RICIRCOLO FUMI LINEA 3\SPETTRI\lv2v.srveas

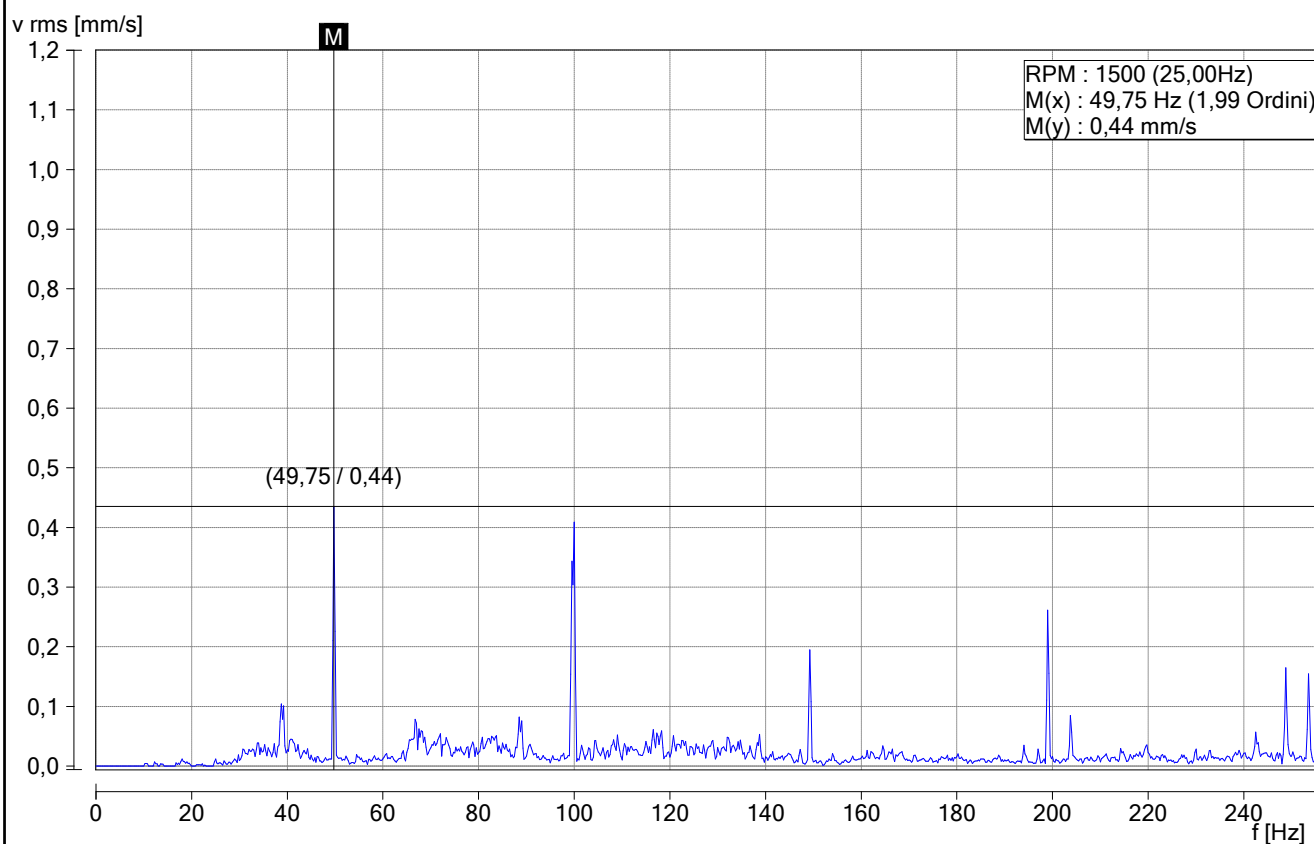

Cursore X [Hz] = 49,75

Principale

Y [mm/s] = 0,44

Cursore delta

X [Hz] = Non Attivo

Y [mm/s] = Non Attivo

RPM = 1500

RMS Y [mm/s] = 1,55



Date/Time

20/09/2019 12:35:56

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	298,50	1,09
2	49,75	0,44
3	100,00	0,41
4	398,00	0,36
5	99,50	0,34
6	199,00	0,26
7	303,25	0,21
8	348,25	0,20
9	149,25	0,19
10	248,75	0,16