


Data e ora della misurazione30/09/2024 11:41:19

REM\LINEA 3\POMPA POZZO CALDO A\POMPA\P1V\1004 ENVELOPE SPETTRO ACC

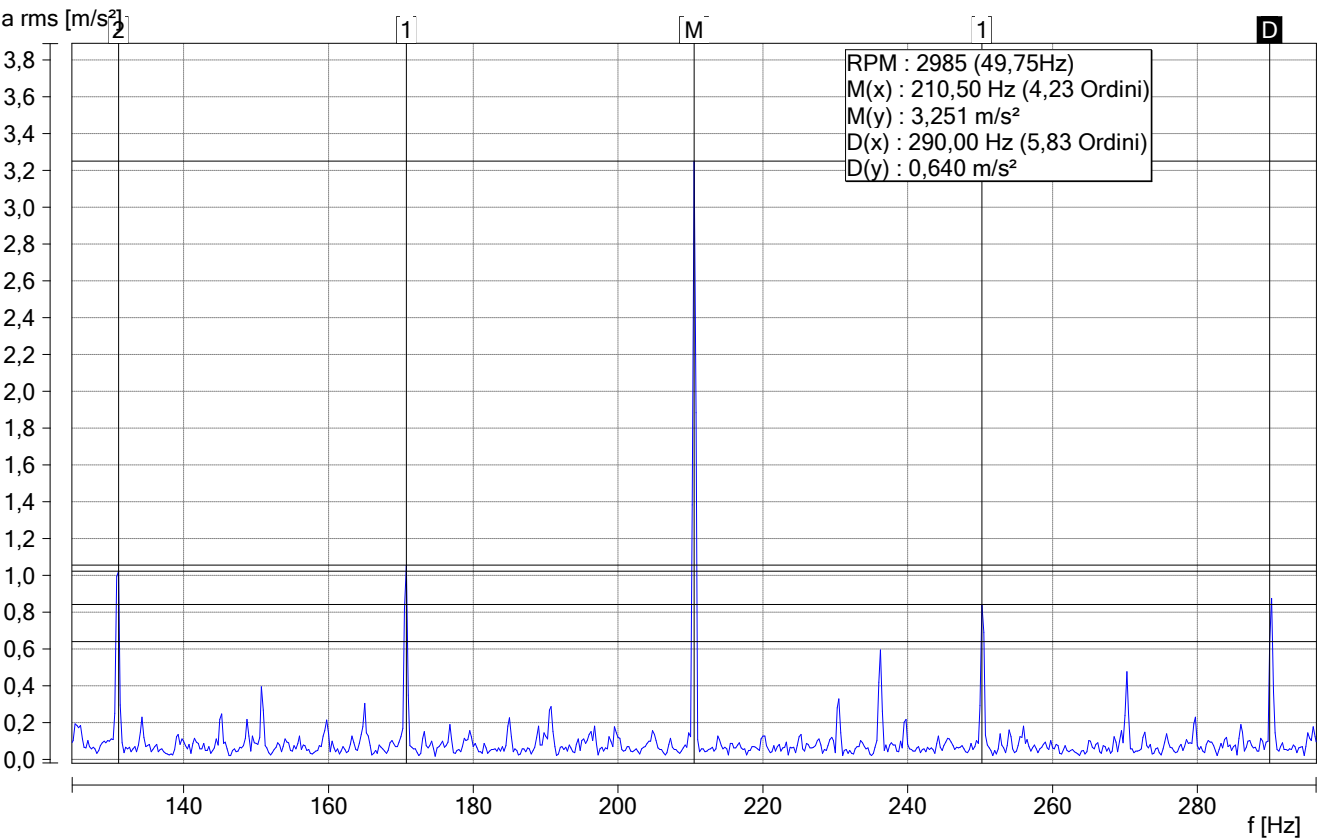

Cursore X [Hz] = 210,50
Principale Y [m/s²] = 3,251
Cursore delta X [Hz] = 290,00
Y [m/s²] = 0,640
RPM = 2985
RMS Y [m/s²] = 7,84

Canale #	A	
	X [Hz]	Y [m/s ²]
1	210,50	3,251
2	842,00	2,406
3	79,75	2,307
4	1052,50	1,979
5	39,75	1,412
6	315,75	1,170
7	421,00	1,137
8	1263,25	1,084
9	170,75	1,055
10	131,00	1,022