




Cursore Principale	X [Hz]	= 49,75	(49,77) Unbalance Unbalance
	Y [mm/s]	= 0,54	
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 2986	
RMS	Y [mm/s]	= 1,96	

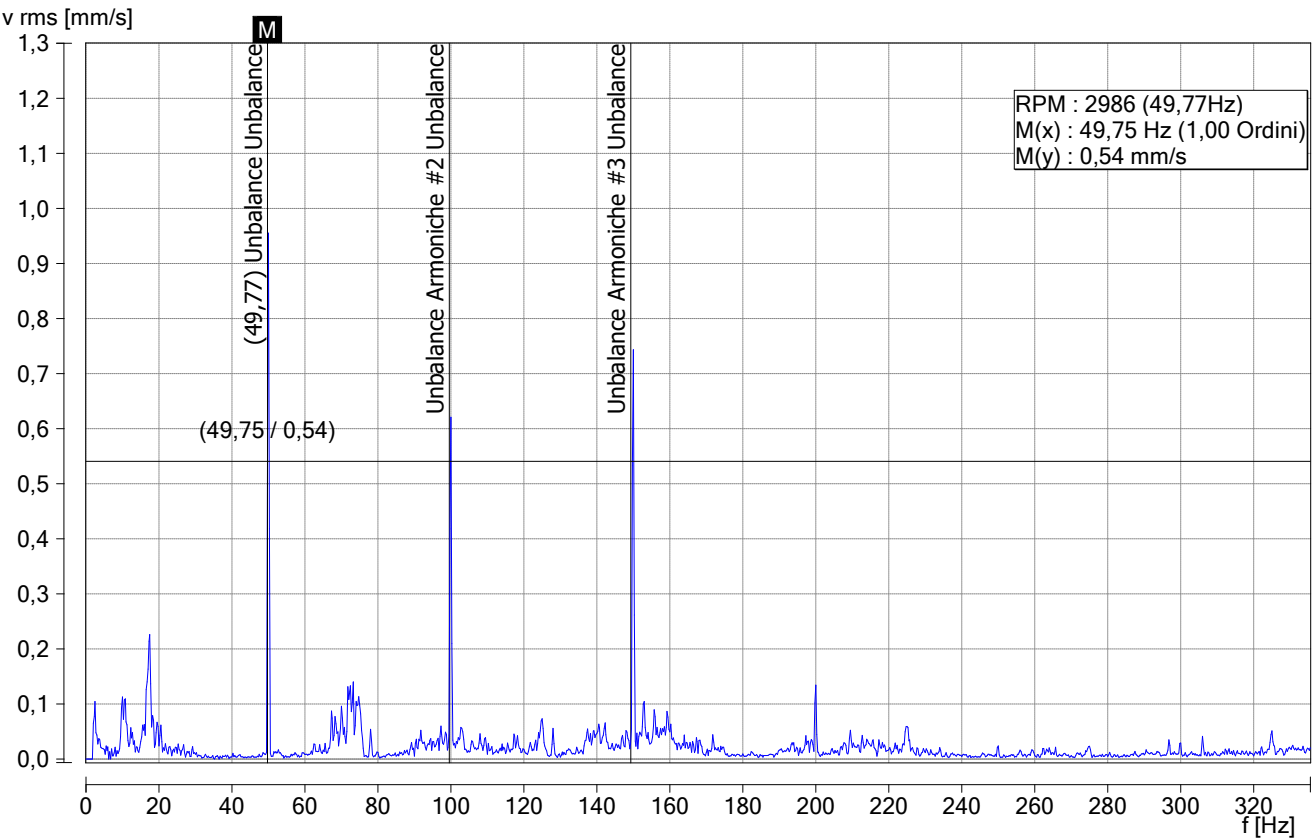

Date/Time

17/07/2019 16:34:17

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	499,75	1,10
2	50,00	0,96
3	150,00	0,74
4	100,00	0,62
5	790,50	0,29
6	17,50	0,23
7	73,25	0,14
8	200,00	0,13
9	72,50	0,13
10	71,75	0,13