


Data e ora della misurazione14/08/2019 16:48:06

REMAGC ROCCASECCA\VENTILATORE 2 SPB \MOTORE\M1V\103 Mach.spectr. > 600

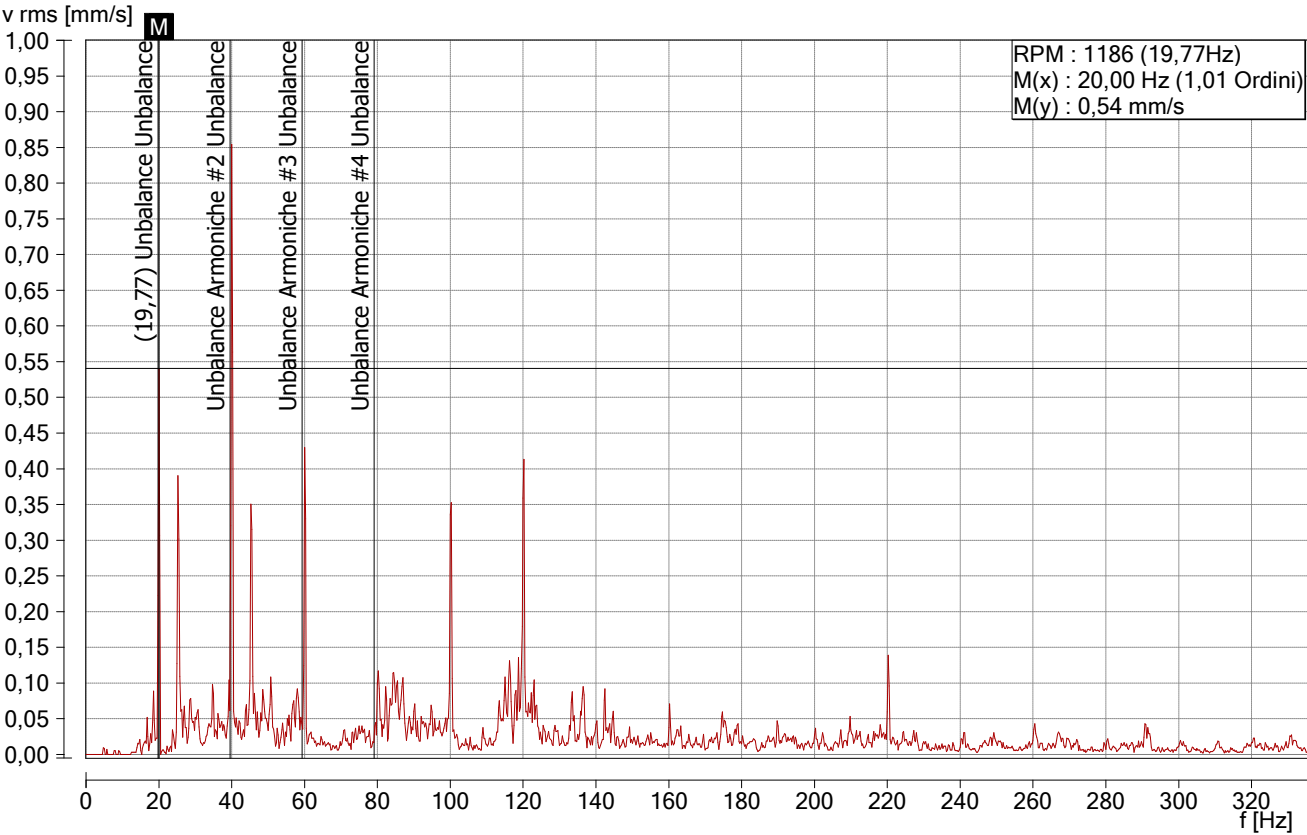

Cursore Principale	X [Hz]	= 20,00	(19,77) Unbalance Unbalance
	Y [mm/s]	= 0,54	
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 1186	
RMS	Y [mm/s]	= 1,58	

Canale #	A	
	X [Hz]	Y [mm/s]
1	40,00	0,85
2	20,00	0,54
3	60,00	0,43
4	120,25	0,41
5	25,25	0,39
6	100,25	0,35
7	45,25	0,35
8	220,25	0,14
9	118,75	0,14
10	116,25	0,13