


Data e ora della misurazione14/12/2023 11:01:57

REMAGC ROCCASECCAVENTILATORE 2 COOLING INFERIORE SPB \VENTILATORE A 11
PALE\2V\1005 Envelope Spectrum Acceleration

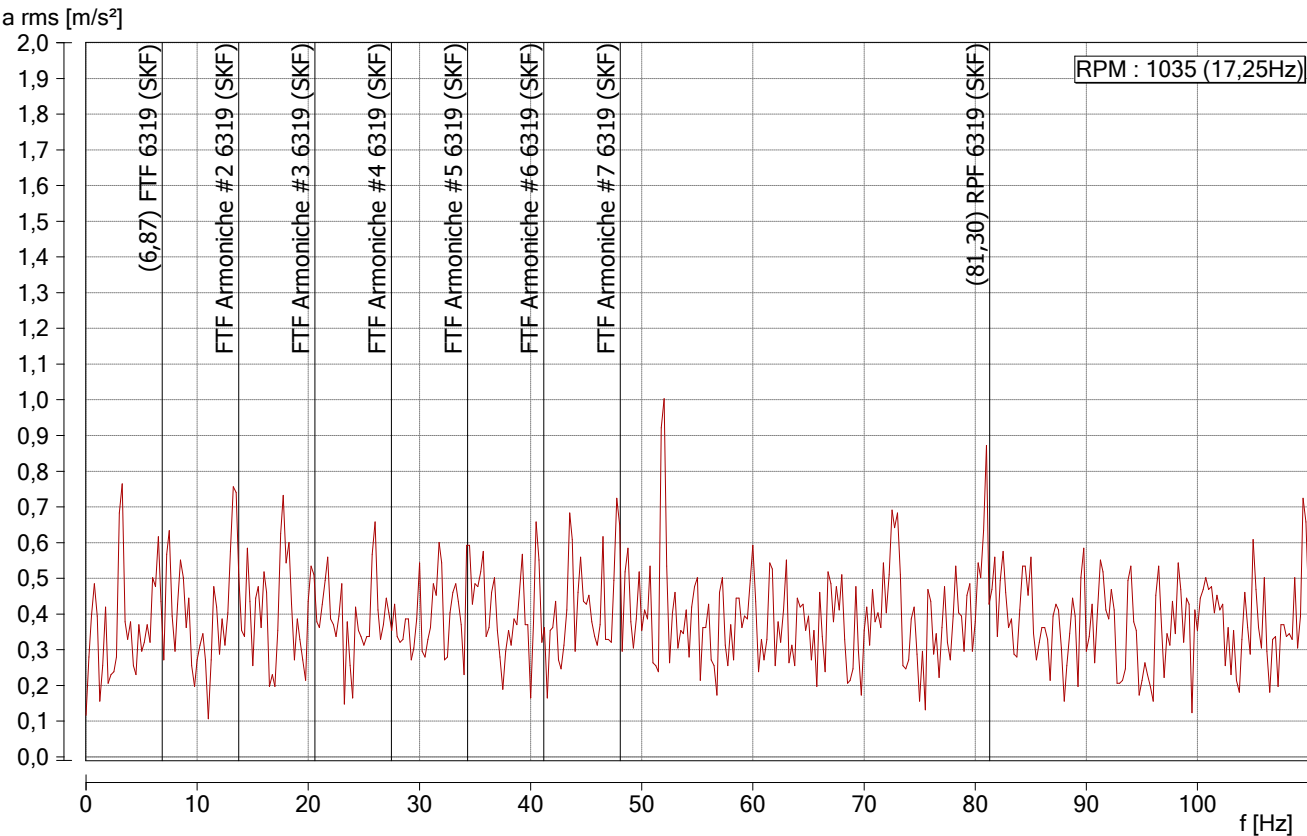

Cursore Principale	X [Hz]	= Non Attivo	(81,30) RPF 6319 (SKF)
	Y [m/s ²]	= Non Attivo	(6,87) FTF 6319 (SKF)
Cursore delta	X [Hz]	= Non Attivo	
	Y [m/s ²]	= Non Attivo	
RPM		= 1480	
RMS	Y [m/s ²]	= 16,03	

Canale #	A	
	X [Hz]	Y [m/s ²]
1	526,00	1,744
2	263,00	1,036
3	52,00	1,003
4	138,75	0,913
5	81,00	0,872
6	126,25	0,790
7	219,00	0,773
8	3,25	0,765
9	13,25	0,757
10	191,25	0,740