


Data e ora della misurazione14/12/2023 11:17:43

REM\AGC ROCCASECCA\VENTILATORE 3 QUENCH 2 SUPERIORE SPB \VENTILATORE A 16
PALEIV2V\1005 Envelope Spectrum Acceleration

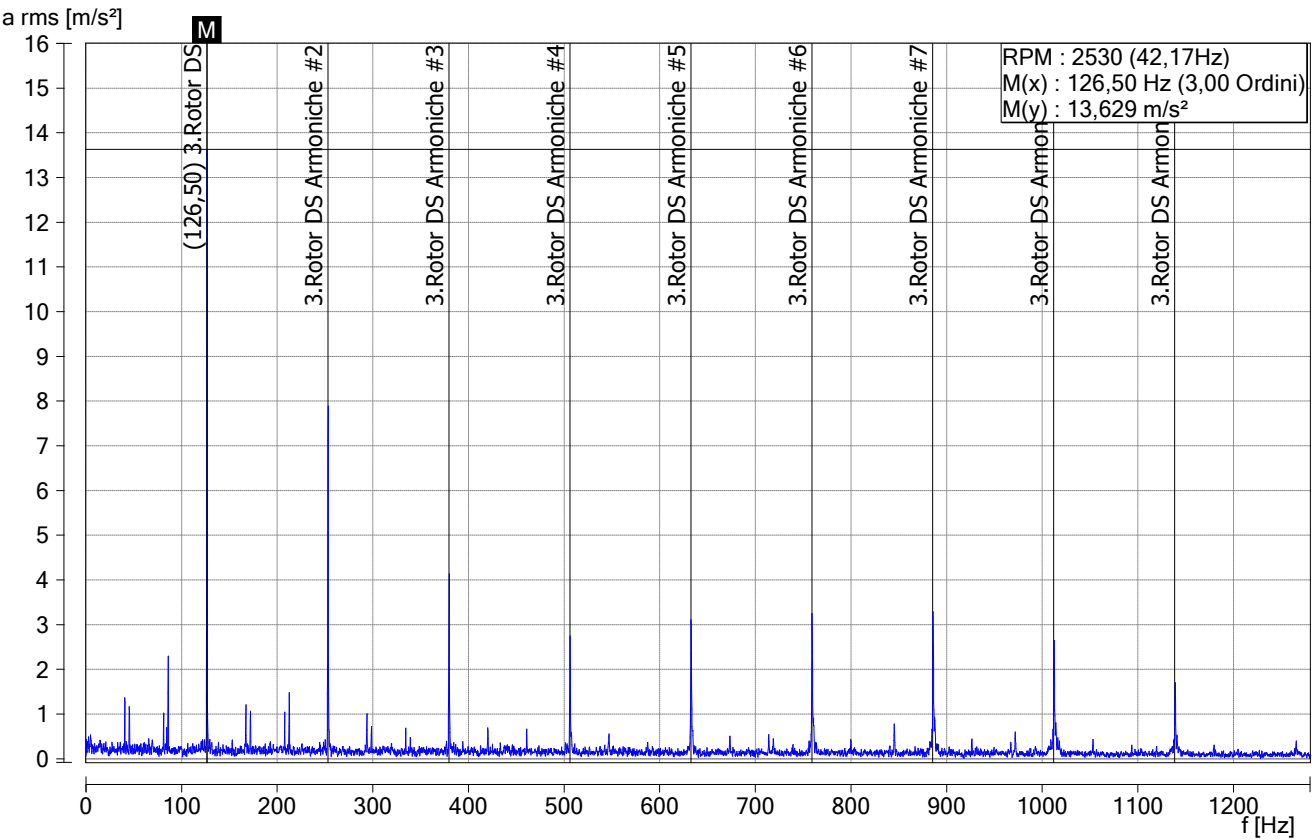

Cursore X [Hz] = 126,50 (126,50) 3.Rotor DS
Principale Y [m/s²] = 13,629
Cursore delta X [Hz] = Non Attivo
Y [m/s²] = Non Attivo
RPM = 2530
RMS Y [m/s²] = 20,21

Canale #	A	
	X [Hz]	Y [m/s ²]
1	126,50	13,629
2	253,25	7,888
3	379,75	4,137
4	885,75	3,290
5	759,25	3,249
6	632,75	3,109
7	506,25	2,747
8	1012,50	2,648
9	86,00	2,295
10	1139,00	1,702