


Data e ora della misurazione14/12/2023 10:45:02 ,01/03/2024 12:54:30

REMAGC ROCCASECCA\VENTILATORE 1 COOLING SUPERIORE SPB \VENTILATORE A 10
PALE\W2V1005 Envelope Spectrum Acceleration

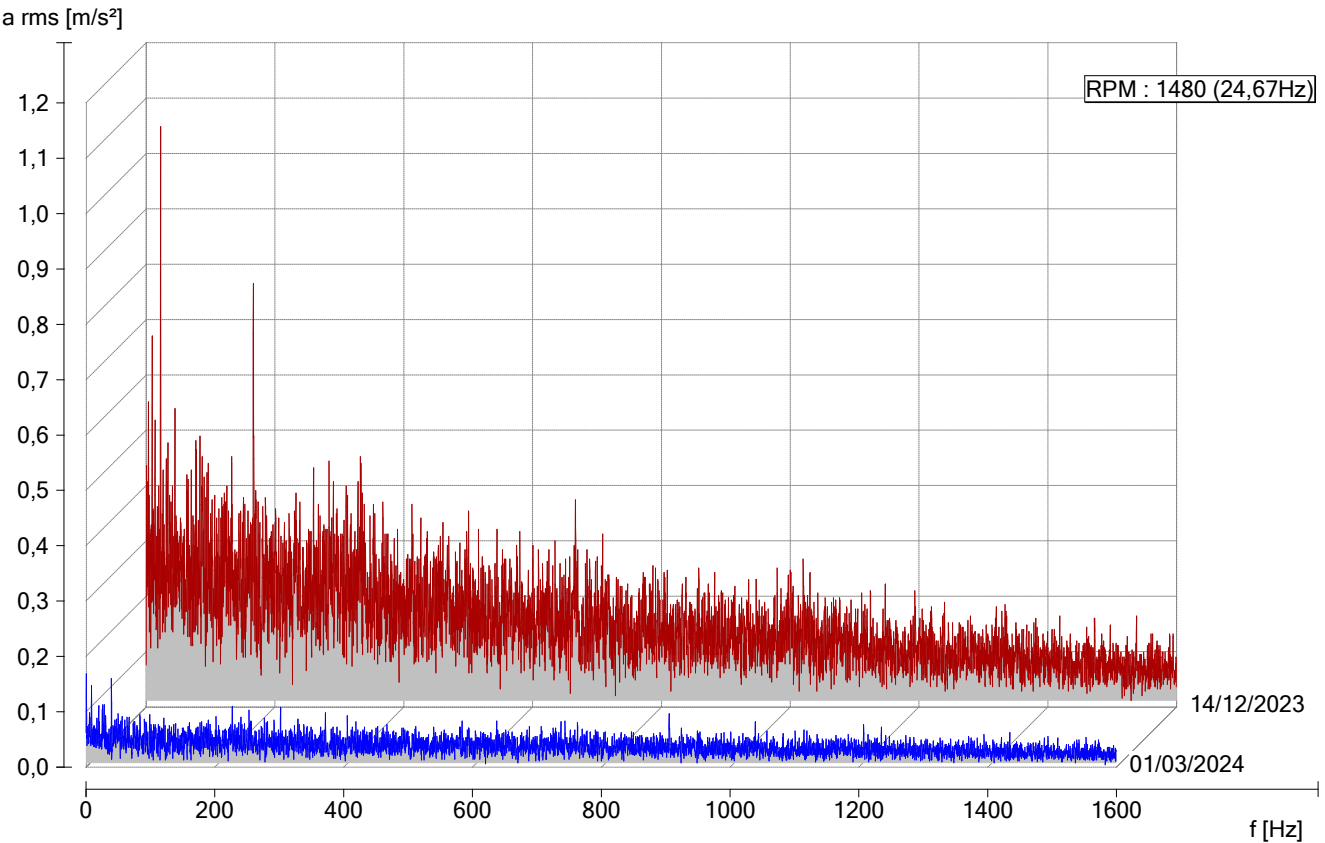

Cursore Principale	X [Hz]	= Non Attivo	(100,000) Elect.100 Hz Electrical
	Y [m/s²]	= Non Attivo	(50,000) Elect.50 Hz Electrical
	X [Hz]	= Non Attivo	(24,67) Unbalance Unbalance
	Y [m/s²]	= Non Attivo	(24,67) 1.Align Misalignment
		= 1480	(49,33) 2.Align Misalignment
			(24,67) 1.Res. RPM Resonance
			(49,33) 2.Res. RPM Resonance
			(74,00) 3.Res. RPM Resonance
			(98,67) 4.Res. RPM Resonance
			(24,67) 1.Rotor DS Harmonics DS
			(49,33) 2.Rotor DS Harmonics DS
			(74,00) 3.Rotor DS Harmonics DS
			(98,67) 4.Rotor DS Harmonics DS
			(123,33) 5.Rotor DS Harmonics DS
			(88,43) BPFO 6319 (SKF)
			(133,57) BPFI 6319 (SKF)
			(116,25) RPF 6319 (SKF)
			(9,82) FTF 6319 (SKF)
			(175,65) BPFO 22222E (SKF)
			(243,68) BPFI 22222E (SKF)

Date/Time 02/03/2024 11:19:09

Page 2 of 2

(146,10) RPF 22222E (SKF)
(10,34) FTF 22222E (SKF)
(188,45) BPFO 2222 (SKF)
(255,55) BPFI 2222 (SKF)
(156,88) RPF 2222 (SKF)
(10,36) FTF 2222 (SKF)
(201,58) BPFO 22222 (SKF)
(267,09) BPFI 22222 (SKF)
(170,40) RPF 22222 (SKF)
(10,61) FTF 22222 (SKF)
(271,33) ventilatore 26 pale VENTILATORE 11 PALE