


Data e ora della misurazione08/01/2024 11:17:18

REM\AGC ROCCASECCA\VENTILATORE 3 QUENCH 2 SUPERIORE SPB \VENTILATORE A 16
PALEIV2V\1061 SPETTRO IN ACC 3200HZ

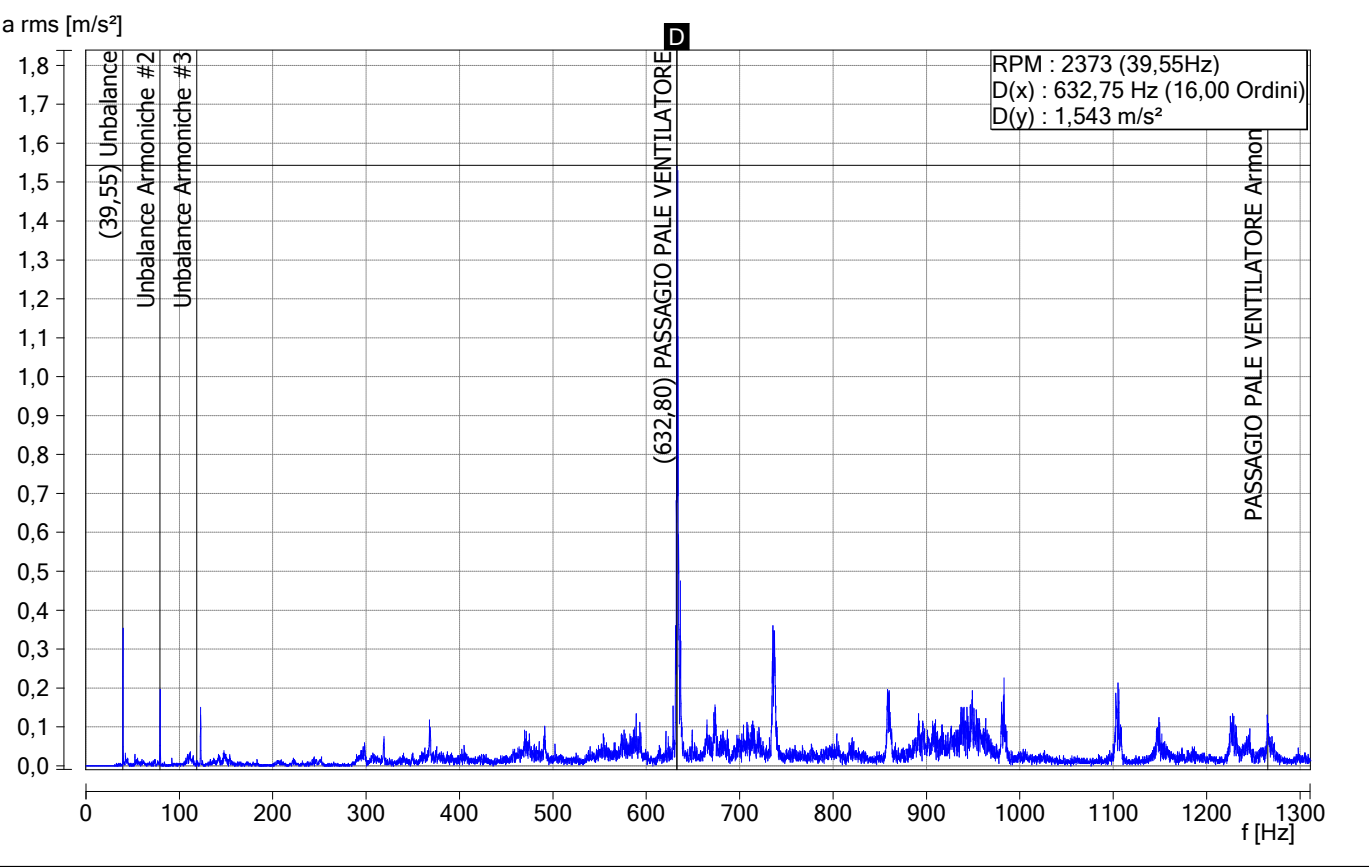

Cursore Principale	X [Hz]	= Non Attivo	(632,80) PASSAGIO PALE VENTILATORE
	Y [m/s²]	= Non Attivo	(39,55) Unbalance
Cursore delta	X [Hz]	= 632,75	
	Y [m/s²]	= 1,543	
RPM		= 2975	
RMS	Y [m/s²]	= 8,84	

Canale #	A	
	X [Hz]	Y [m/s²]
1	632,75	1,543
2	633,75	1,530
3	2207,75	1,196
4	2208,50	1,058
5	2210,25	1,016
6	2206,75	1,006
7	2212,88	1,006
8	633,38	0,993
9	2206,38	0,986
10	2207,25	0,904