


R1 R2
 S1 S2
 T1 T2

SCHEMA
 RILEVATO AD AUGUSTO 2011
 (OK)

PASSO 12 2A2

SPIN 6
 SE 2 = 4 FILI 10A 1,18-4 FILI 10A 1,25

FINEST. TP. H 355 H 4-6
 KW 160/110 V. 690-400 A 165/285
 V 690-400 A 125 245
 ALI 1485-990

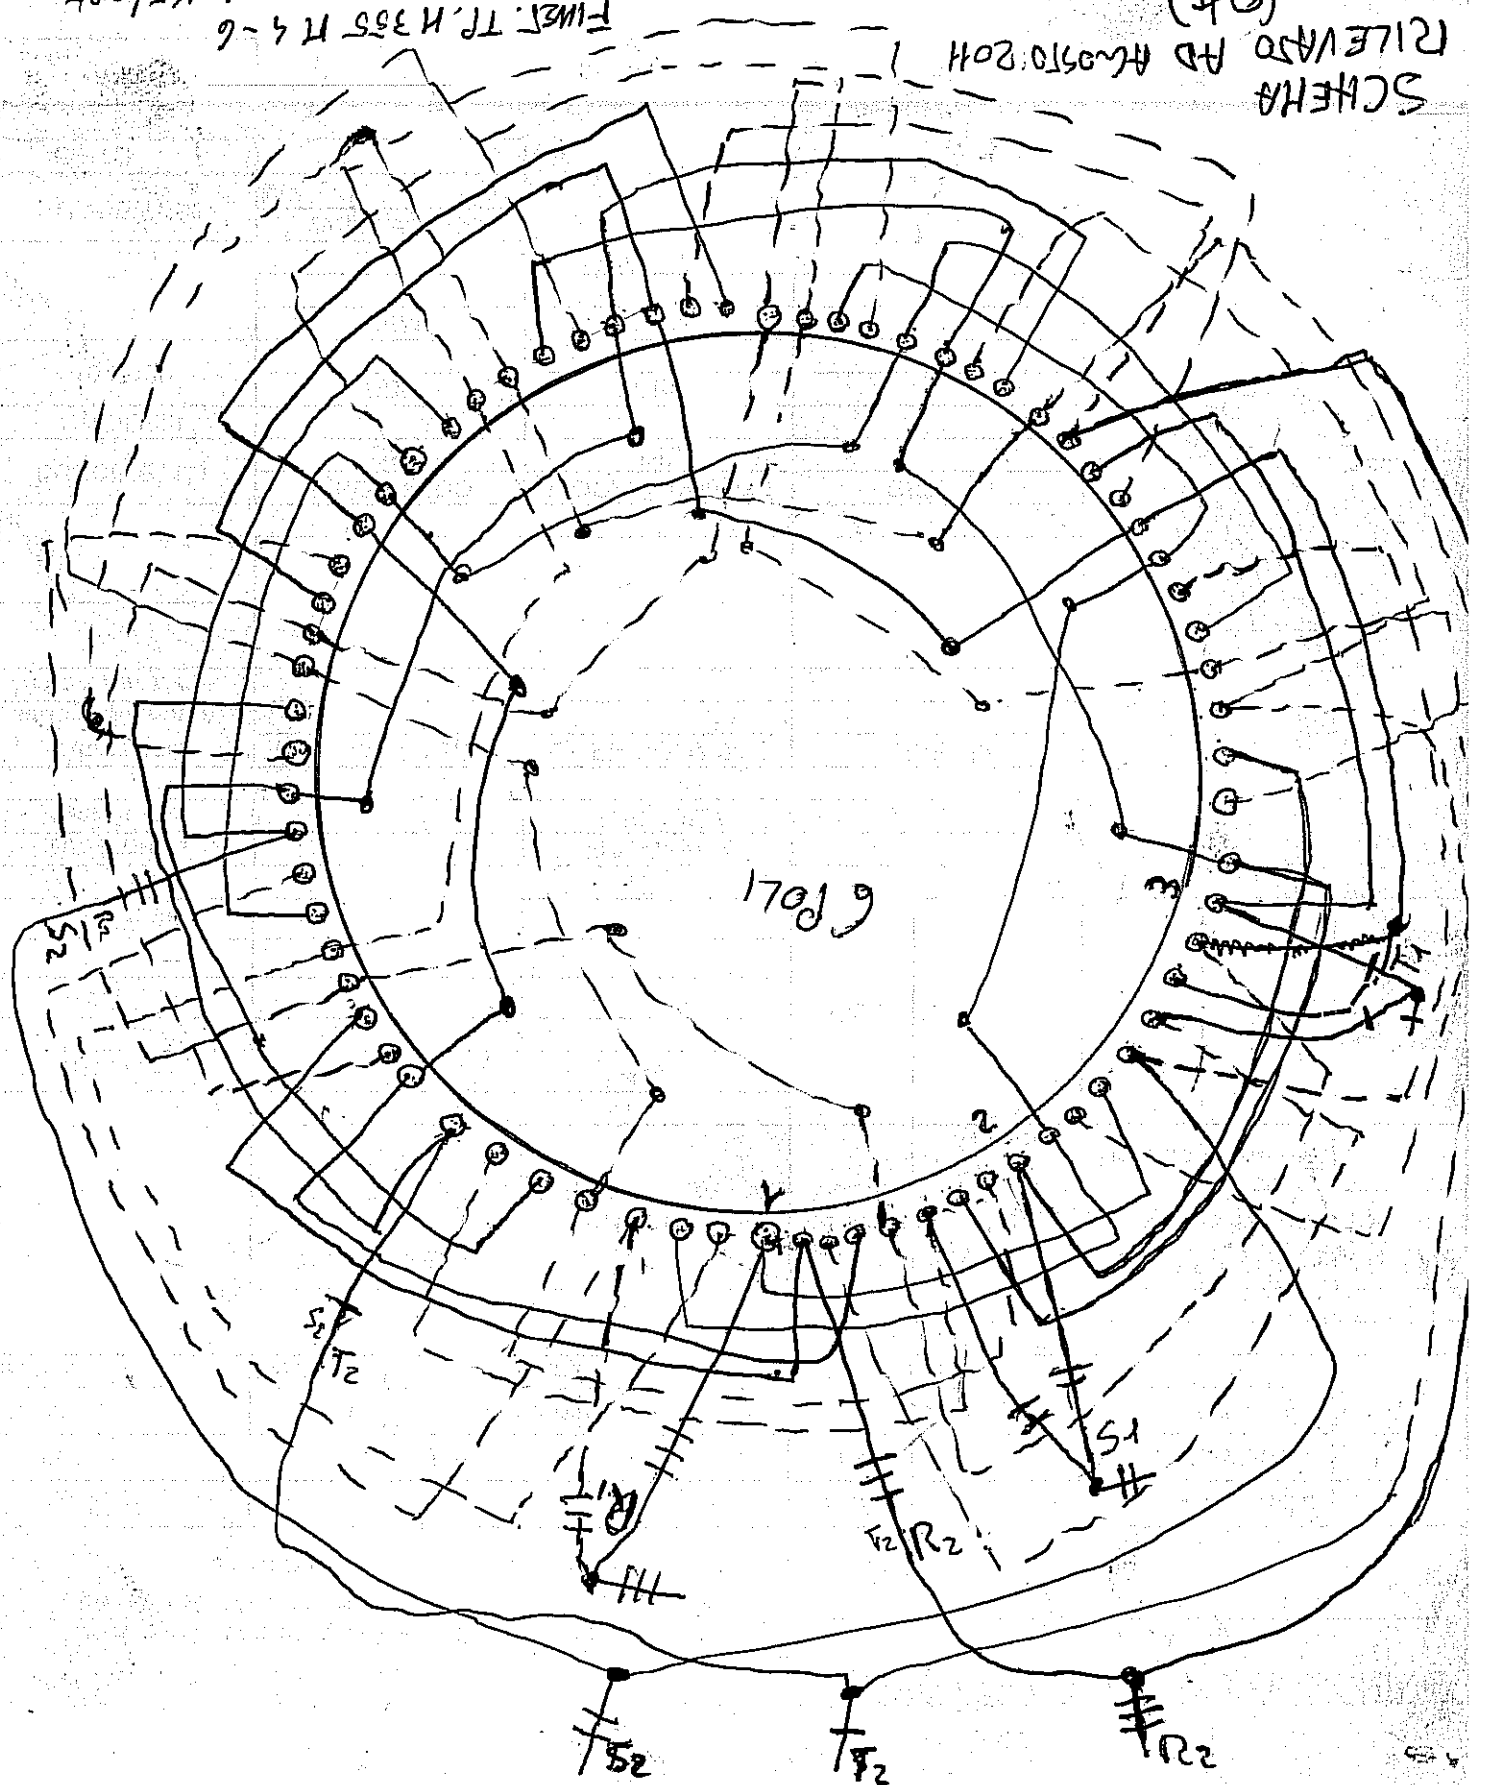

SCHEMA NILEVATO
RAD AC 0550 2041
(OK)

TURN.	121-122
TURN.	54-52
TURN.	14-12

FILET T.P.H 355 H 4-6
KX 460/440 VOLT. 680/400 690/400
PASSO=14-16-18-165/285 125/245
SPINZ=4-4-5 CINI 1485 - 990
DEZ = 5 FILI DA 1,32 - 2 FILI DA 1,40 - 4 FILI DA 1,25

