




REM\BURGO GROUP SORA\VENTILATORE PILLER LATO SORA MACCHINA 2\MOTORE\M1V\1003
SPETTRO MACCHINA 400 HZ



Cursore Principale	X [Hz]	= 49,75	(49,58) Unbalance Unbalance
	Y [mm/s]	= 15,03	
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 2975	
RMS	Y [mm/s]	= 16,27	

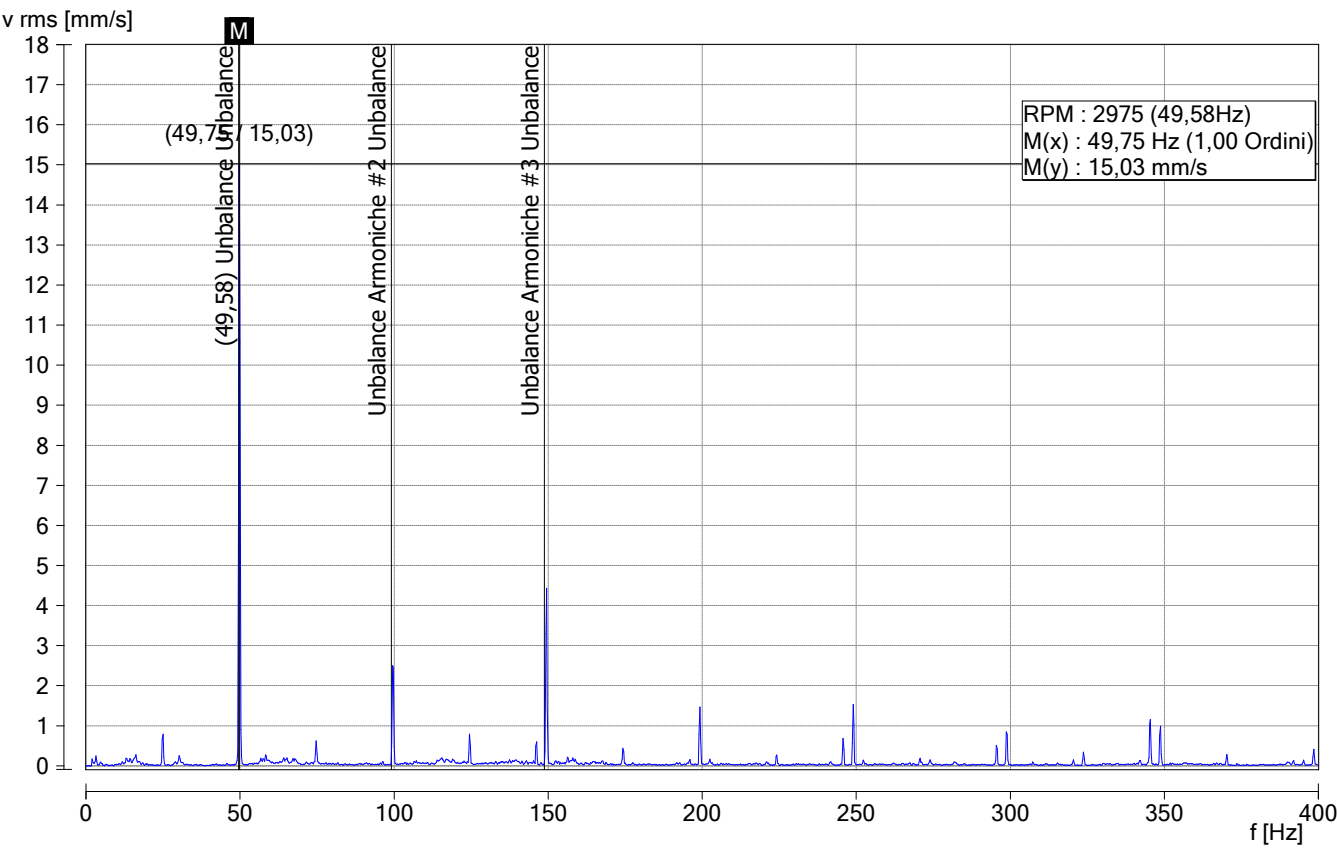

Date/Time

12/12/2019 15:10:23

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	49,75	15,03
2	149,50	4,43
3	99,50	2,50
4	249,00	1,53
5	199,25	1,47
6	345,50	1,15
7	348,75	0,99
8	298,75	0,84
9	124,50	0,79
10	25,00	0,79