




Cursore Principale	X [Hz]	= Non Attivo	(100,000) Elect.100 Hz Electrical
	Y [mm/s]	= Non Attivo	(50,000) Elect.50 Hz Electrical
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 2240	
RMS	Y [mm/s]	= 1,81	

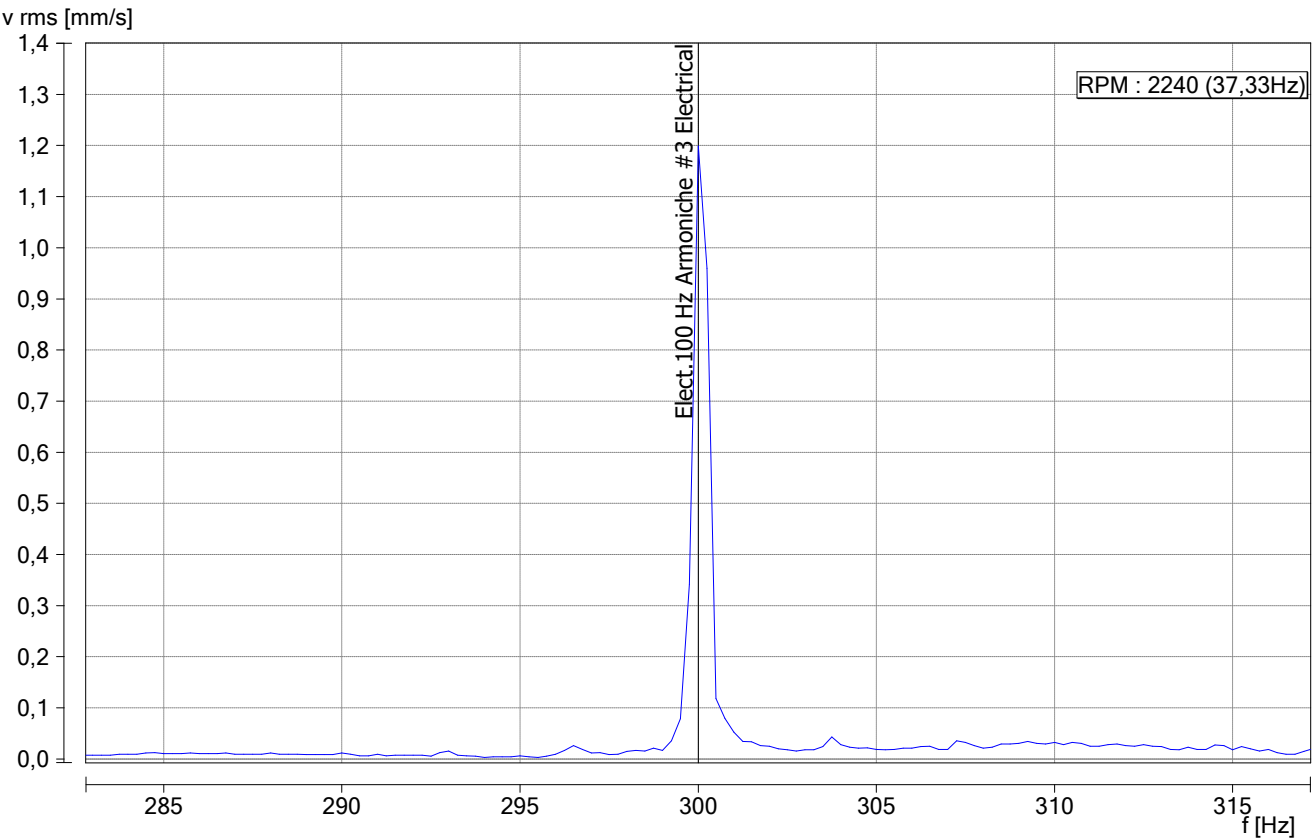

Date/Time

03/08/2018 12:05:26

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	300,00	1,20
2	48,25	0,77
3	323,00	0,67
4	21,50	0,33
5	23,00	0,29
6	46,00	0,22
7	22,25	0,21
8	19,50	0,20
9	20,00	0,18
10	18,75	0,16