




Cursore Principale	X [Hz]	= Non Attivo	(100,000) Elect.100 Hz Electrical
	Y [mm/s]	= Non Attivo	(50,000) Elect.50 Hz Electrical
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 2240	
RMS	Y [mm/s]	= 3,51	

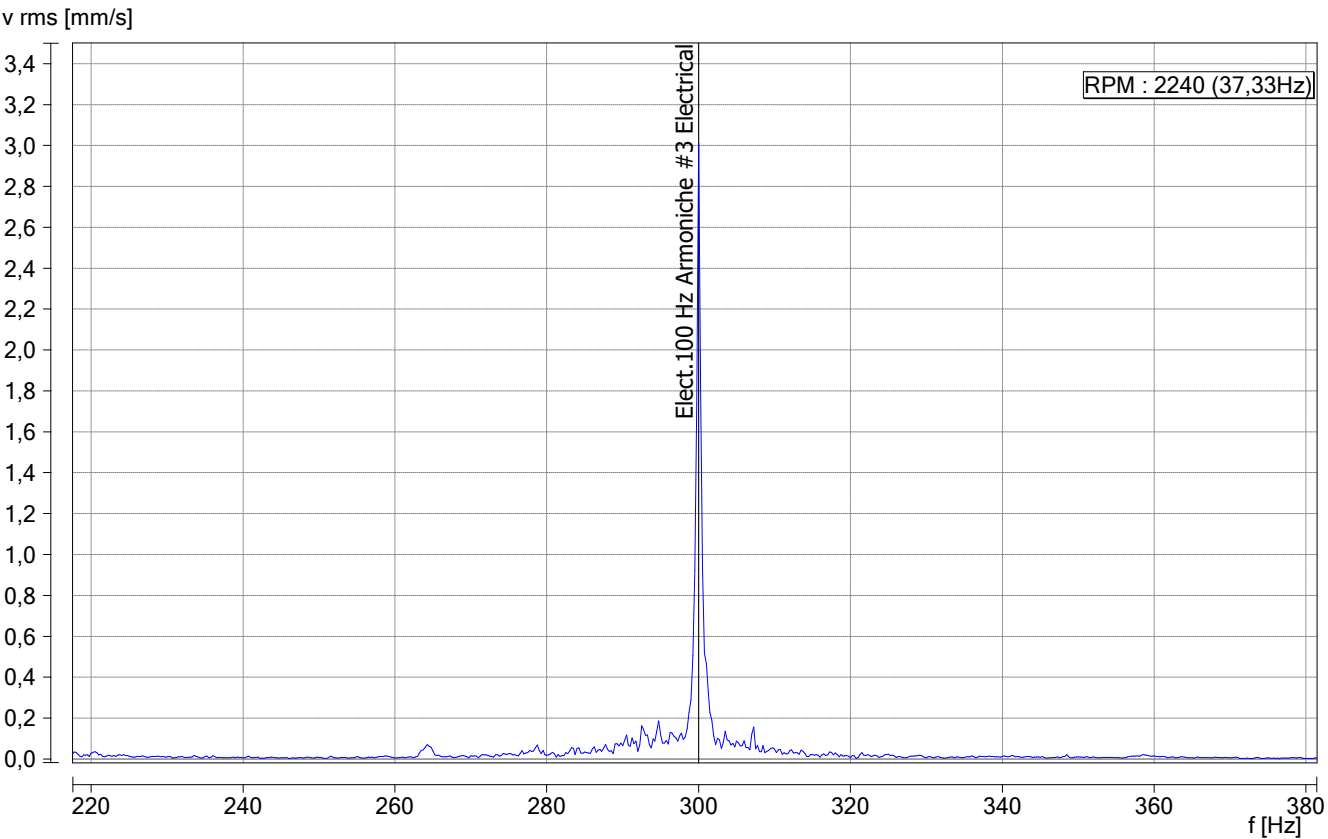

Date/Time

03/08/2018 12:01:10

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	300,00	3,01
2	3,75	0,72
3	48,50	0,63
4	31,00	0,57
5	28,00	0,41
6	4,50	0,37
7	30,25	0,36
8	28,75	0,34
9	45,25	0,28
10	26,25	0,28