




Date/Time 04/03/2021 14:25:09

Page 1 of 2

Data e ora della misurazione 03/03/2021 16:00:11

REM\ITALCHEMICAL\POMPA OLIO CALDO\MOTOREM2H\m2h.srcea

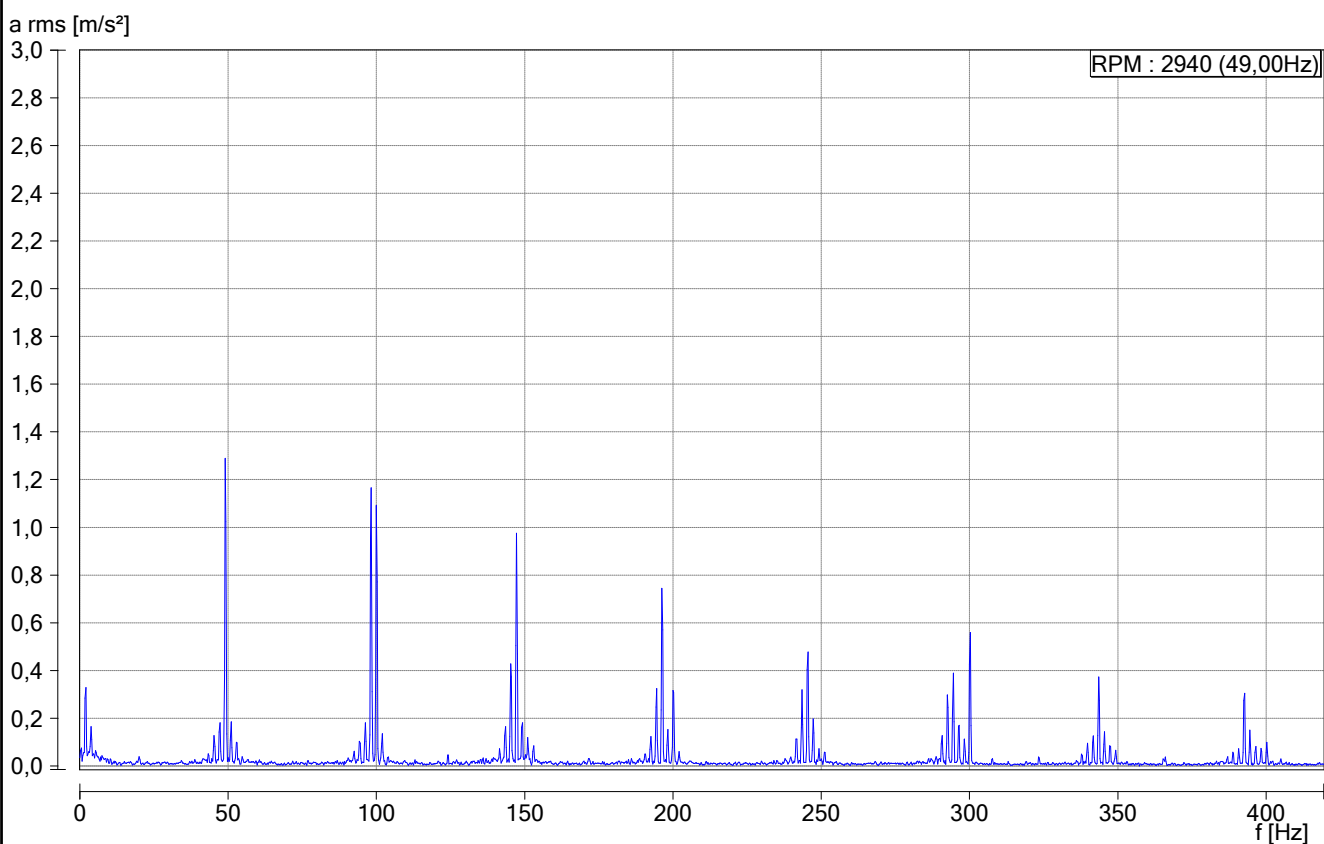

Cursore Principale	X [Hz]	= Non Attivo
	Y [m/s ²]	= Non Attivo
Cursore delta	X [Hz]	= Non Attivo
	Y [m/s ²]	= Non Attivo
RPM		= 2940
RMS	Y [m/s ²]	= 4,91



Canale #	A	
	X [Hz]	Y [m/s ²]
1	1176,00	2,480
2	1376,25	2,141
3	49,00	1,289
4	98,25	1,166
5	100,00	1,092
6	147,25	0,975
7	1327,00	0,837
8	196,25	0,744
9	1576,25	0,689
10	1276,00	0,596