




Date/Time 04/03/2021 14:27:41

Page 1 of 2

Data e ora della misurazione 03/03/2021 16:00:58

REM\ITALCHEMICAL\POMPA OLIO CALDO\MOTOREM2V\m2v.srveas

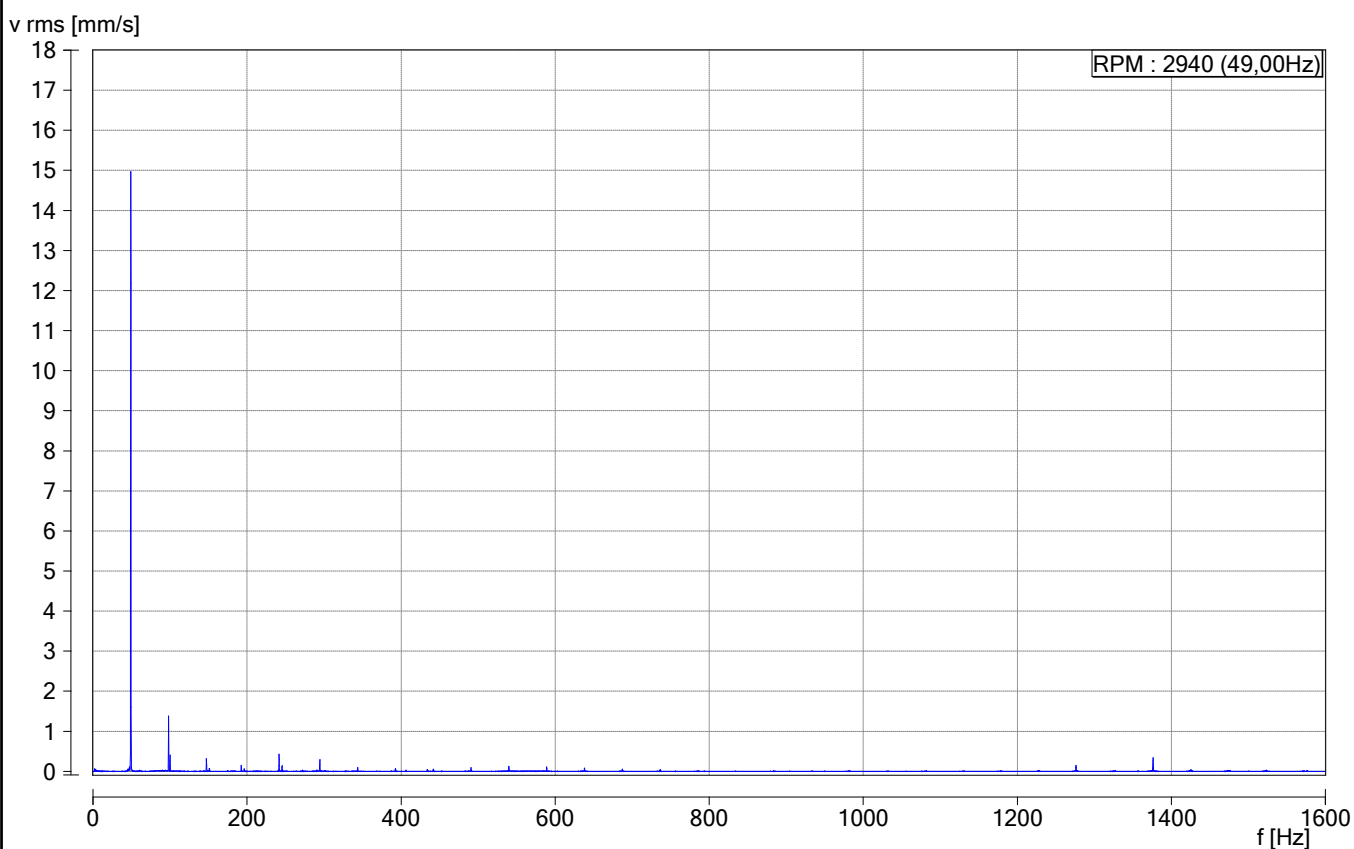

Cursore Principale	X [Hz]	= Non Attivo
	Y [mm/s]	= Non Attivo
Cursore delta	X [Hz]	= Non Attivo
	Y [mm/s]	= Non Attivo
RPM		= 2940
RMS	Y [mm/s]	= 15,06



Date/Time

04/03/2021 14:27:41

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	49,00	14,97
2	98,25	1,38
3	241,50	0,43
4	100,00	0,40
5	1376,25	0,34
6	147,25	0,32
7	294,50	0,30
8	1276,25	0,15
9	192,50	0,15
10	245,50	0,14