


PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-GIV-83 07:57:35
LETTURA GIRI : 333.
CARICO : 100.
VAL-TOT.=1.55 MM/SEC RMS DIGIT
SPETTRO =1.55 MM/SEC RMS DIGIT

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]


SPETTRO =1.55 MM/SEC RMS DIGIT

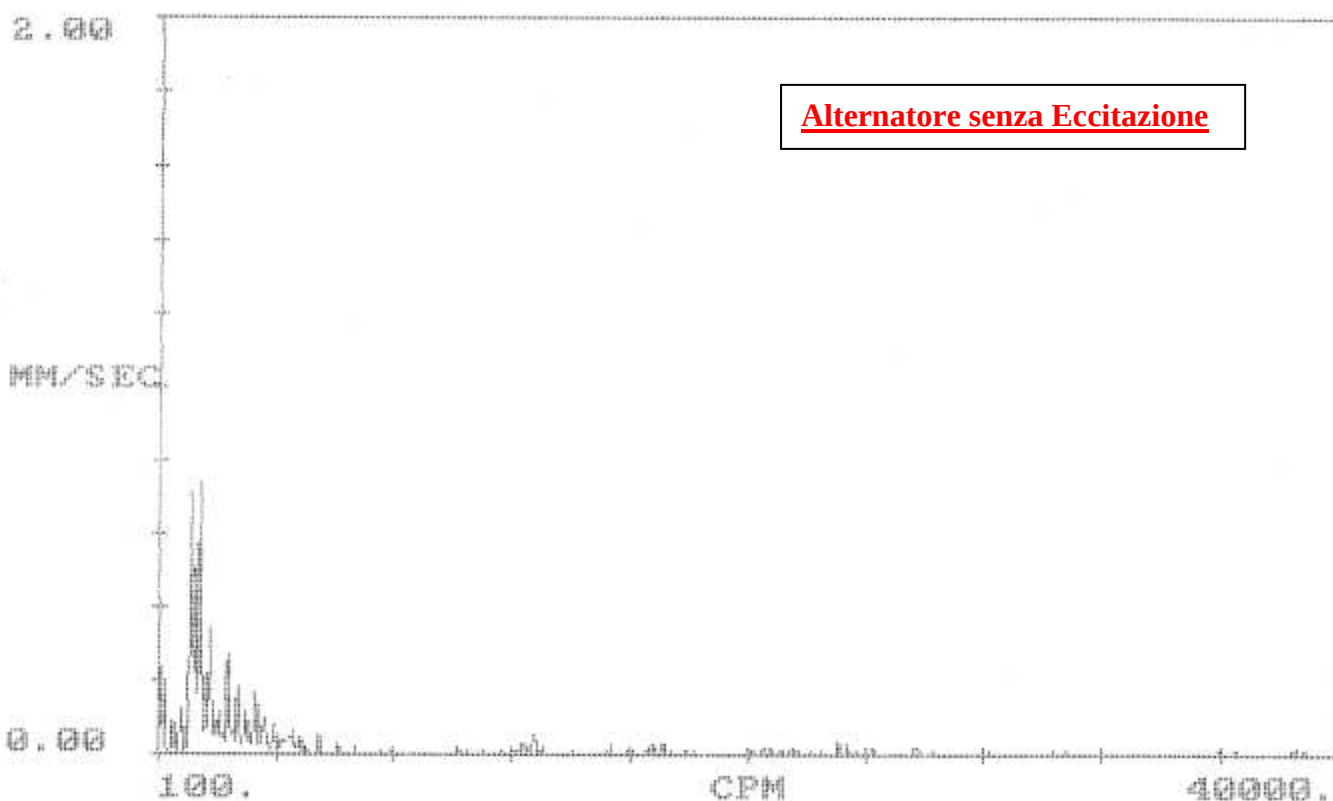

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
100.0	0.8653	1545.	0.7477	2300.	.05876	3714.	0.1049
312.9	0.2489	1700.	.08431	2478.	0.3119	4034.	.08468
620.4	0.1063	1861.	0.3510	2790.	0.1902	4636.	.07202
928.7	0.1399	2000.	.09538	3107.	0.1227	5573.	.06026
1238.	0.7406	2168.	0.1242	3407.	0.1689	12870.	.06652

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]


SPETTRO #2.26 MM/SEC RMS DIGIT

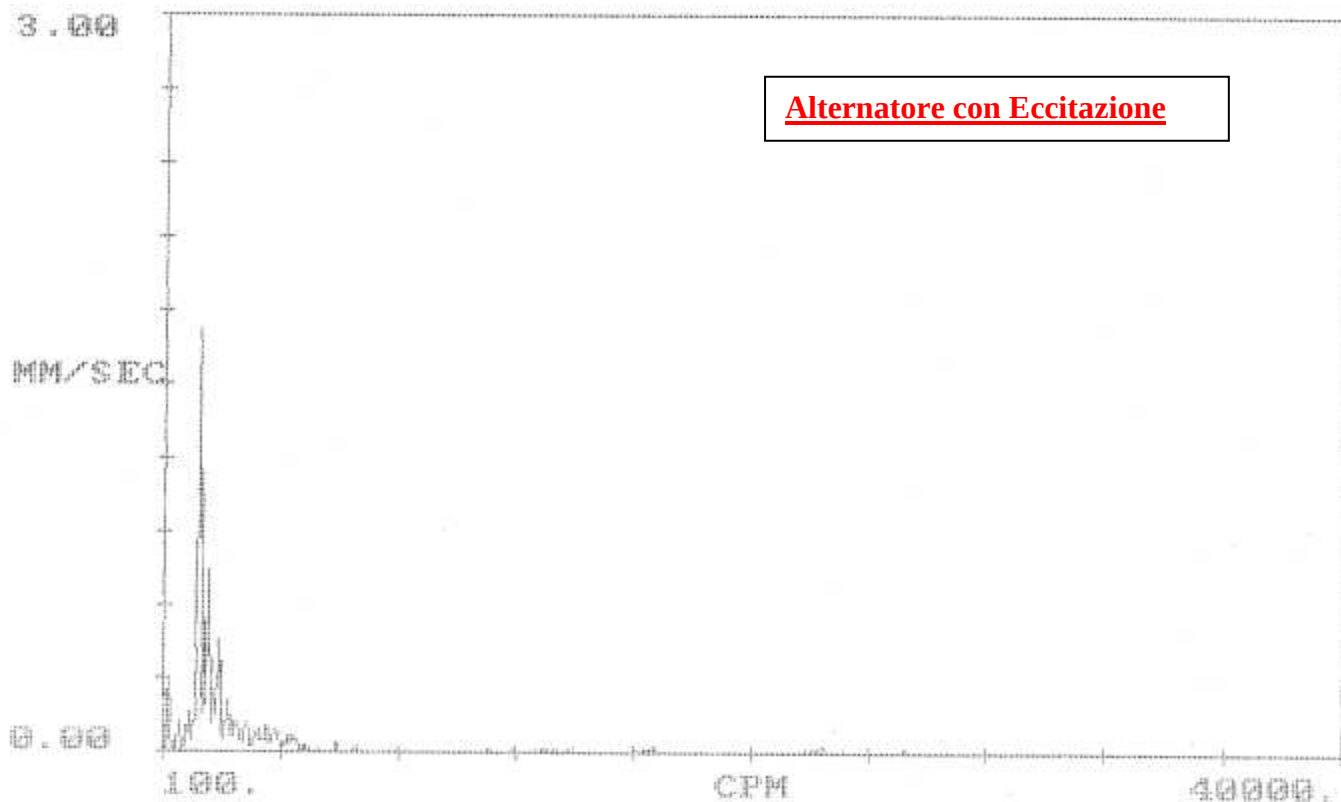

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
334.7	0.3149	1800.	0.1686	3250.	.08261	4361.	.07465
669.2	0.1282	1990.	0.4757	3339.	0.1064	4525.	.08226
1003.	0.1674	2335.	0.2220	3523.	.07331	6025.	.05746
1335.	1.840	2626.	0.1496	3679.	0.1308	16827.	.03741
1669.	0.8249	2977.	0.1496	3928.	0.1167	22479.	.03520

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.72 MM/SEC RMS DIGIT

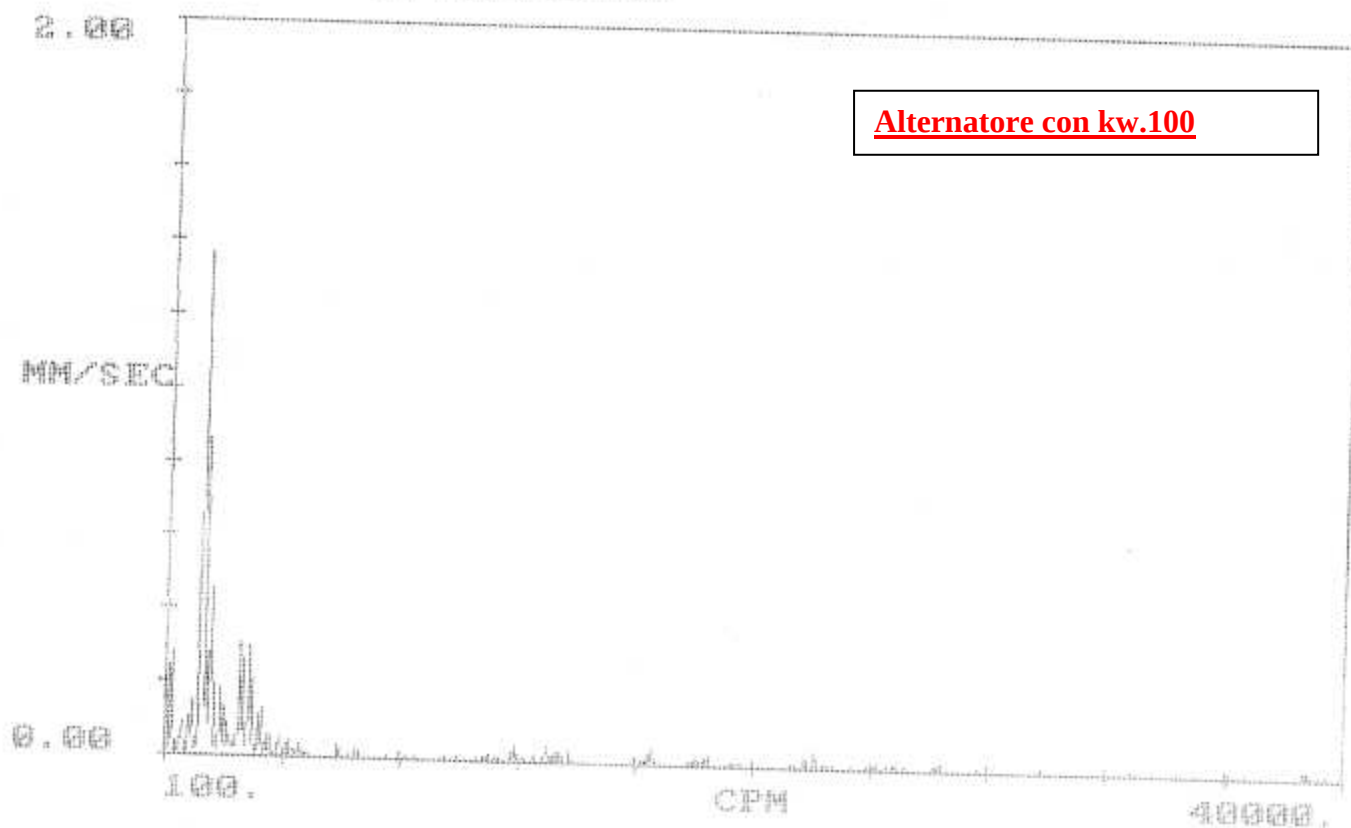

DATI DI FREQ.

333.2	0.3077
667.8	.09740
1000.	0.1564
1332.	1.495
1500.	0.1645

DATI DI FREQ.

1665.	0.4861
1997.	0.1893
2179.	0.1060
2333.	.05800
2662.	0.3220

DATI DI FREQ.

2800.	.00091
2997.	0.2976
3329.	0.1467
3662.	.07067
3995.	.05845


DATI DI FREQ.

4327.	.05209
11997.	.04806
13069.	.04807
16643.	.04791
22185.	.05381

PUNTO #175 CEN EHR -1
[GENER 700KVA]

SPETTRO =1.72 MM/SEC RMS DIGIT

2.00

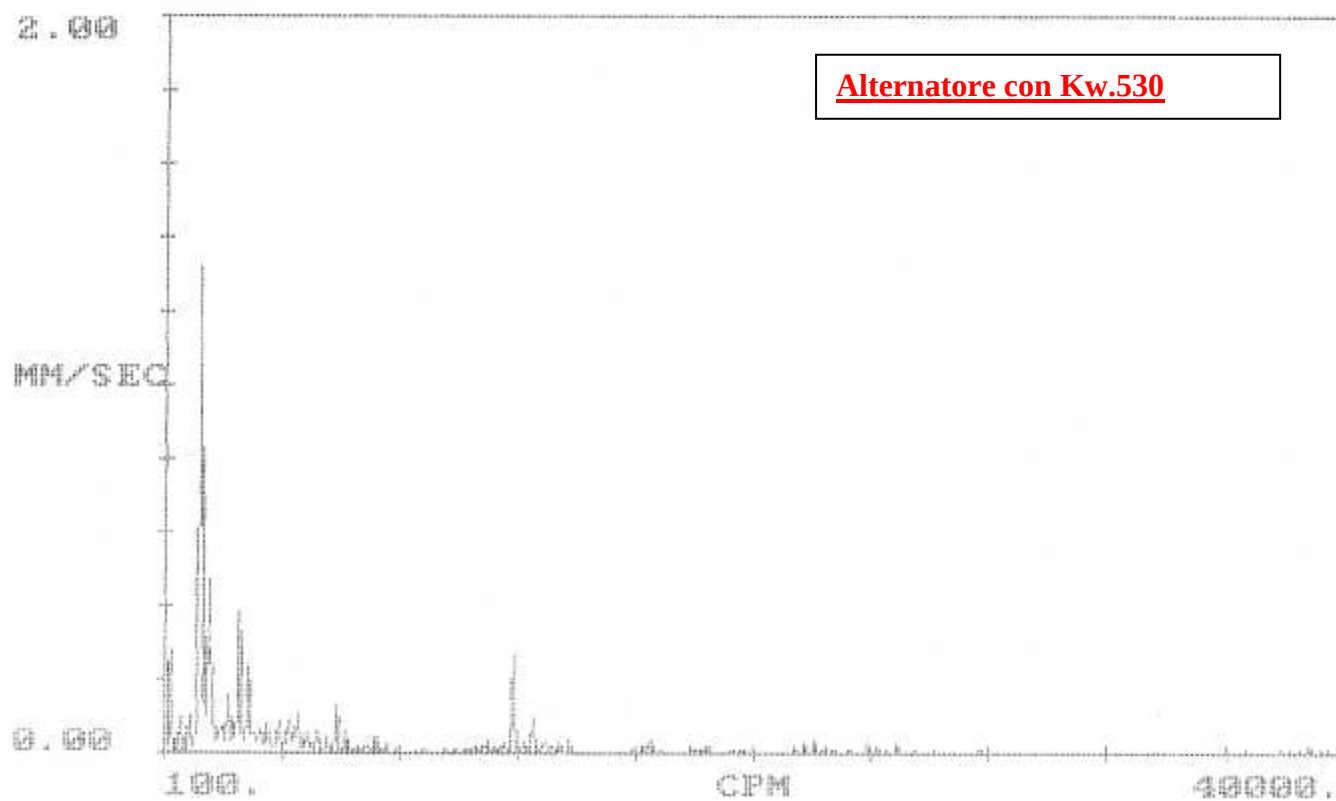

DATI DI FREQ.

333.0	0.3064
666.6	0.1106
996.1	0.1073
1333.	1.426
1667.	0.5107

DATI DI FREQ.

2072.	.00074
2200.	.06907
2332.	0.1760
2665.	0.4079
3009.	0.2452

DATI DI FREQ.

3378.	.07877
3656.	.07960
4004.	.09172
4340.	.08974
4666.	0.1171


DATI DI FREQ.

5331.	.06854
6000.	0.1369
6331.	.07433
11998.	0.2741
12663.	0.1035

Kw 530

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.64 MM/SEC RMS DIGIT

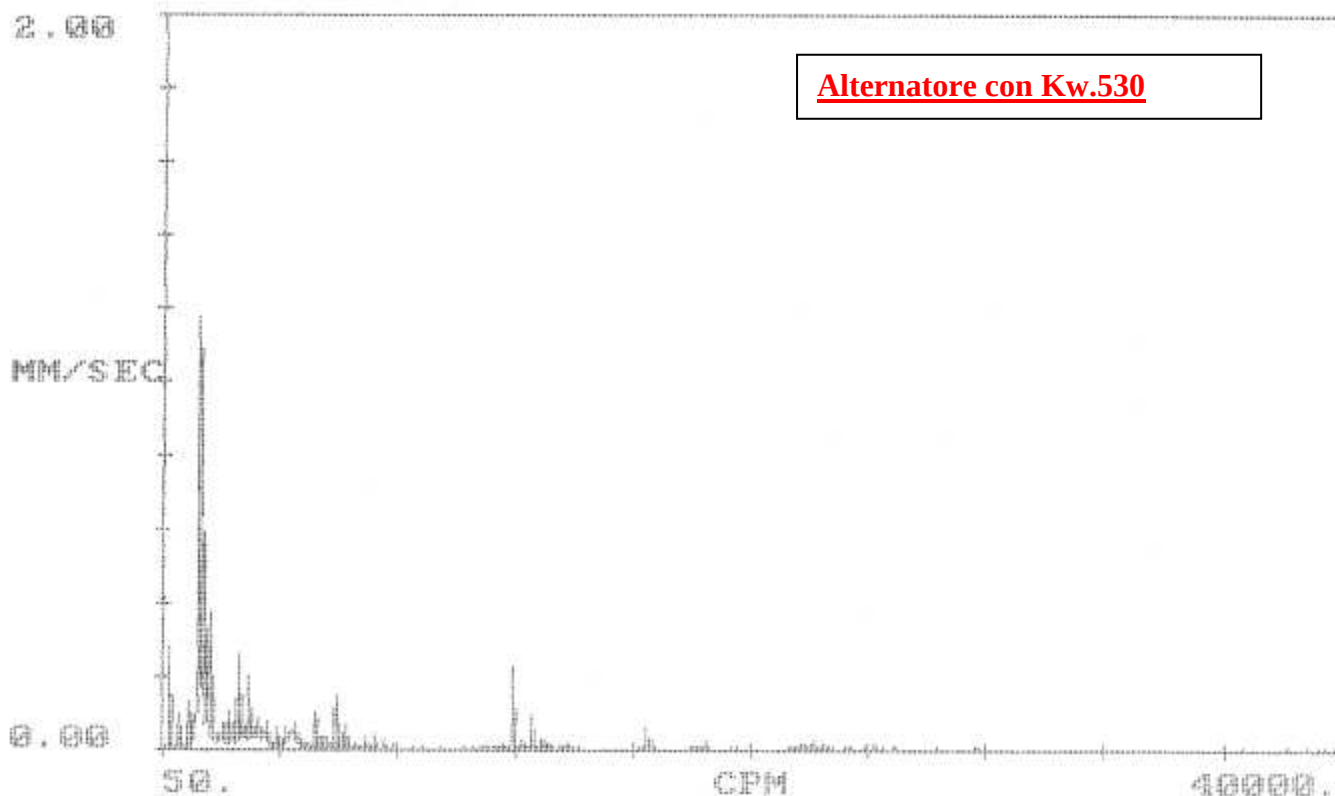


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
332.9	0.3036	1464.	0.2141	2665.	0.2982	5330.	0.1107
665.7	0.1141	1567.	0.1394	3003.	0.2079	5996.	0.1581
997.0	0.1332	1667.	0.4088	3334.	.09567	6329.	.07877
1250.	0.1214	2190.	.07871	3664.	.09833	11991.	0.2524
1335.	1.296	2332.	0.1158	4664.	.08115	12658.	0.1056

Kw530

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.37 MM/SEC RMS DIGIT

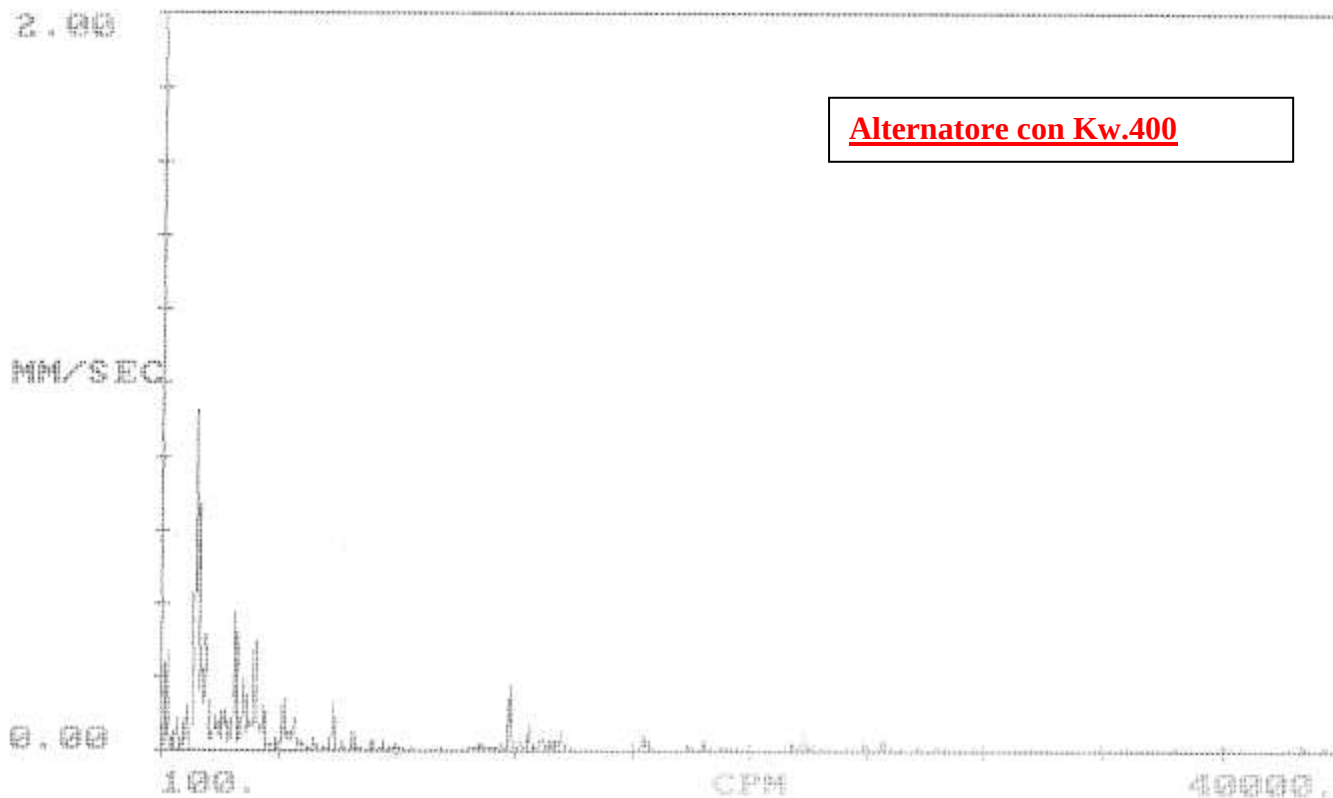

DATI DI FREQ.

333.1	0.2919
665.6	0.1005
996.7	0.1249
1335.	0.9889
1661.	0.3257

DATI DI FREQ.

1990.	0.1022
2142.	0.1070
2336.	0.1236
2662.	0.3961
2989.	0.2056

DATI DI FREQ.

3150.	.08956
3331.	0.3304
3500.	.07324
3664.	0.1296
4330.	0.1636

DATI DI FREQ.


4665.	.05303
5994.	0.1351
11992.	0.1826
12659.	.07193
21927.	.06639

Kw. 400

PUNTO #175 CEN EHR -1
[GENER 700KVA *]

SPETTRO =1.62 MM/SEC RMS DIGIT

2.00

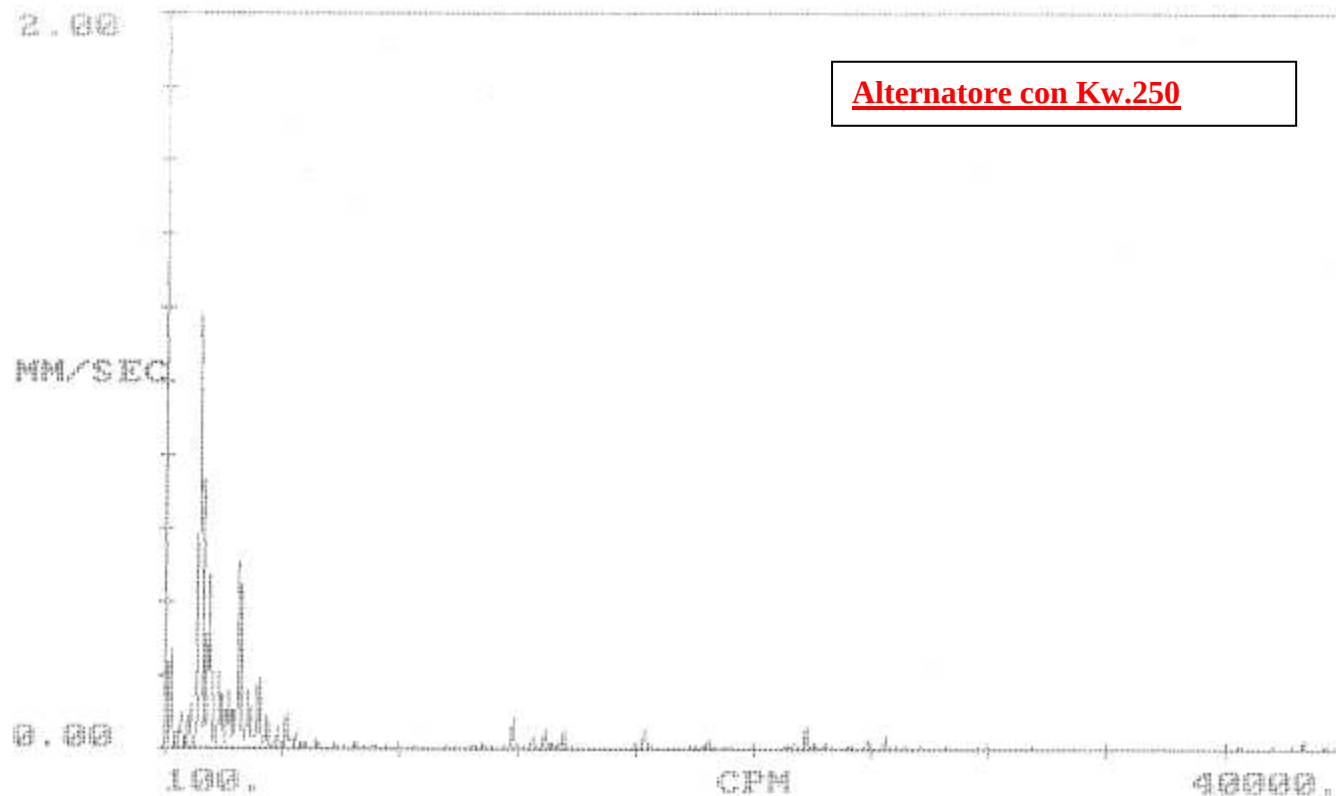

DATI DI FREQ.

333.4	0.2967
665.9	0.1023
998.5	0.1289
1331.	1.299
1666.	0.5112

DATI DI FREQ.

1998.	0.2160
2155.	0.1050
2335.	0.1753
2665.	0.5355
2992.	0.1631

DATI DI FREQ.

3329.	0.2209
3664.	.09388
3998.	.06274
4331.	0.1114
4661.	.04557

DATI DI FREQ.

11995.	.09447
13060.	.05609
13679.	.06029
16407.	.05299
21884.	.07173


Kw250

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-GIV-83 07:58:20
LETTURA GIRI : 333.
CARICO : 100.
VAL-TOT.=1.65 MM/SEC RMS DIGIT
SPETTRO =1.64 MM/SEC RMS DIGIT

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]


SPETTRO =1.64 MM/SEC RMS DIGIT

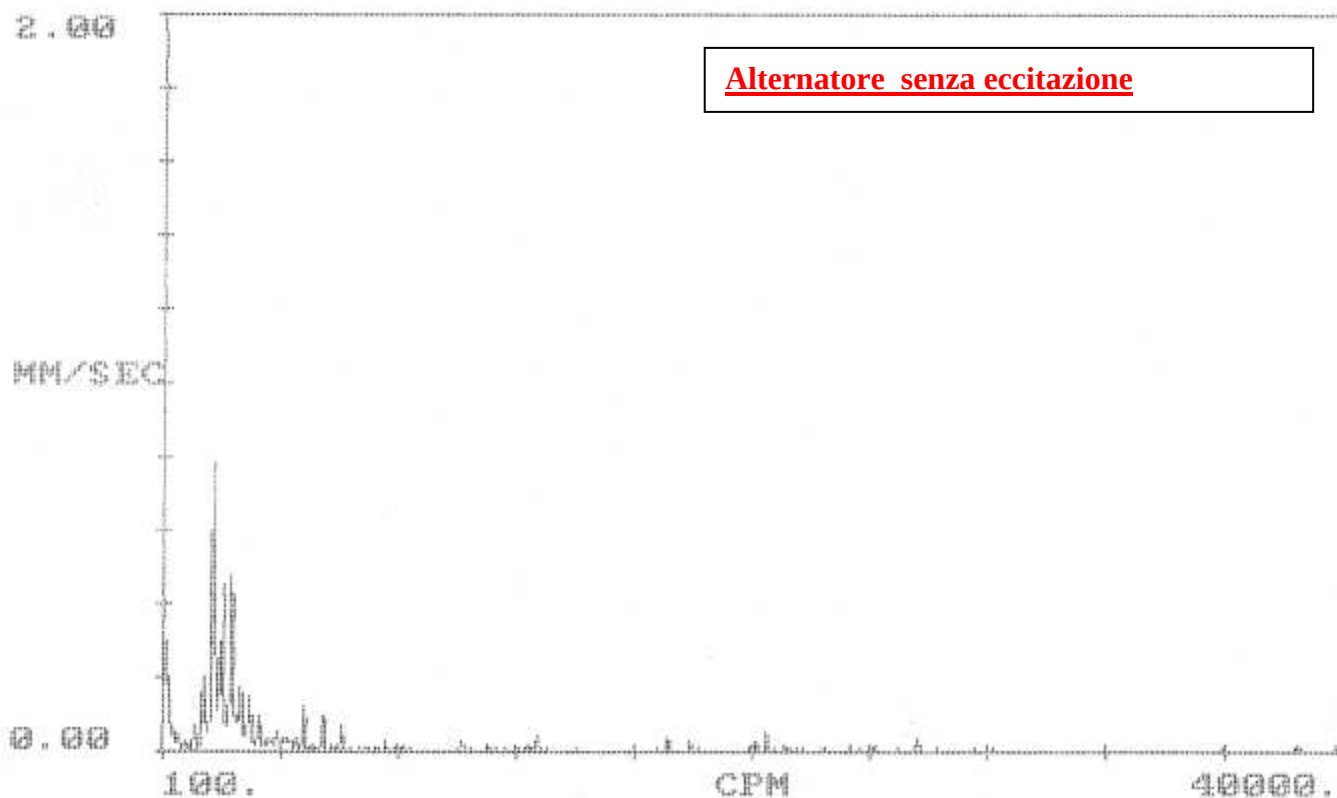

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
114.6	1.030	1847.	0.7935	3085.	0.1623	4948.	0.1269
300.0	0.2303	2000.	0.2456	3407.	.09907	5567.	0.1061
621.0	.05872	2165.	0.4872	3685.	.04361	6184.	.08215
1234.	.08327	2466.	0.5188	3987.	.05871	12849.	.05188
1543.	0.2082	2768.	0.1928	4325.	.04747	20562.	.06146

PUNTO #176 CEN EHR -2
[GENER 700KVA , 1]

RMS DIGITRO =1.51 MM/SEC R

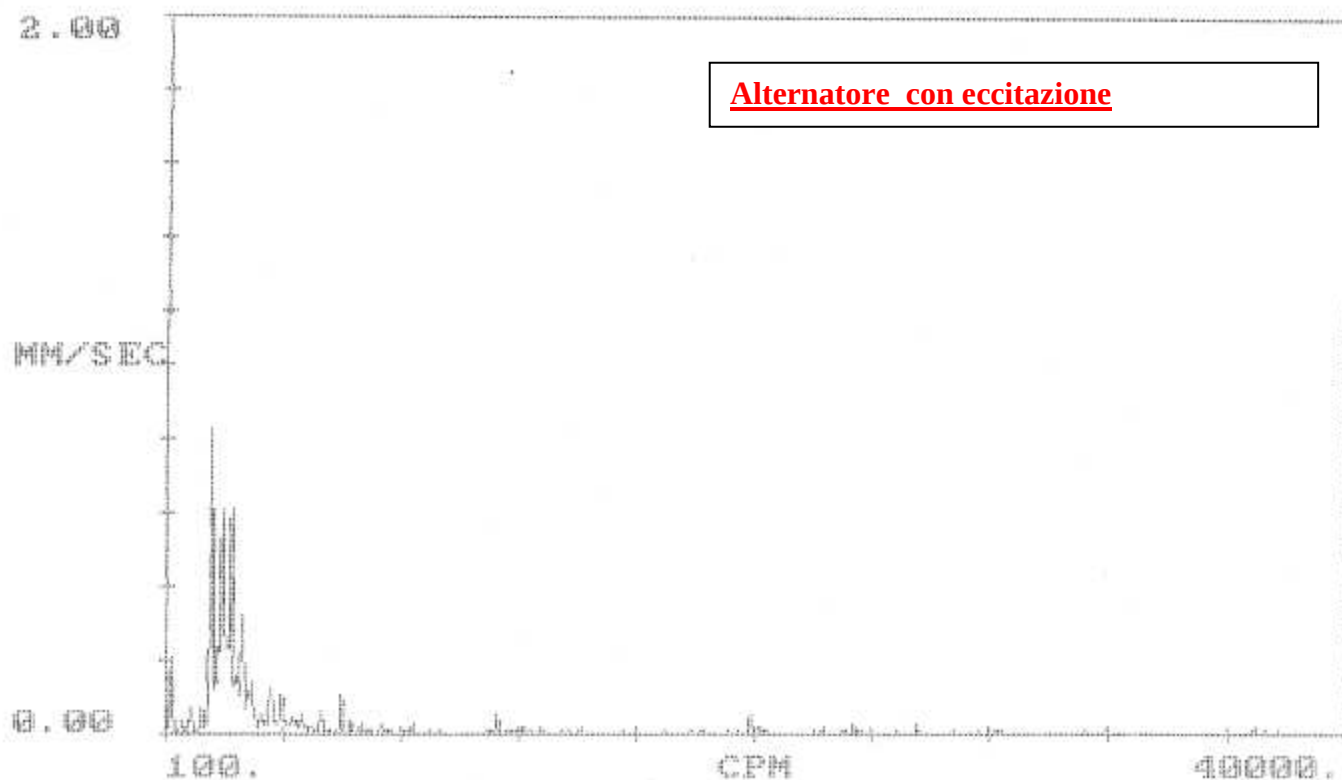


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
338.8	0.2238	2035.	0.6518	3037.	0.1523	4761.	.05926
1019.	.07745	2200.	0.2690	3379.	.06202	5430.	.06997
1362.	.07677	2378.	0.7040	3728.	0.1433	6109.	0.1105
1700.	0.8333	2531.	0.1810	4073.	0.1218	11390.	.05979
1900.	0.2362	2721.	0.3630	4477.	.05852	19933.	.05862

PUNTO #176 CEN EHR -2
[GENER 700KVA , 3]

SPETTRO =1.52 MM/SEC RMS DIGIT


2.00

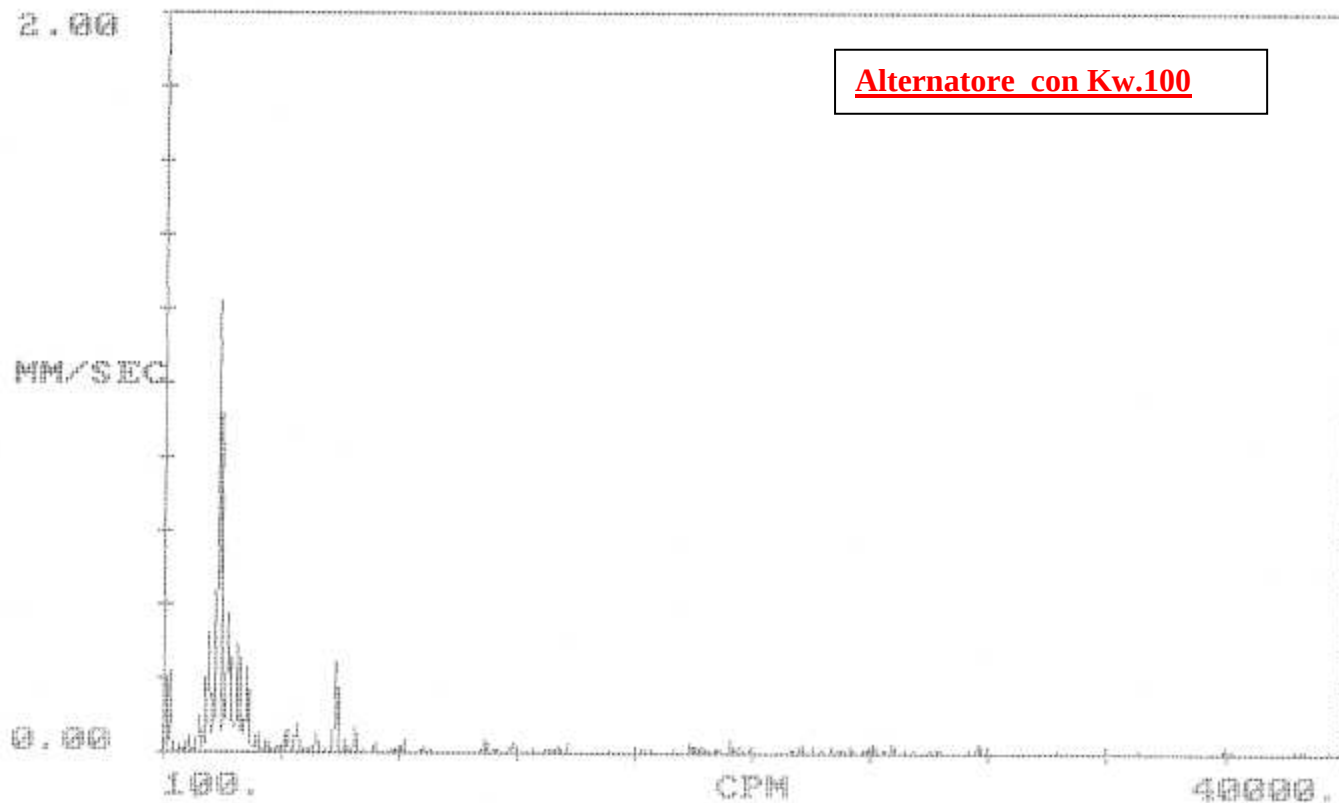

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
332.7	0.2363	2200.	0.1874	3326.	.06056	5997.	0.2505
991.7	.04527	2333.	0.4098	3667.	.03980	6330.	.03860
1332.	0.1129	2666.	0.3108	4329.	.07422	6663.	.07280
1668.	0.3547	2850.	.09009	4665.	.09080	11071.	.04229
1996.	1.225	2999.	0.2309	5329.	.06355	19370.	.04550

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

SPETTRO =2.59 MM/SEC RMS DIGIT

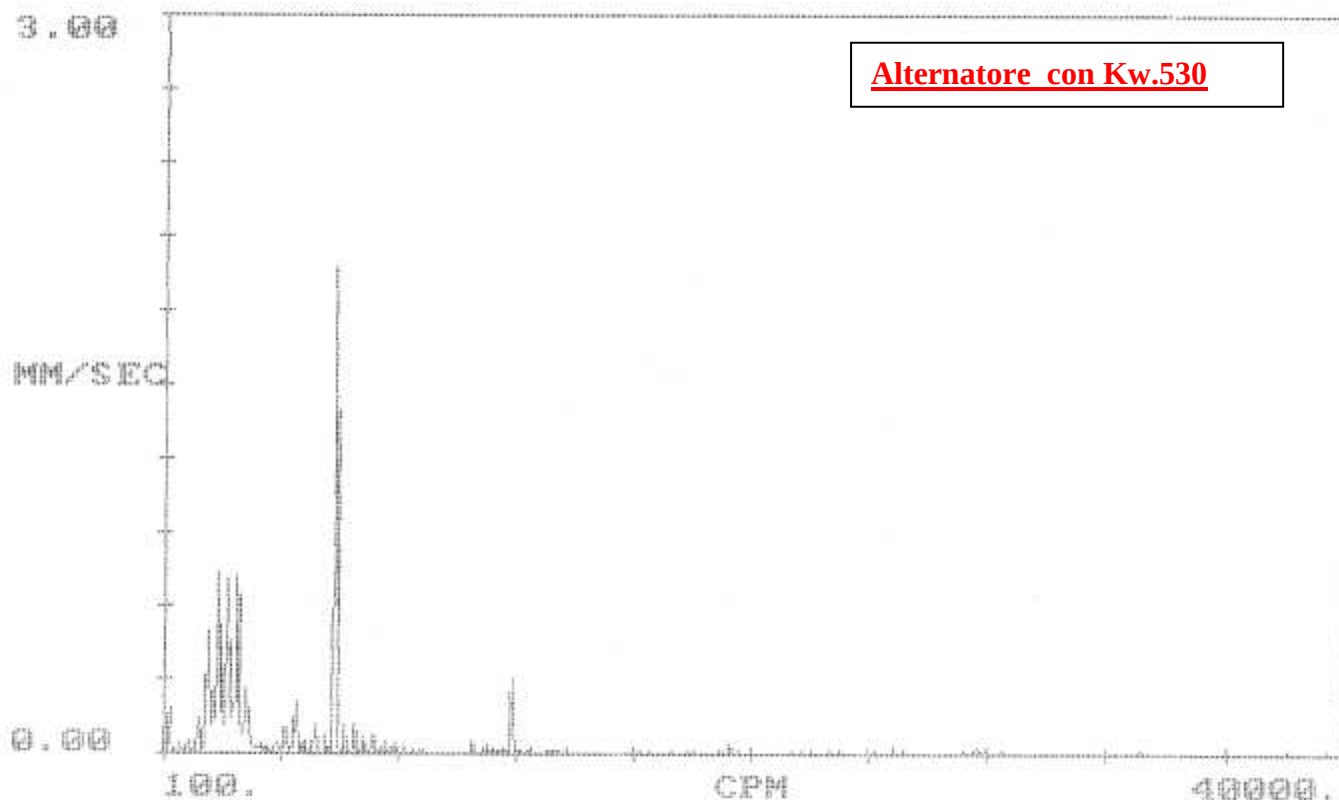

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.0	0.2083	2331.	0.7822	4323.	0.1339	6327.	0.1426
1332.	0.1682	2500.	0.1911	4662.	0.2202	6664.	0.1275
1665.	0.5280	2666.	0.7699	5328.	0.1439	6991.	.06773
1850.	0.1794	2850.	0.1248	5663.	.09051	7323.	.09084
1999.	0.7339	2987.	0.2775	5994.	1.998	11989.	0.3216

Kw530