


PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

SPETTRO =2.42 MM/SEC RMS DIGIT

2.00

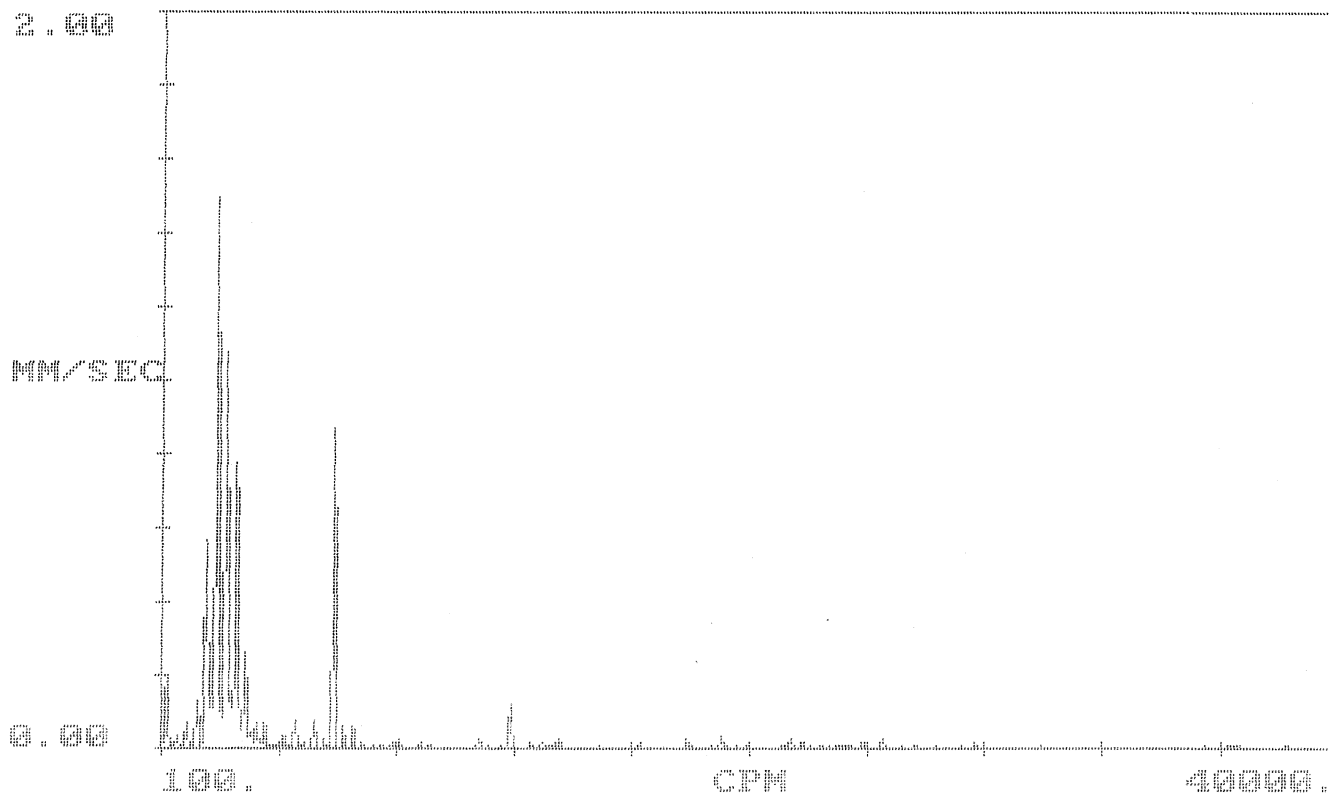

DATI DI FREQ.

333.4	0.2126
1000.	.07015
1334.	0.1479
1668.	0.6153
1850.	0.1476

DATI DI FREQ.

1999.	1.502
2150.	0.1890
2334.	1.161
2500.	0.1580
2668.	0.8442

DATI DI FREQ.

3001.	0.2689
3335.	.08068
3666.	.07854
4323.	.04591
4665.	.08776

DATI DI FREQ.

5333.	.09044
6000.	0.8743
6334.	.06577
6666.	.06943
12001.	0.1271


KW250

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-GIV-83 08:30:12
SPETTRO =2.46 MM/SEC RMS DIGIT

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]


SPETTRO =2.46 MM/SEC RMS DIGIT

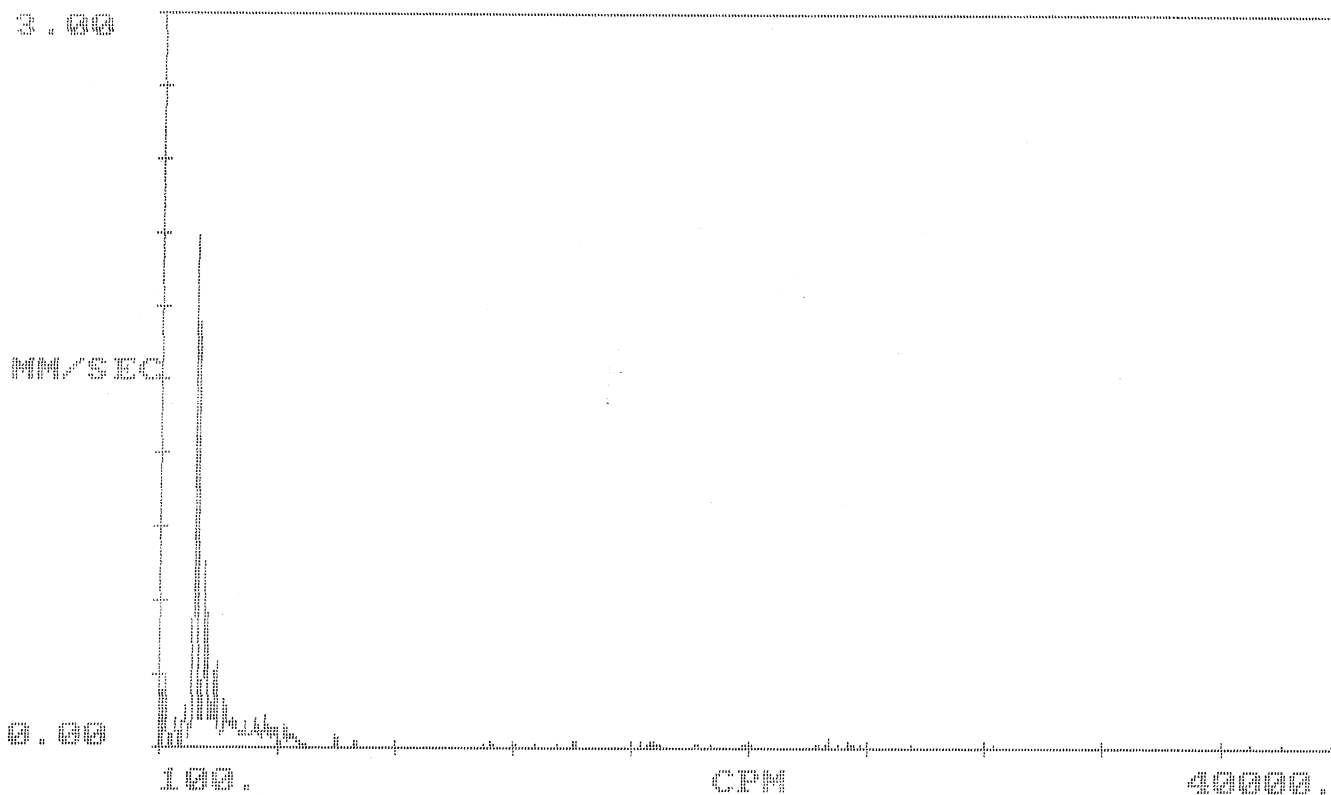

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
339.9	0.3140	1694.	0.7754	2584.	0.1349	3600.	.07335
678.4	0.1342	1900.	0.1922	2700.	0.1105	3736.	0.1387
1018.	0.1955	2032.	0.3882	3045.	0.1070	3950.	.08161
1360.	2.151	2369.	0.2149	3250.	.07541	4074.	.09744
1550.	0.1488	2500.	0.1126	3390.	0.1284	4420.	0.1029

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]


SPETTRO =0.675 MM/SEC RMS DIGIT

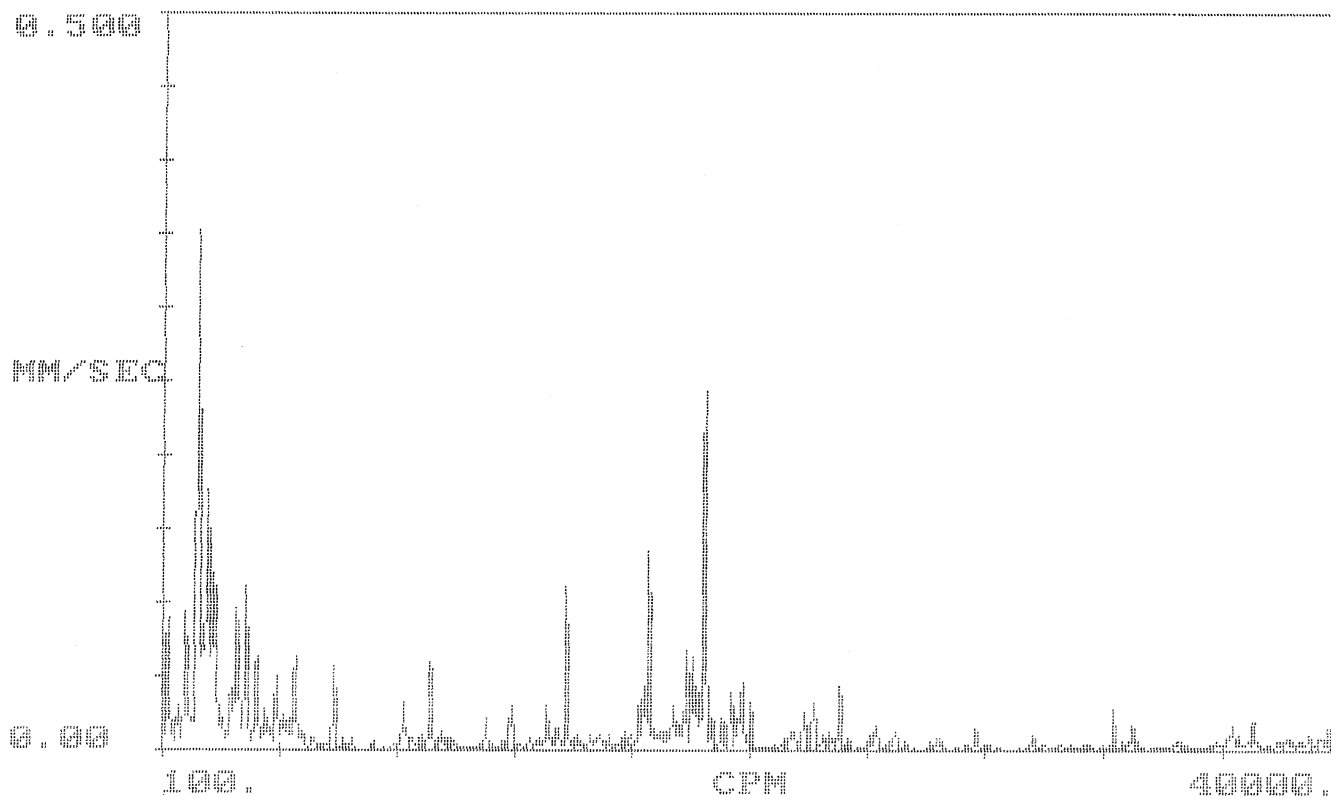

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
334.0	.09675	1919.	0.1338	4636.	.06757	18004.	.06780
958.5	.09655	2669.	0.1055	6001.	.05855	18189.	.06621
1334.	0.3797	3000.	0.1128	9269.	.06608	18535.	0.2619
1500.	0.1044	3328.	.07273	13902.	0.1130	19835.	.04954
1713.	0.1848	4006.	.05194	16694.	0.1380	23165.	.04701

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

SPETTRO =0.970 MM/SEC RMS DIGIT

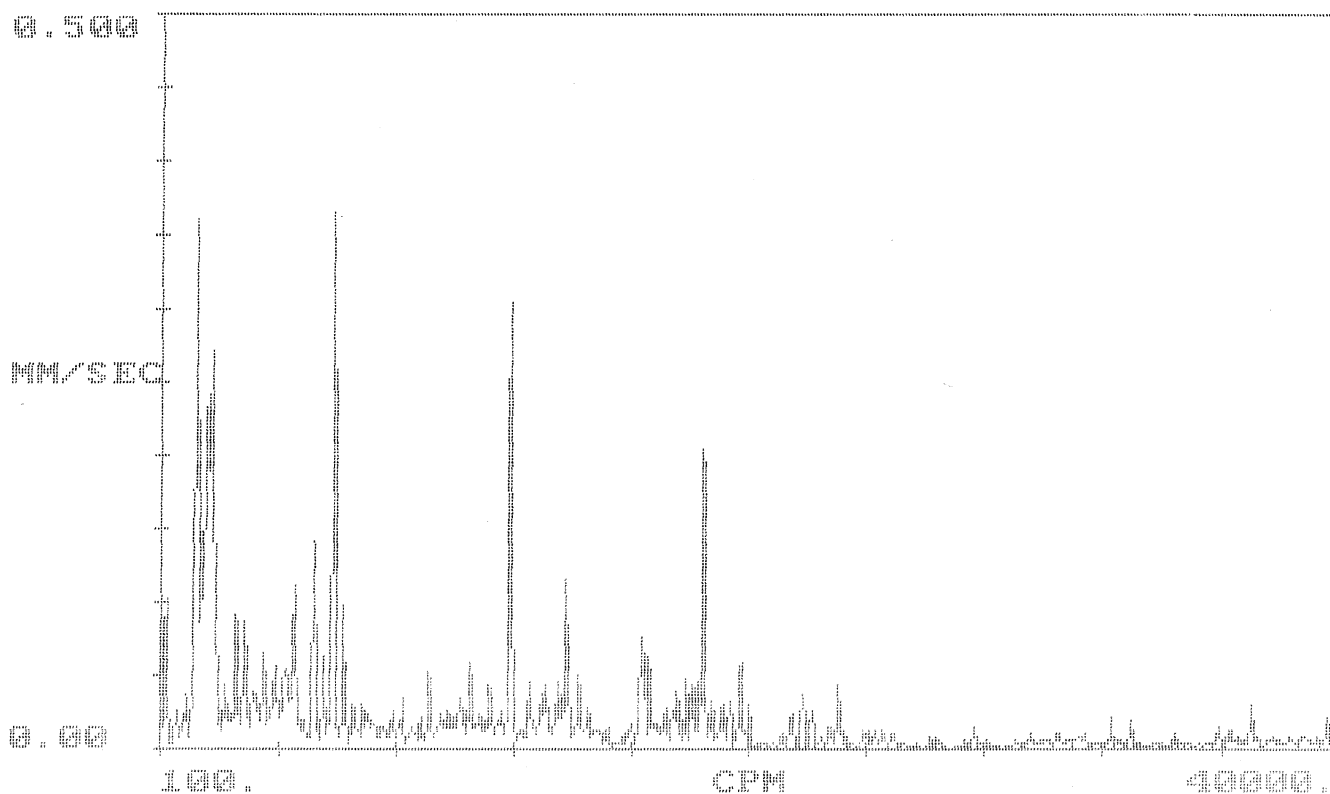


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.2	0.1101	2671.	0.1030	5329.	0.1601	13892.	0.1172
1330.	0.4013	3007.	.08891	5665.	.06877	16430.	.08533
1450.	0.1051	3642.	.06749	5994.	0.3696	16714.	.06823
1717.	0.2524	4375.	.06578	6328.	0.1113	18522.	0.2328
1834.	0.2931	4639.	0.1143	11990.	0.3136	19827.	.06921

100 Kw

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

SPETTRO =2.27 MM/SEC RMS DIGIT

2.00

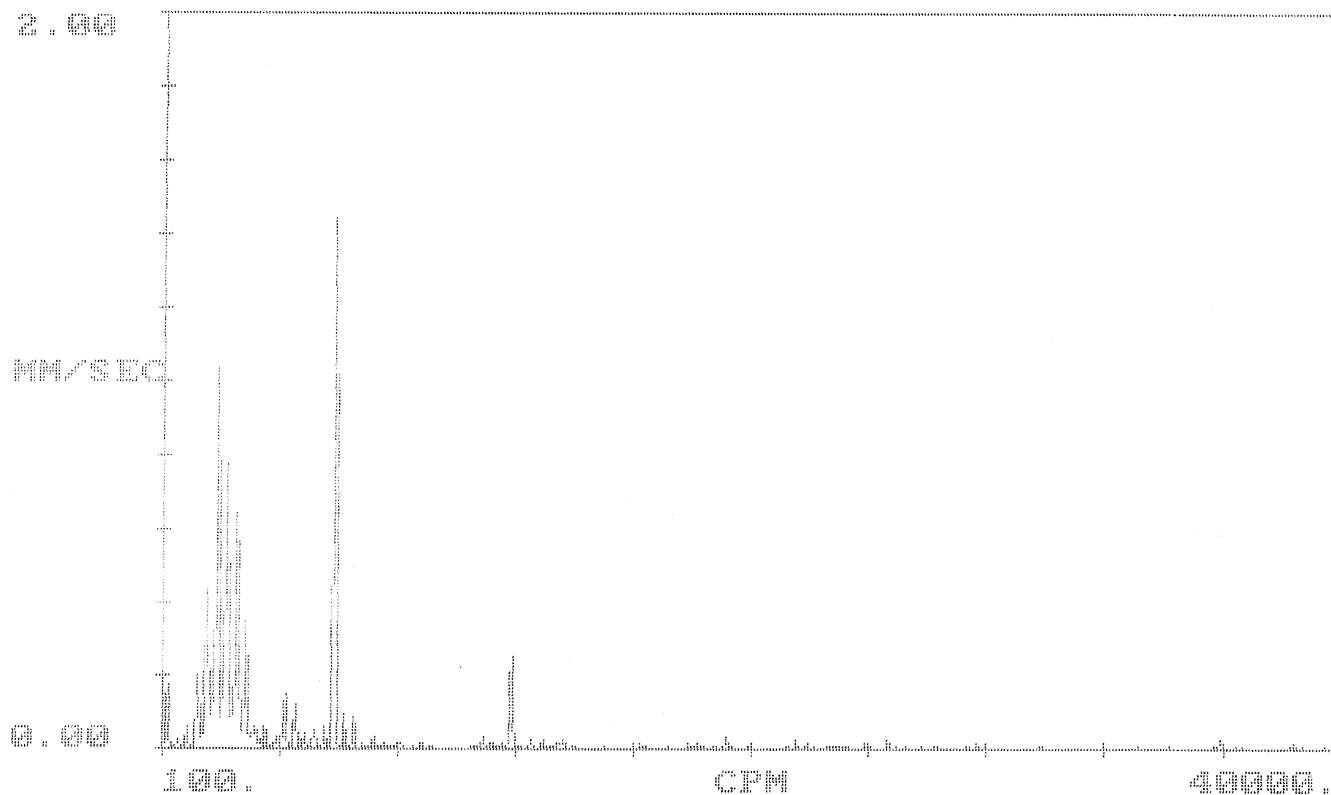

DATI DI FREQ.

332.9	0.1938
998.9	.06416
1333.	0.2184
1666.	0.4680
2001.	1.038

DATI DI FREQ.

2200.	0.2080
2333.	0.8340
2665.	0.6862
3000.	0.3561
3324.	.07138

DATI DI FREQ.

3666.	.07082
4331.	0.1625
4661.	0.1325
4991.	.05245
5328.	.06891

DATI DI FREQ.

5664.	.07104
5994.	1.462
6327.	0.1117
6660.	.09151
11987.	0.2721


Ku 530

PUNTO #177 CEN EHR -4
[GENER 700KVA ,]

STATO SEGNALE : OK
LT. MISURA FATTA IL : 21-GIV-83 08:37:48
ETTURA GIRI : 333.
ARICO : 100.
AL-TOT.=1.43 MM/SEC RMS DIGIT
PETTRO =1.43 MM/SEC RMS DIGIT

PUNTO #178 CEN EHR -4
[GENER 700KVA ,]

PETTRO =1.43 MM/SEC RMS DIGIT

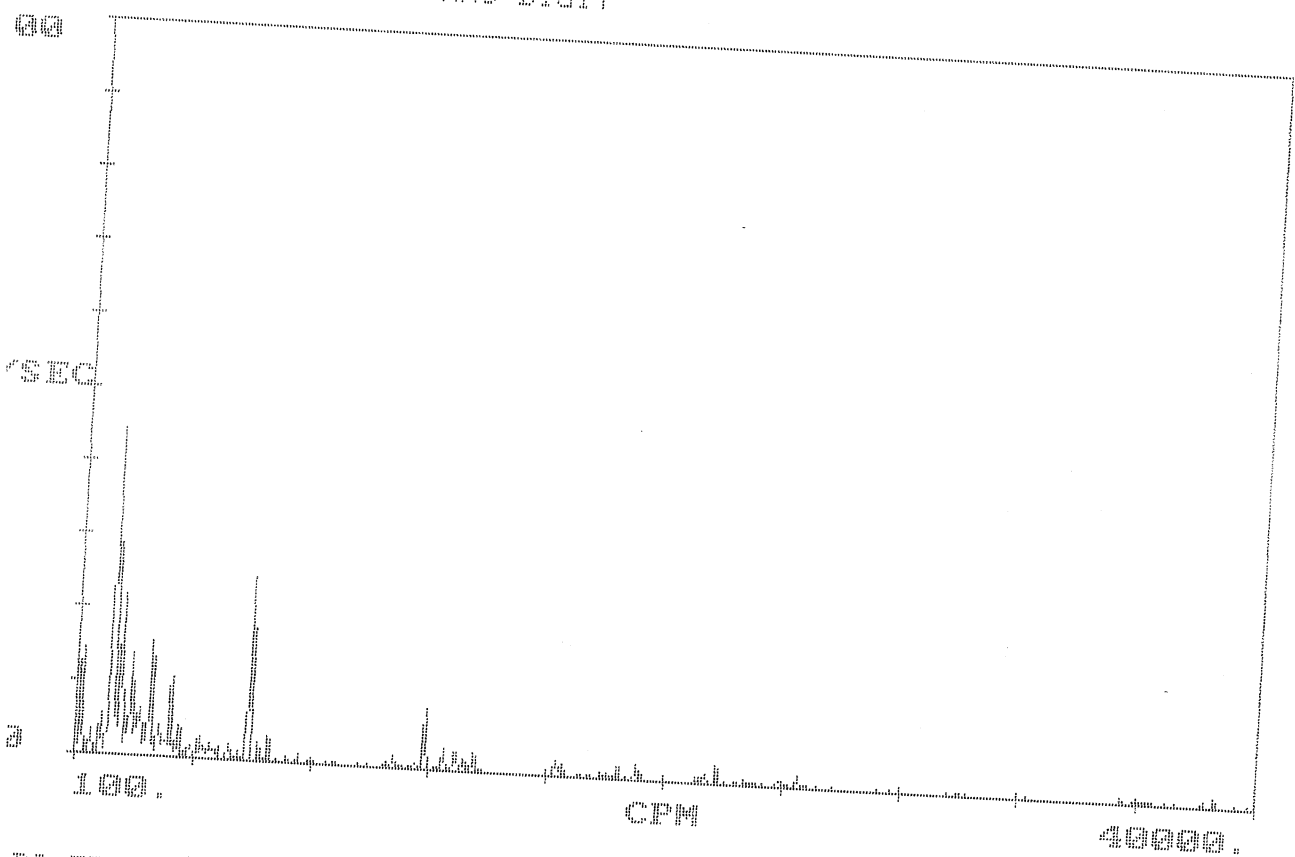


DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
3.4	0.3153	1664.	0.4624	2664.	0.3390	5997.	0.5046
5.7	.00011	1850.	.00821	2981.	.09800	6329.	.06400
7.2	0.1191	1995.	0.2811	3332.	0.2433	6666.	.07580
31.	0.9750	2200.	0.1170	3665.	0.1008	11995.	0.1671
30.	0.1170	2326.	0.1606	4332.	.07429	12659.	.06518

kw400

PUNTO #178 CEN EHR -2
[GENER 700KVA ,]

SPETTRO =1.87 MM/SEC RMS DIGIT

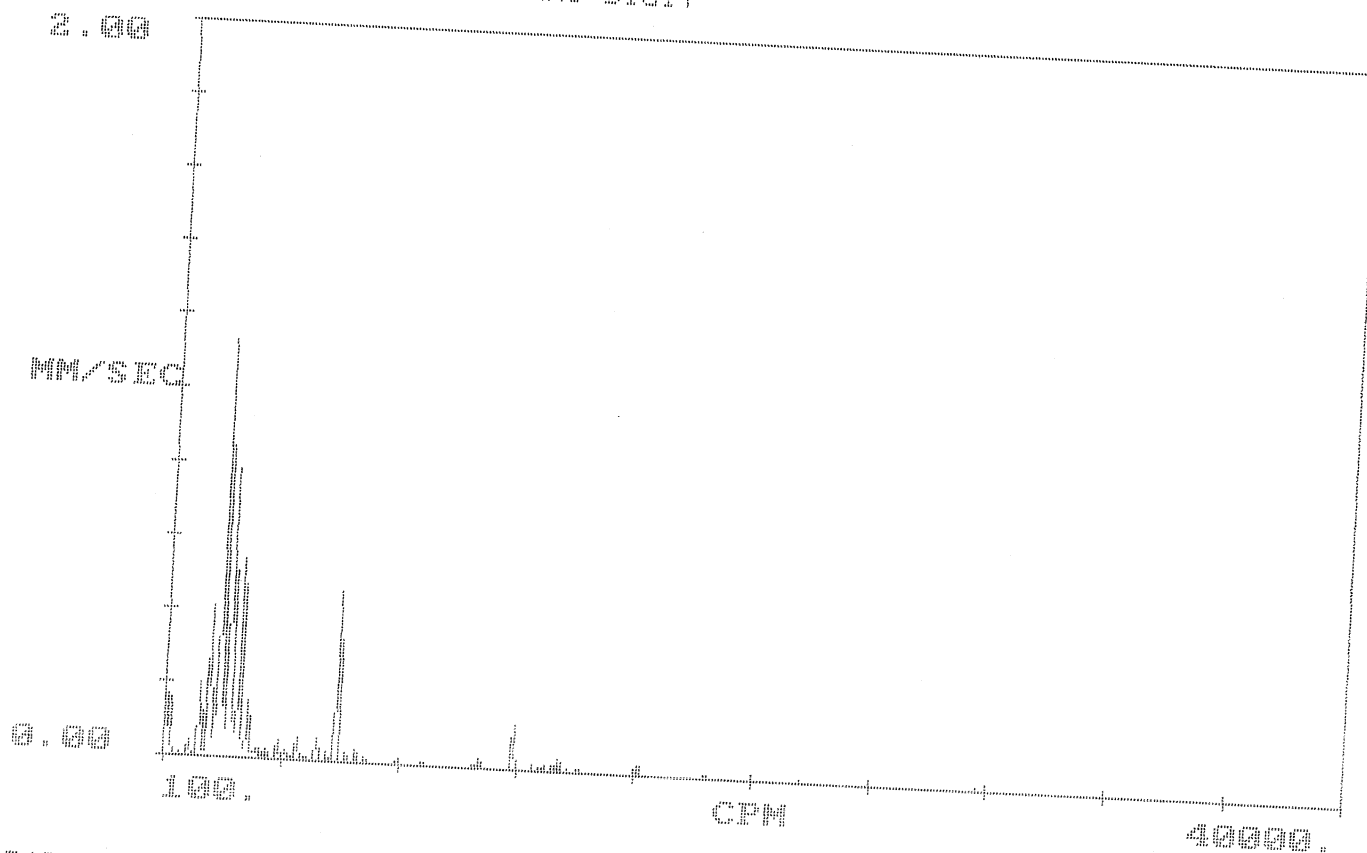

DATI DI FREQ.

300.0	0.1670
1000.	.04955
1334.	0.2198
1666.	0.4377
1850.	0.1448

DATI DI FREQ.

2000.	1.131
2150.	0.1470
2332.	0.8535
2500.	0.1136
2664.	0.5707

DATI DI FREQ.

2850.	.04789
3002.	0.1607
3998.	.05577
4659.	.06830
5329.	.06983


DATI DI FREQ.

5996.	0.4655
6328.	.03781
6662.	.04004
11992.	0.1248
13561.	.04303

45°

PUNTO #178 CEN EHR -4
 [GENER 700KVA ,]

SPETTRO =0.455 MM/SEC RMS DIGIT

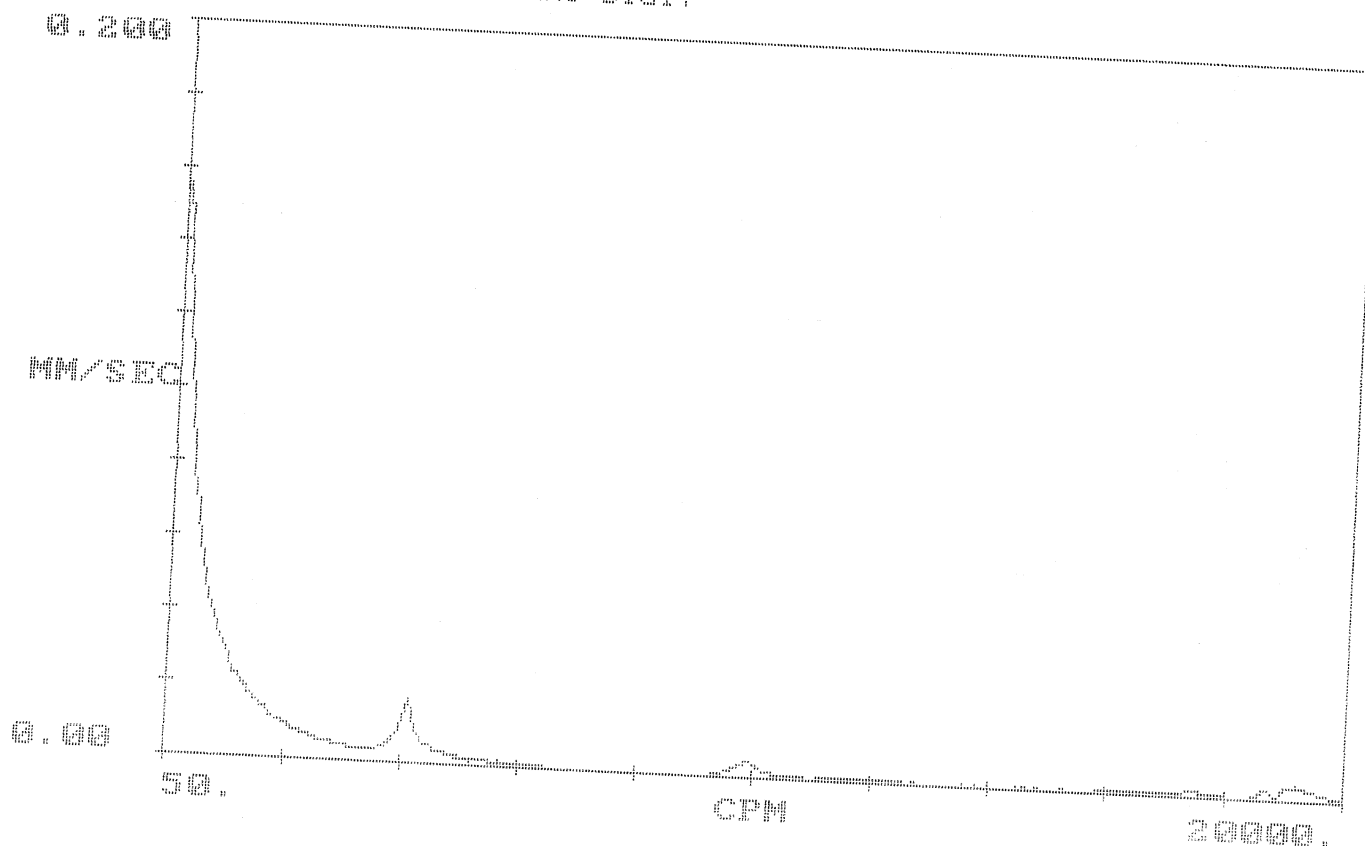

DATI DI FREQ.

111.9	0.1843
1963.	.01280
2288.	.00976
2600.	.00633
2700.	.00570

DATI DI FREQ.

2738.	.00682
2813.	.00649
3038.	.00551
3100.	.00457
3313.	.00486

DATI DI FREQ.

3488.	.00449
3750.	.00496
4163.	.02109
4525.	.00531
4650.	.00422

DATI DI FREQ.

4738.	.00463
9938.	.00578
19100.	.00430
19175.	.00434
19213.	.00513