


PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-GIV-83 07:57:35
LETTURA GIRI : 333.
CARICO : 100.
VAL-TOT.=1.55 MM/SEC RMS DIGIT
SPETTRO =1.55 MM/SEC RMS DIGIT

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]


SPETTRO =1.55 MM/SEC RMS DIGIT

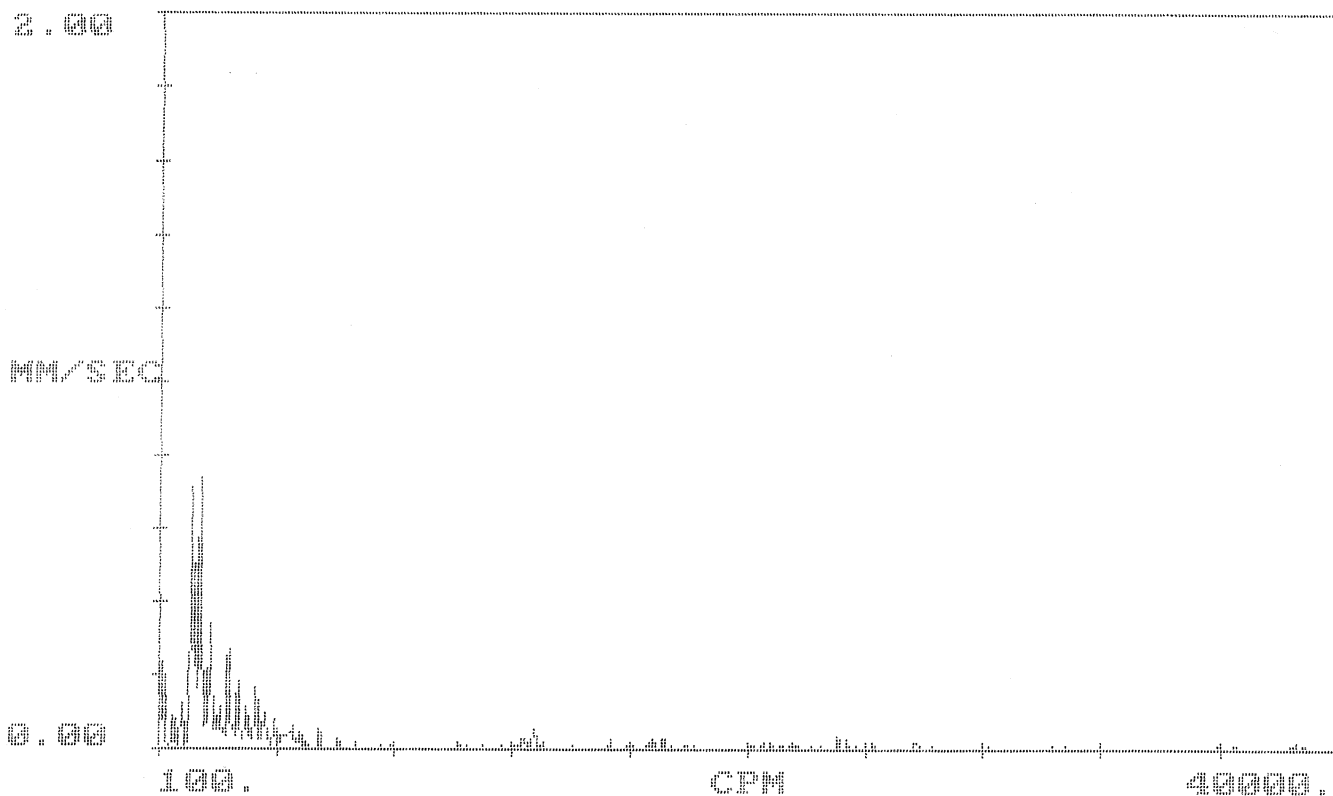

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
100.0	0.8653	1545.	0.7477	2300.	.05876	3714.	0.1049
312.9	0.2489	1700.	.08431	2478.	0.3119	4034.	.08468
620.4	0.1063	1861.	0.3510	2790.	0.1902	4636.	.07202
928.7	0.1399	2000.	.09538	3107.	0.1227	5573.	.06026
1238.	0.7406	2168.	0.1242	3407.	0.1689	12870.	.06652

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]


SPETTRO =2.26 MM/SEC RMS DIGIT

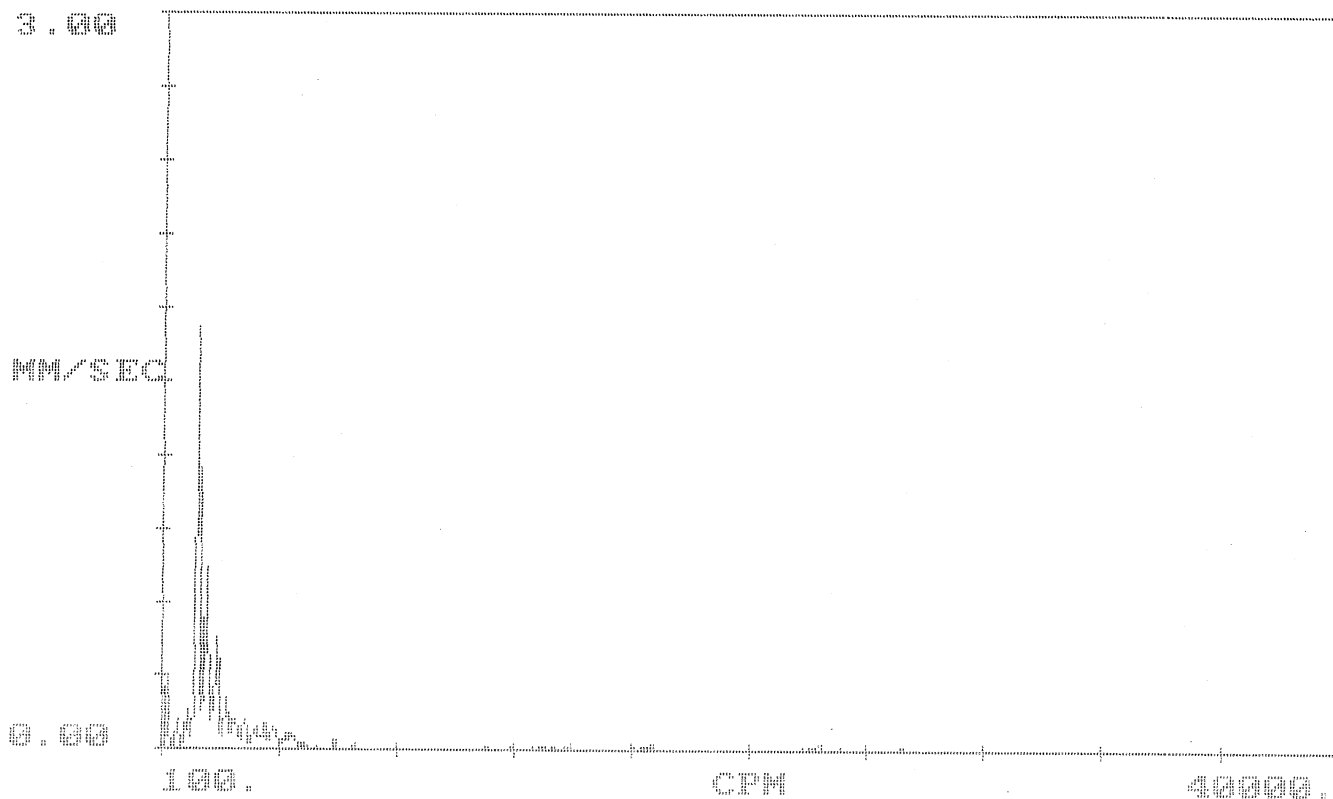

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
334.7	0.3149	1800.	0.1686	3250.	.08261	4361.	.07465
668.2	0.1282	1998.	0.4757	3339.	0.1064	4525.	.08226
1003.	0.1674	2335.	0.2220	3523.	.07331	6025.	.05746
1335.	1.840	2626.	0.1496	3679.	0.1308	16827.	.03741
1669.	0.8249	2977.	0.1496	3928.	0.1167	22479.	.03520

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.72 MM/SEC RMS DIGIT

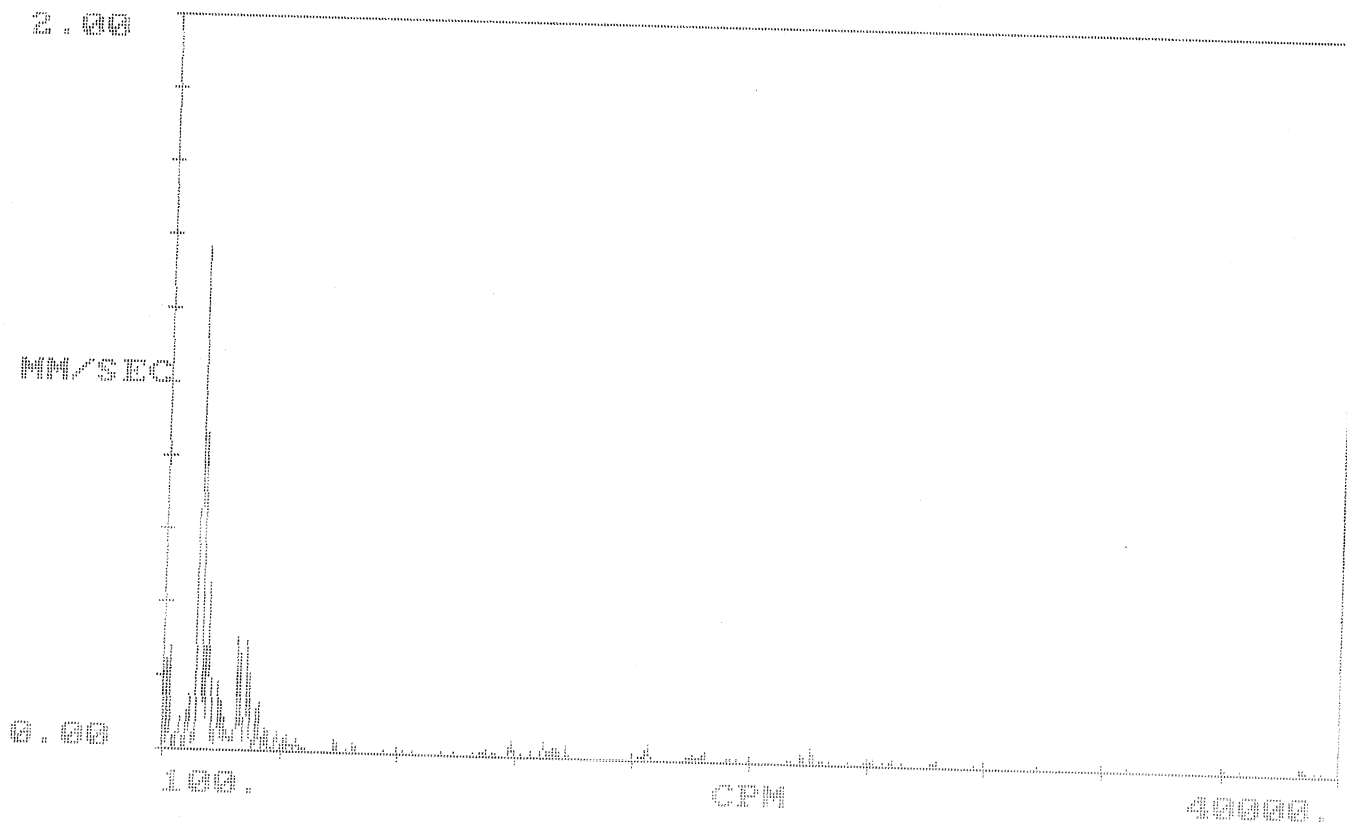


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.2	0.3077	1665.	0.4861	2800.	.00091	4327.	.05209
667.0	.09740	1997.	0.1393	2997.	0.2976	11997.	.04806
1000.	0.1564	2179.	0.1060	3329.	0.1467	13069.	.04807
1332.	1.495	2333.	.05880	3662.	.07067	16643.	.04791
1500.	0.1645	2662.	0.3220	3995.	.05845	22185.	.05381

100kw

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.72 MM/SEC RMS DIGIT

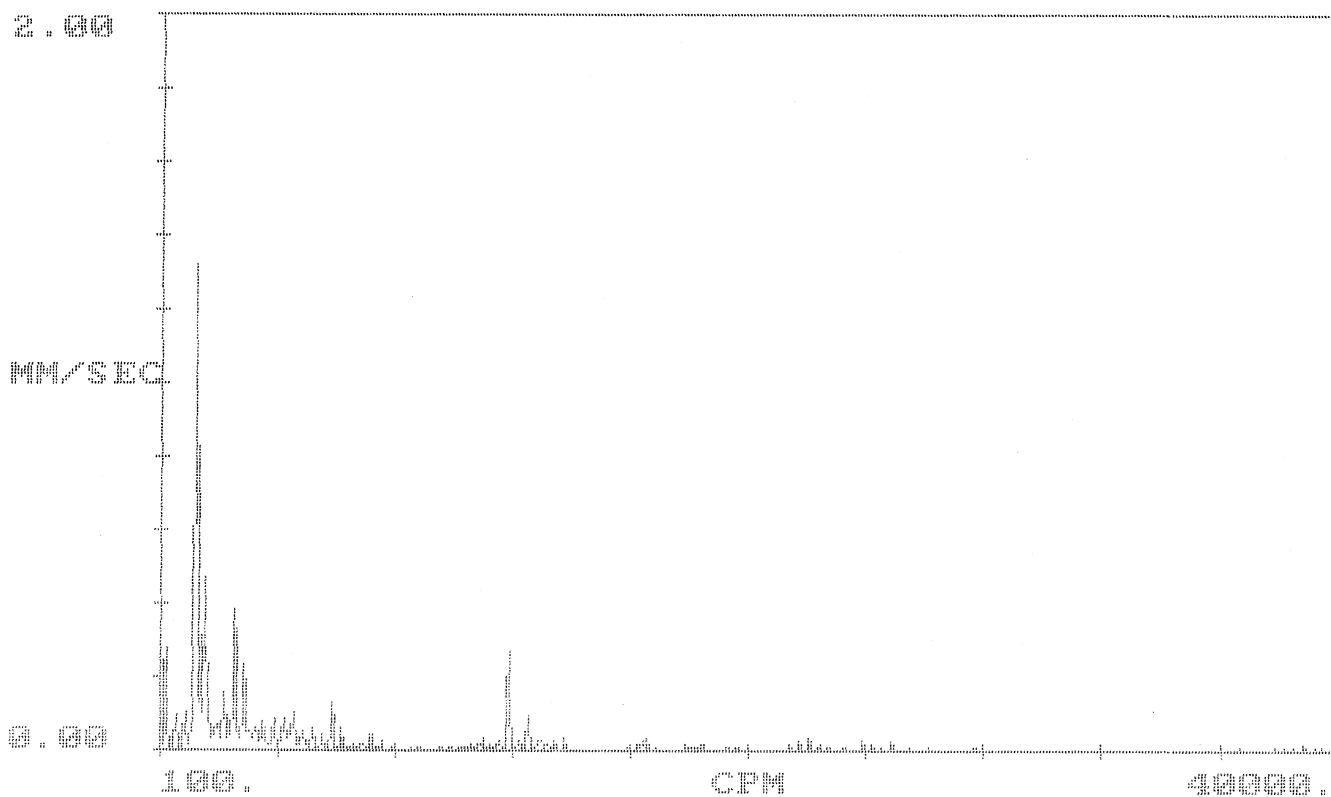


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.0	0.3064	2072.	.08074	3378.	.07877	5331.	.06854
666.6	0.1106	2200.	.06907	3656.	.07960	6000.	0.1369
996.1	0.1073	2332.	0.1760	4004.	.09172	6331.	.07433
1333.	1.426	2665.	0.4079	4340.	.08974	11998.	0.2741
1667.	0.5107	3009.	0.2452	4666.	0.1171	12663.	0.1035

Kw 530

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.64 MM/SEC RMS DIGIT

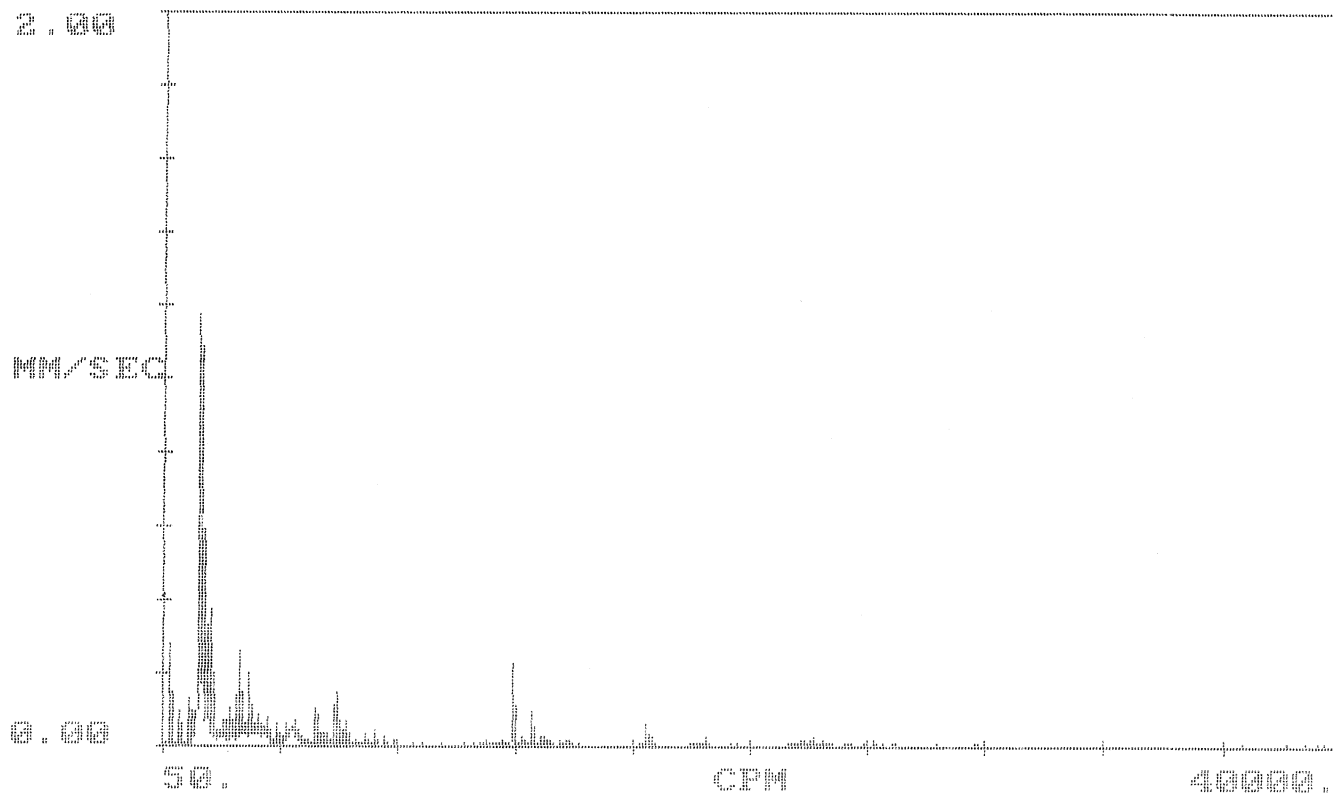


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
332.9	0.3036	1464.	0.2141	2665.	0.2982	5330.	0.1107
665.7	0.1141	1567.	0.1394	3003.	0.2079	5996.	0.1581
997.0	0.1332	1667.	0.4088	3334.	.09567	6329.	.07877
1250.	0.1214	2190.	.07871	3664.	.09833	11991.	0.2524
1335.	1.296	2332.	0.1158	4664.	.08115	12658.	0.1056

Kw530

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.37 MM/SEC RMS DIGIT

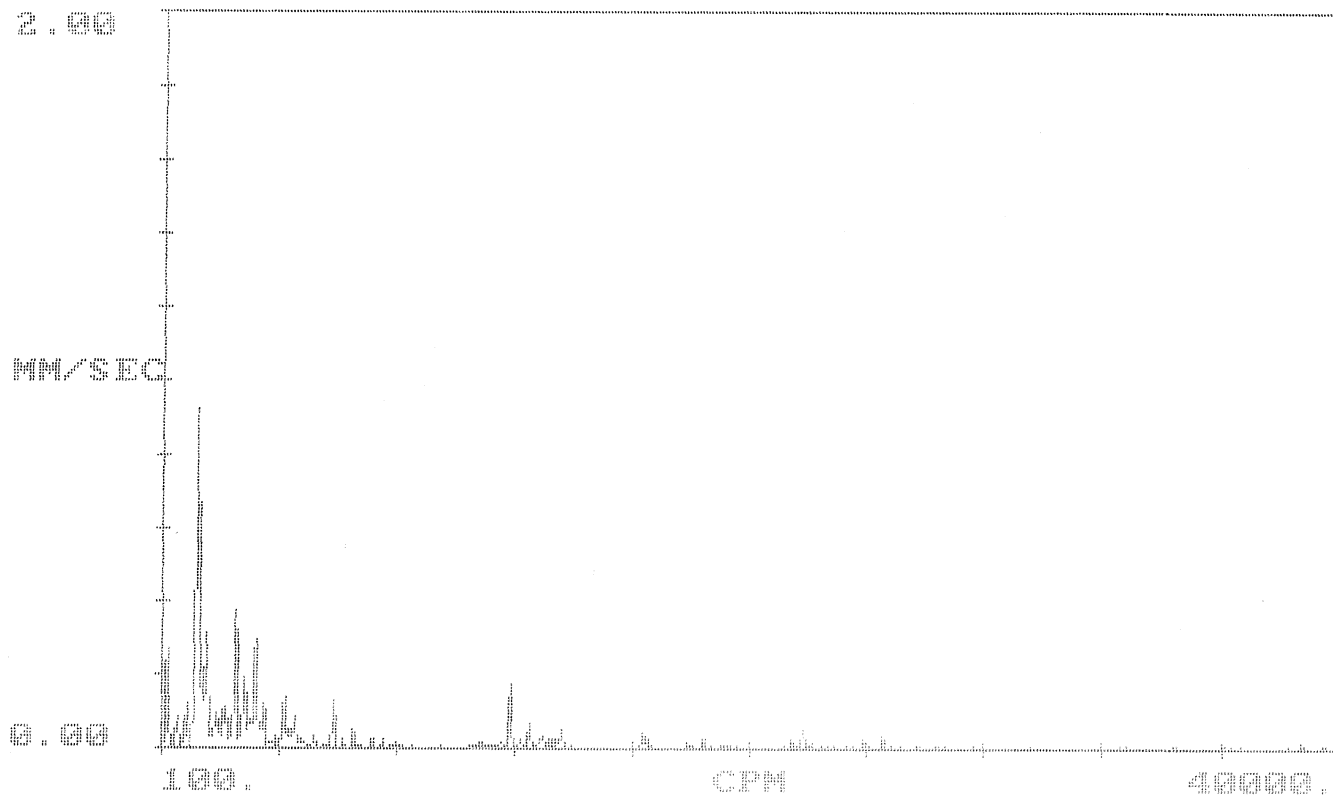


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.1	0.2919	1990.	0.1022	3150.	.08856	4665.	.09383
665.6	0.1005	2142.	0.1070	3331.	0.3304	5994.	0.1351
996.7	0.1249	2336.	0.1236	3500.	.07324	11992.	0.1826
1335.	0.9889	2662.	0.3961	3664.	0.1296	12659.	.07193
1661.	0.3257	2989.	0.2856	4330.	0.1636	21927.	.06639

Kw, 400

PUNTO #175 CEN EHR -1
[GENER 700KVA ,]

SPETTRO =1.62 MM/SEC RMS DIGIT

2.00

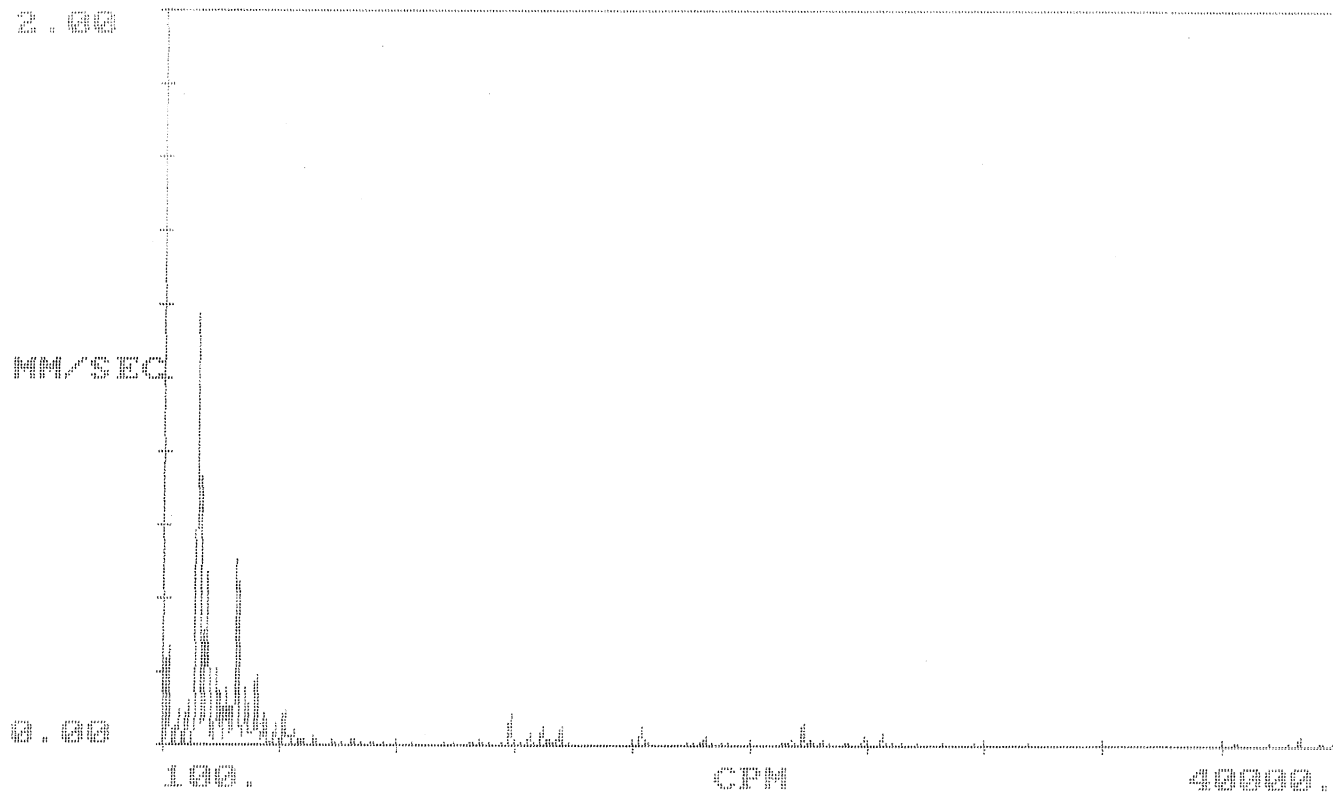

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.4	0.2967	1998.	0.2160	3329.	0.2209	11995.	.09447
665.9	0.1028	2155.	0.1050	3664.	.09388	13060.	.05609
998.5	0.1289	2335.	0.1753	3998.	.06274	13679.	.06029
1331.	1.299	2665.	0.5355	4331.	0.1114	16407.	.05299
1666.	0.5112	2992.	0.1631	4661.	.04557	21884.	.07173


KW250

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-IV-83 07:58:20
LETTURA GIRI : 333.
CARICO : 100.
VAL-TOT.=1.65 MM/SEC RMS DIGIT
SPETTRO =1.64 MM/SEC RMS DIGIT

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]


SPETTRO =1.64 MM/SEC RMS DIGIT

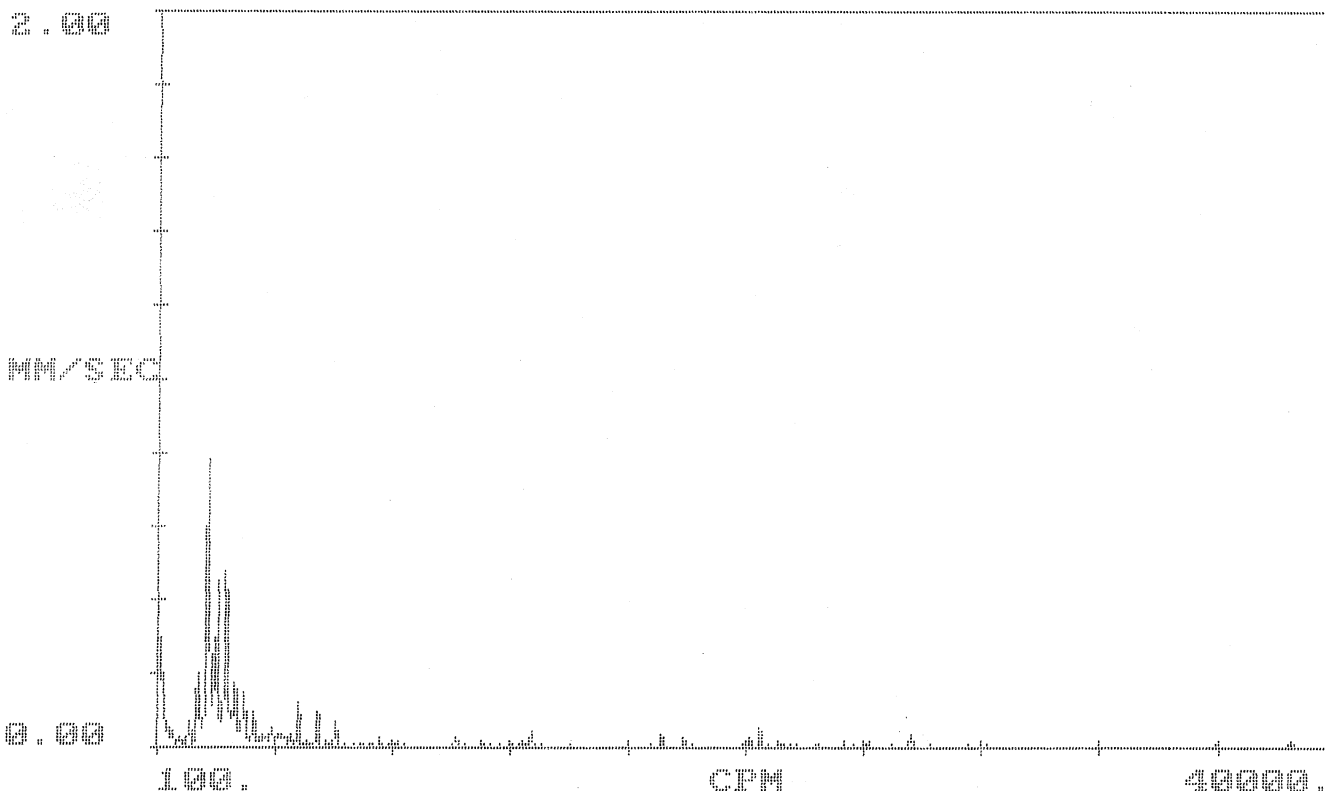

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
114.6	1.030	1847.	0.7935	3085.	0.1623	4948.	0.1269
300.0	0.2303	2000.	0.2456	3407.	.09907	5567.	0.1061
621.0	.05872	2165.	0.4872	3685.	.04361	6184.	.08215
1234.	.08327	2466.	0.5188	3987.	.05871	12849.	.05188
1543.	0.2082	2768.	0.1928	4325.	.04747	20562.	.06146

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

RMS DIGITRO =1.51 MM/SEC F

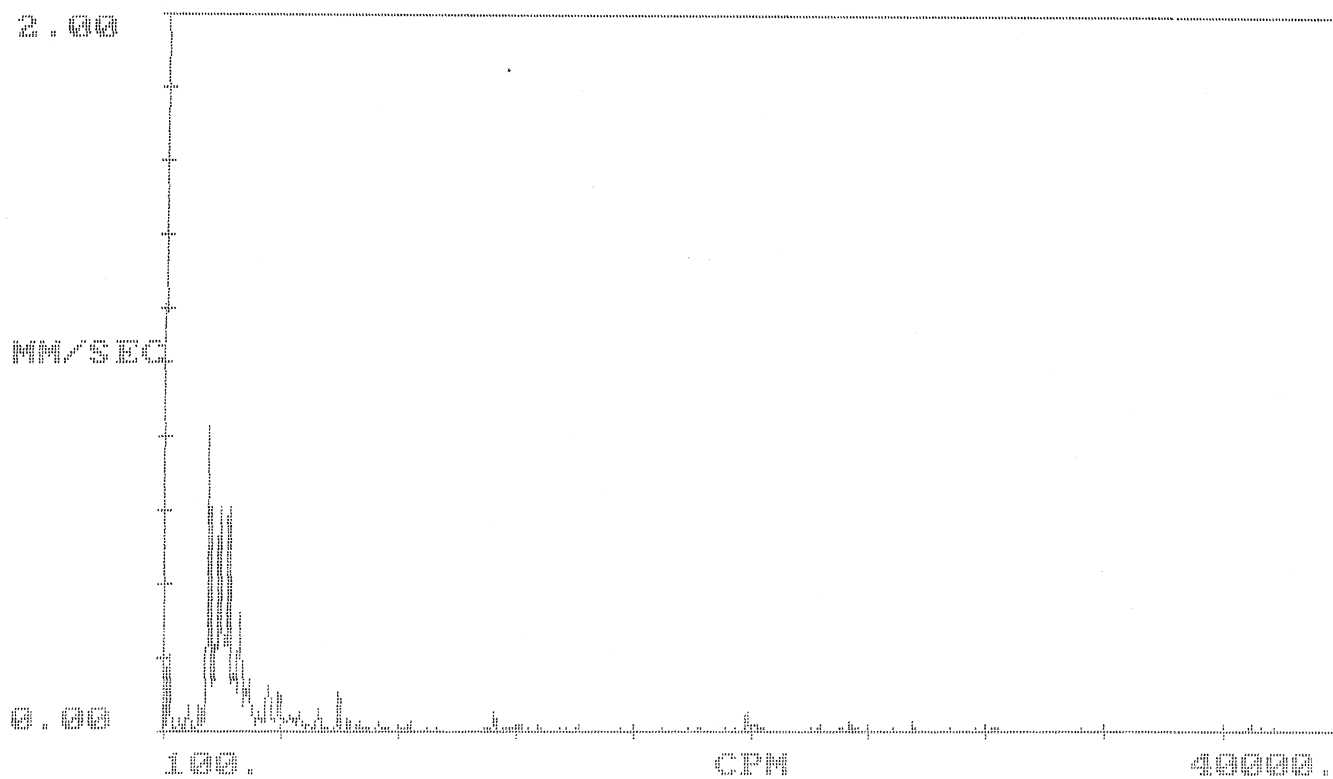


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
338.8	0.2238	2035.	0.6513	3037.	0.1523	4761.	.05926
1019.	.07745	2200.	0.2690	3379.	.06202	5430.	.06997
1362.	.07677	2378.	0.7040	3728.	0.1433	6109.	0.1105
1700.	0.8333	2531.	0.1810	4073.	0.1218	11390.	.05979
1900.	0.2362	2721.	0.3630	4477.	.05852	19933.	.05862

PUNTO #176 CEN EHR -2

[GENER 700KVA ,]

SPETTRO =1.52 MM/SEC RMS DIGIT

2.00

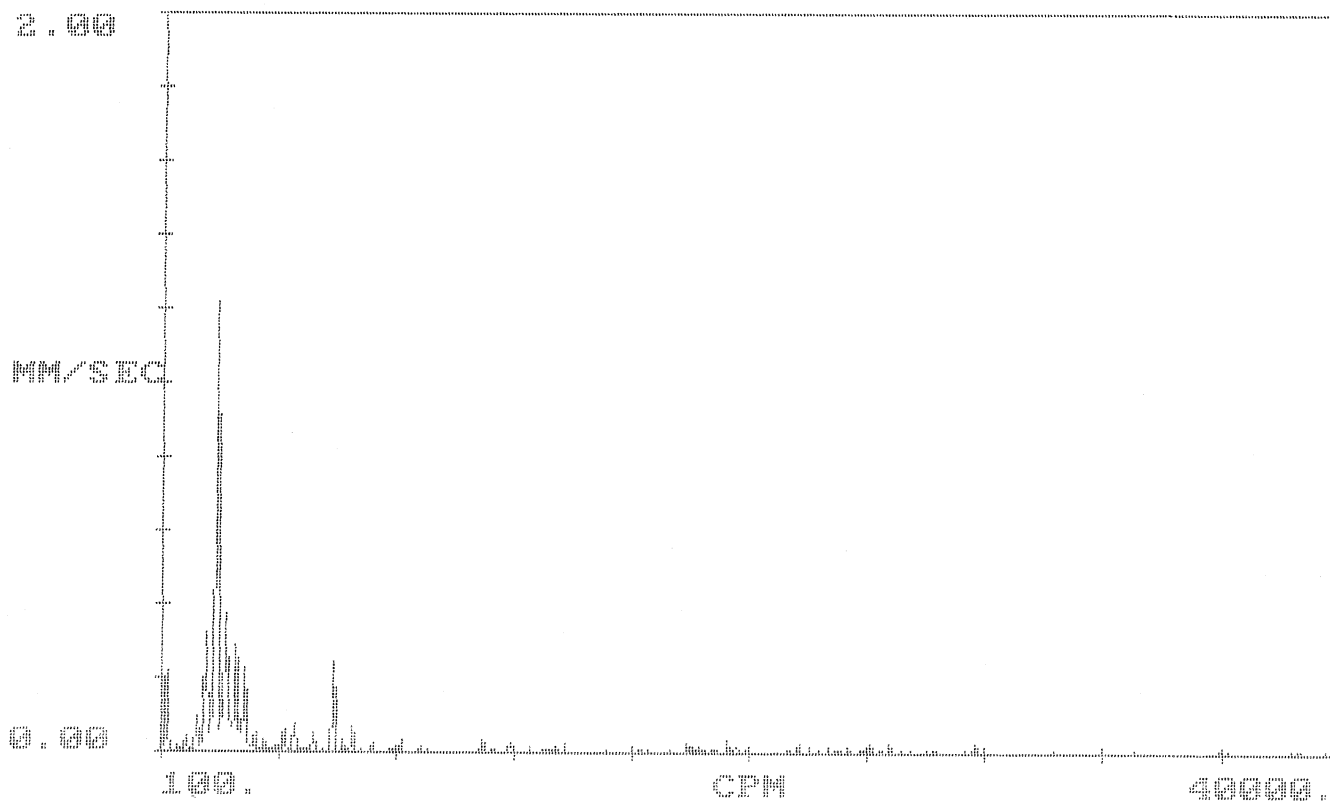

DATI DI FREQ.

332.7	0.2363
991.7	.04527
1332.	0.1129
1668.	0.3547
1996.	1.225

DATI DI FREQ.

2200.	0.1874
2333.	0.4098
2666.	0.3108
2850.	.09009
2999.	0.2309

DATI DI FREQ.

3326.	.06056
3667.	.03980
4329.	.07422
4665.	.09080
5329.	.06355

DATI DI FREQ.


5997.	0.2505
6330.	.03860
6663.	.07280
11071.	.04229
19370.	.04550

100ku

PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

SPETTRO =2.59 MM/SEC RMS DIGIT

3.00

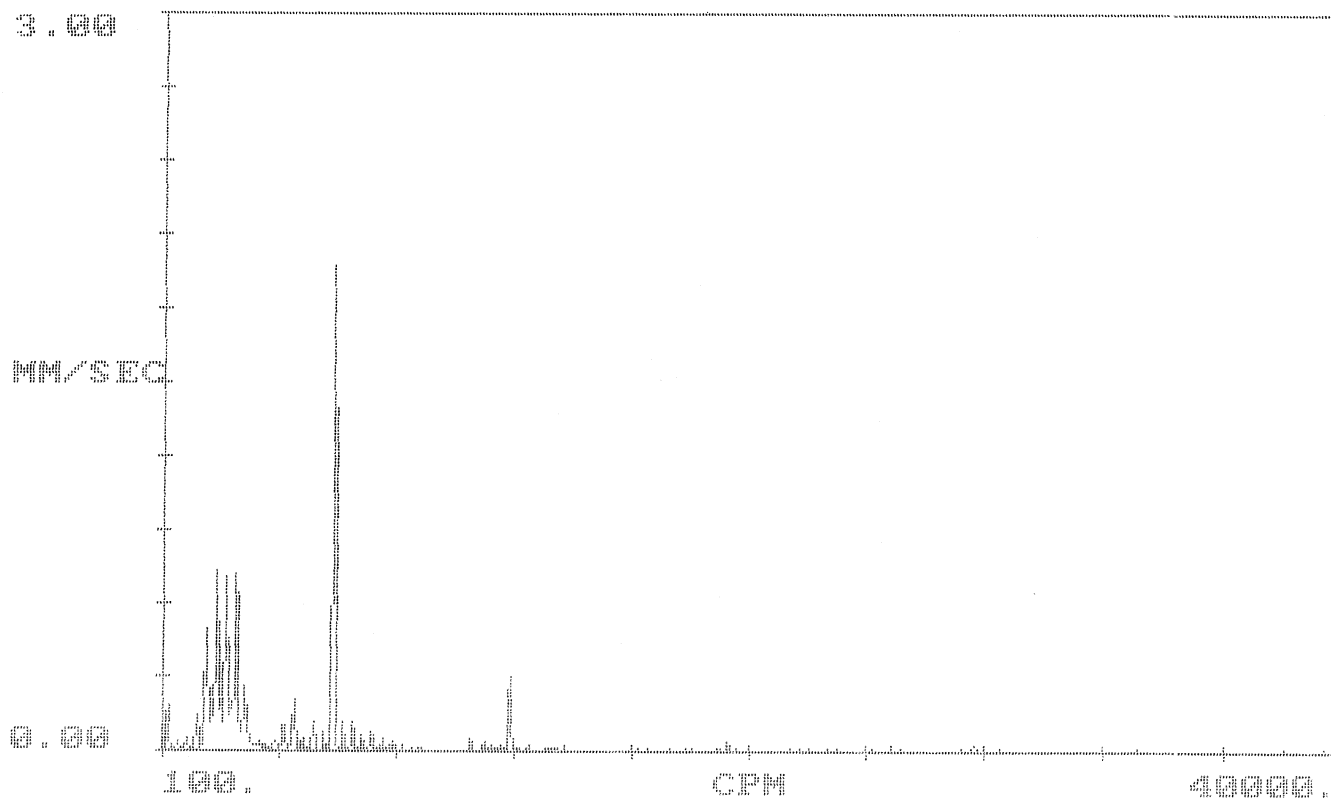

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.0	0.2083	2331.	0.7822	4323.	0.1339	6327.	0.1426
1332.	0.1682	2500.	0.1911	4662.	0.2202	6664.	0.1275
1665.	0.5280	2666.	0.7699	5328.	0.1439	6991.	.06773
1850.	0.1794	2850.	0.1248	5663.	.09051	7323.	.09084
1999.	0.7339	2987.	0.2775	5994.	1.998	11989.	0.3216

Kw530