


PUNTO #176 CEN EHR -2
[GENER 700KVA ,]

SPETTRO =2.42 MM/SEC RMS DIGIT

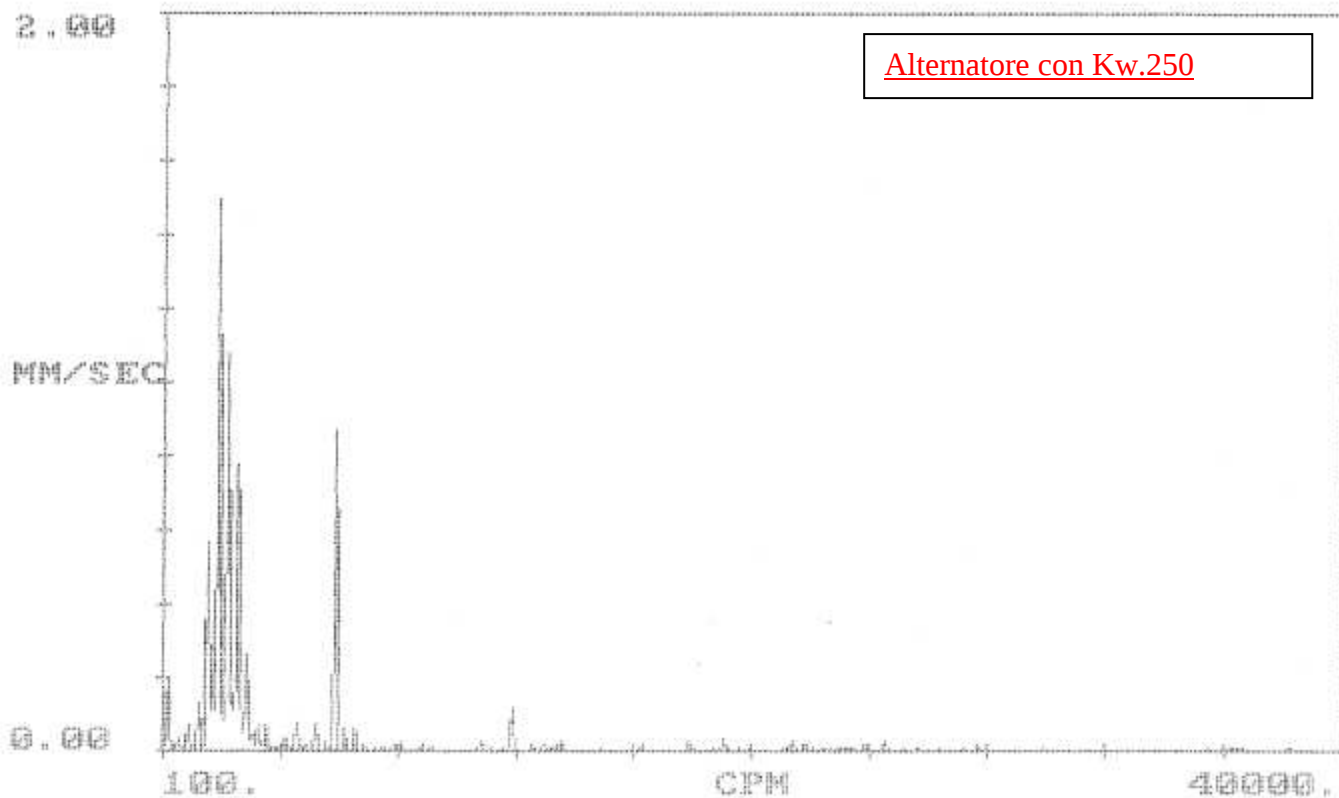

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.4	0.2126	1999.	1.502	3001.	0.2689	5333.	.09044
1000.	.07015	2150.	0.1890	3335.	.08068	6000.	0.8743
1334.	0.1479	2334.	1.161	3666.	.07854	6334.	.06577
1668.	0.6153	2500.	0.1500	4323.	.04591	6666.	.06943
1850.	0.1476	2668.	0.8442	4665.	.08776	12001.	0.1271


Kw250

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

STATO SEGNALE : OK
ULT. MISURA FATTA IL : 21-GIV-83 08:30:12
SPETTRO =2.46 MM/SEC RMS DIGIT

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]


SPETTRO =2.46 MM/SEC RMS DIGIT

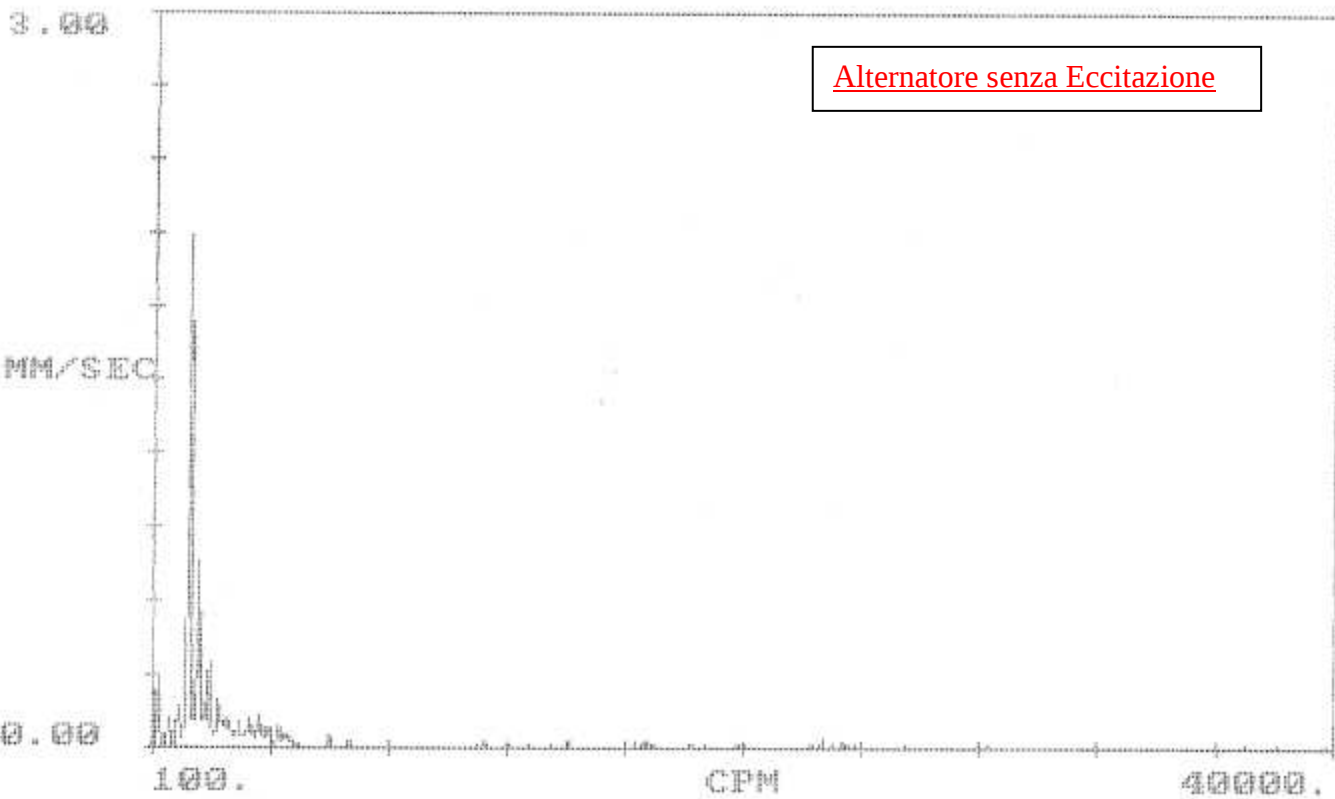

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
339.9	0.3140	1694.	0.7754	2584.	0.1349	3600.	.07335
678.4	0.1342	1900.	0.1922	2700.	0.1105	3736.	0.1387
1018.	0.1955	2032.	0.3082	3045.	0.1070	3950.	.08161
1360.	2.151	2369.	0.2149	3250.	.07541	4074.	.09744
1550.	0.1488	2500.	0.1126	3390.	0.1284	4420.	0.1029

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]


SPETTRO =0.675 MM/SEC RMS DIGIT

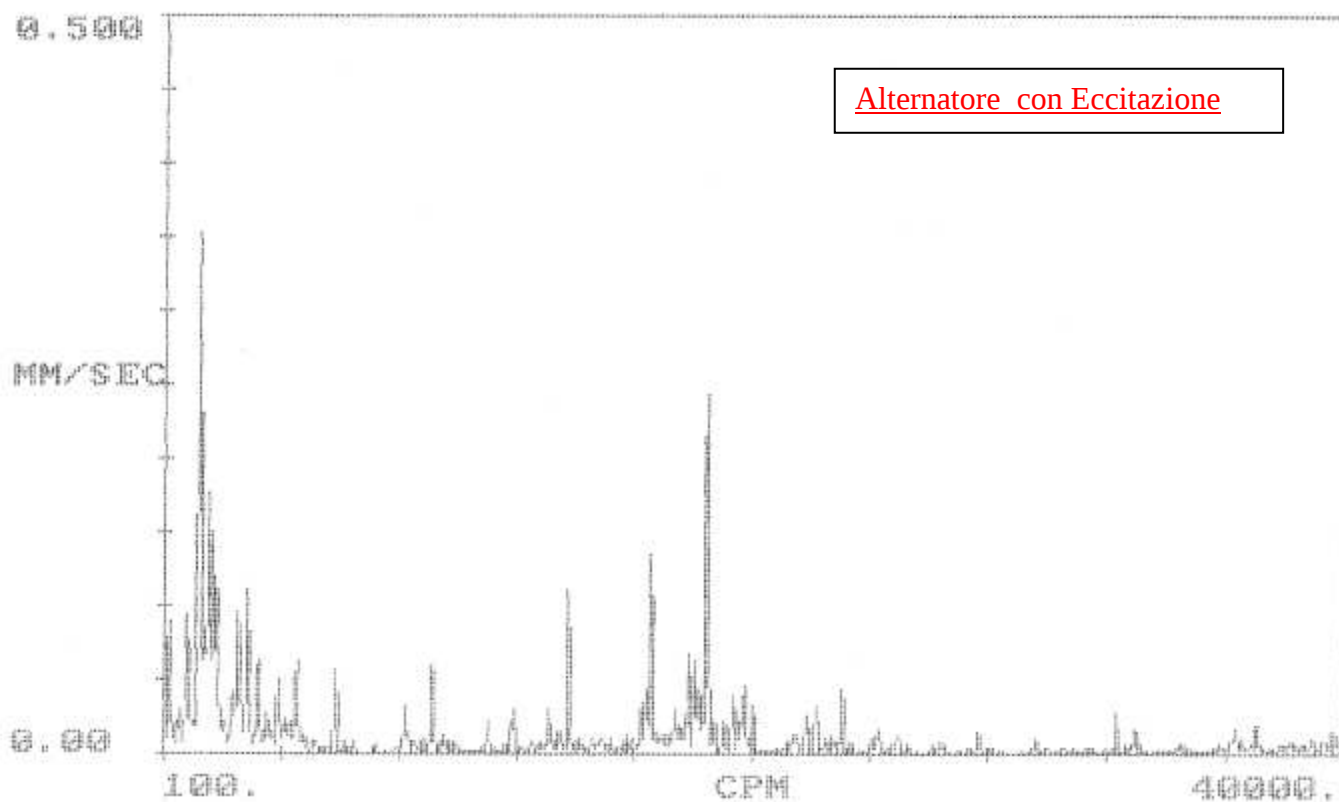

DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
334.0	.09675	1919.	0.1338	4636.	.06757	18904.	.06788
958.5	.09655	2669.	0.1055	6001.	.05855	18189.	.06621
1334.	0.3797	3000.	0.1128	9269.	.06608	18535.	0.2619
1500.	0.1044	3328.	.07273	13902.	0.1130	19835.	.04954
1713.	0.1848	4006.	.05194	16694.	0.1380	23165.	.04701

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

SPETTRO #0.970 MM/SEC RMS DIGIT

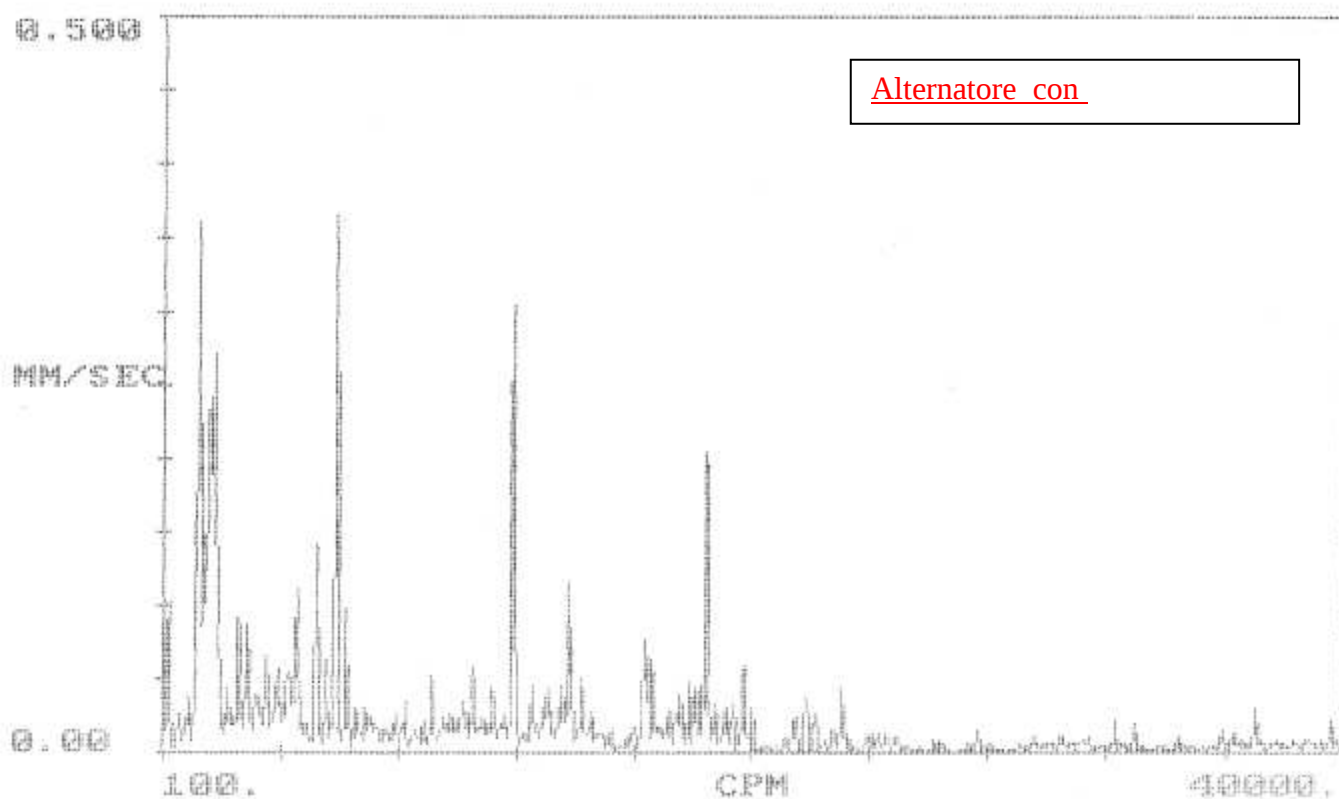


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
333.2	0.1101	2671.	0.1030	5329.	0.1601	13892.	0.1172
1330.	0.4013	3007.	.08891	5665.	.06877	16430.	.08533
1450.	0.1051	3642.	.06749	5994.	0.3696	16714.	.06823
1717.	0.2524	4375.	.06578	6328.	0.1113	18522.	0.2328
1834.	0.2931	4639.	0.1143	11990.	0.3136	19827.	.06921

100 Kw

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

SPETTRO =0.641 MM/SEC RMS DIGIT

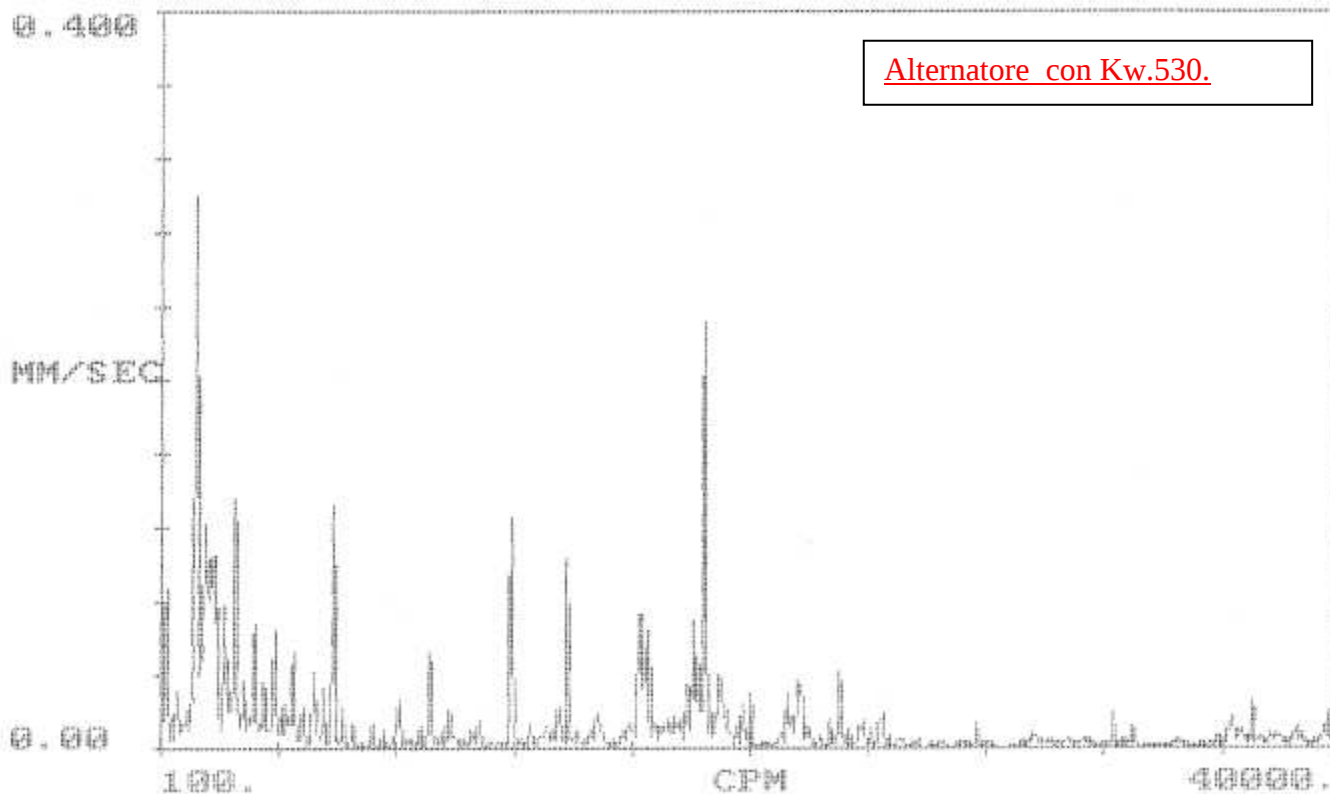


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
332.4	.09611	2334.	.08464	6000.	0.1337	16534.	.05947
1334.	0.3204	2668.	0.1498	9266.	.05602	16690.	.06704
1670.	0.1390	3330.	.07599	11999.	0.1267	18193.	.07194
1875.	0.1240	3997.	.06580	13902.	0.1031	18536.	0.2449
1990.	0.1079	4632.	.05703	16375.	.08673	19072.	.04708

Kw 530

PUNTO #177 CEN EHR -3
[GENER 700KVA ,]

SPETTRO =0.732 MM/SEC RMS DIGIT

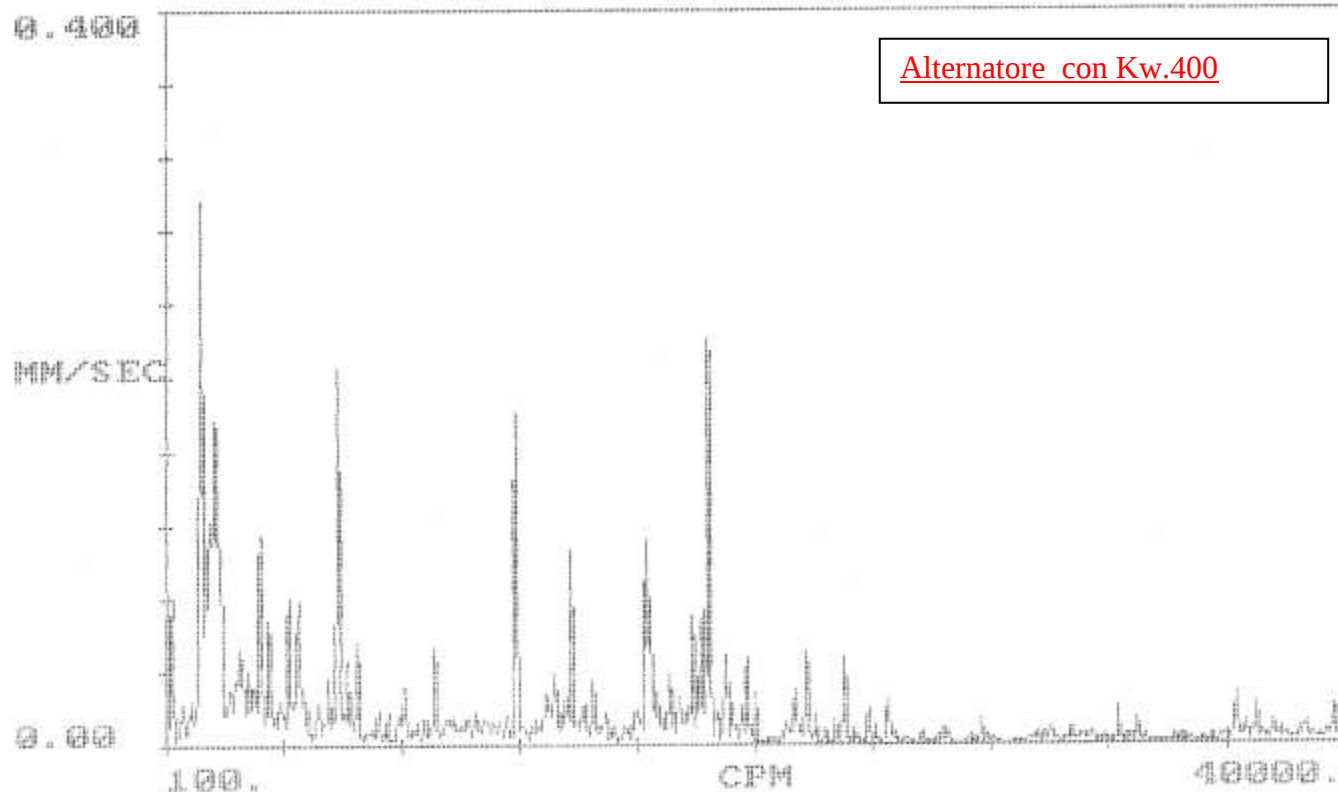


DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.		DATI DI FREQ.	
331.6	.08692	2668.	.05710	5997.	0.2065	16394.	0.1136
1332.	0.3230	3332.	0.1266	6659.	.05804	16527.	.09310
1671.	0.1376	3667.	.07369	9263.	.05563	18012.	.07244
1824.	0.2055	4333.	.08718	11993.	0.1850	18329.	.08265
2000.	0.1017	4644.	.07902	13895.	0.1070	18522.	0.2537

Kw 400

PUNTO #178 CEN EHR -3
[GENER 700KVA ,]

SPETTRO =1.87 MM/SEC RMS DIGIT

Alternatore con Kw..400 a 45° rispetto al punto monte valle

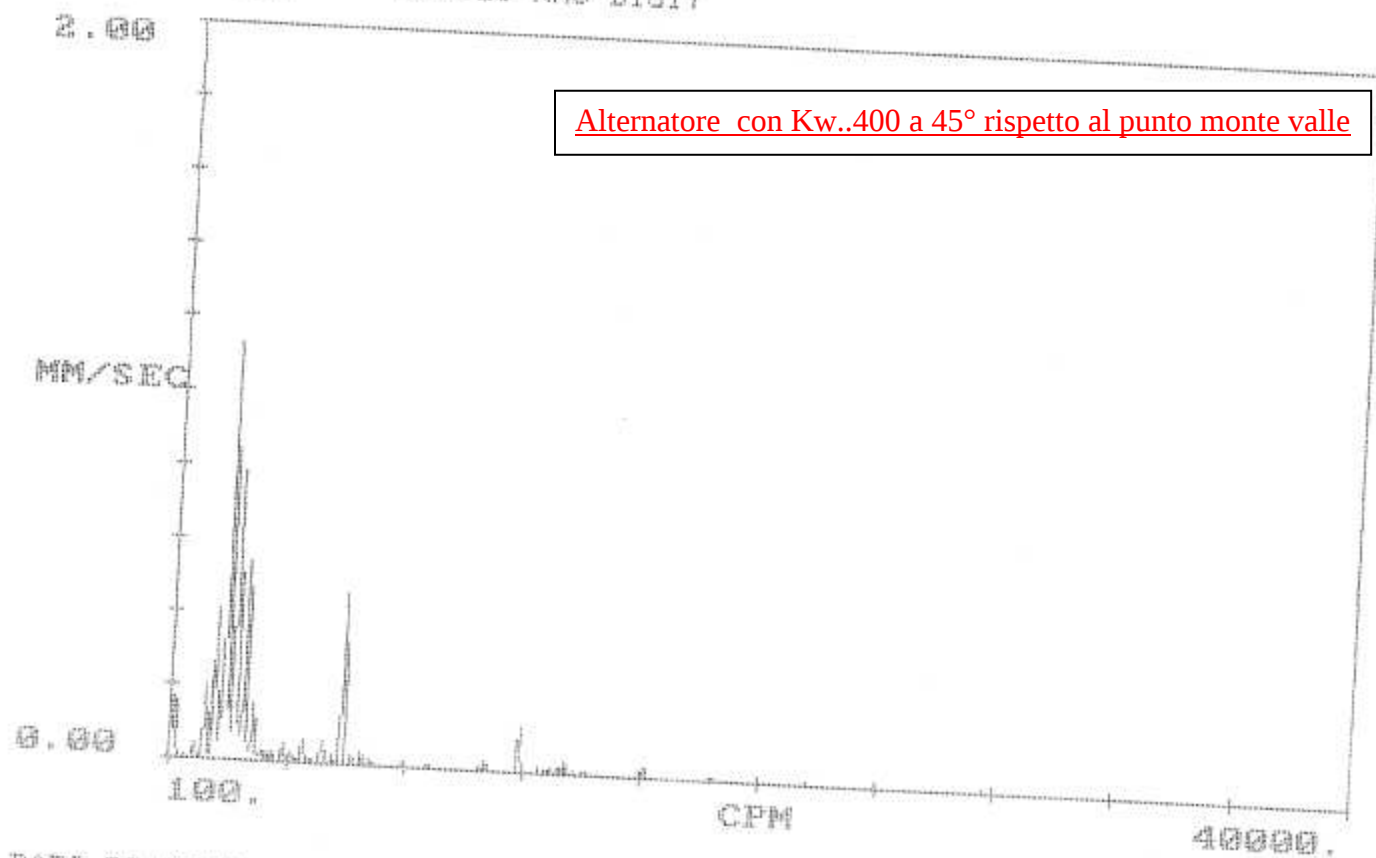

DATI DI FREQ.

300.0	0.1670
1000.	.04955
1334.	0.2198
1666.	0.4377
1850.	0.1448

DATI DI FREQ.

2000.	1.131
2150.	0.1470
2332.	0.8535
2500.	0.1136
2664.	0.5707

DATI DI FREQ.

2850.	.04789
3002.	0.1607
3998.	.05577
4659.	.06830
5329.	.06983


DATI DI FREQ.

5996.	0.4655
6328.	.03781
6662.	.04004
11992.	0.1248
13561.	.04303

45°

PUNTO #178 CEN EHR -4
I GENER 700KVA , 3

SPETTRO =0.455 MM/SEC RMS DIGIT

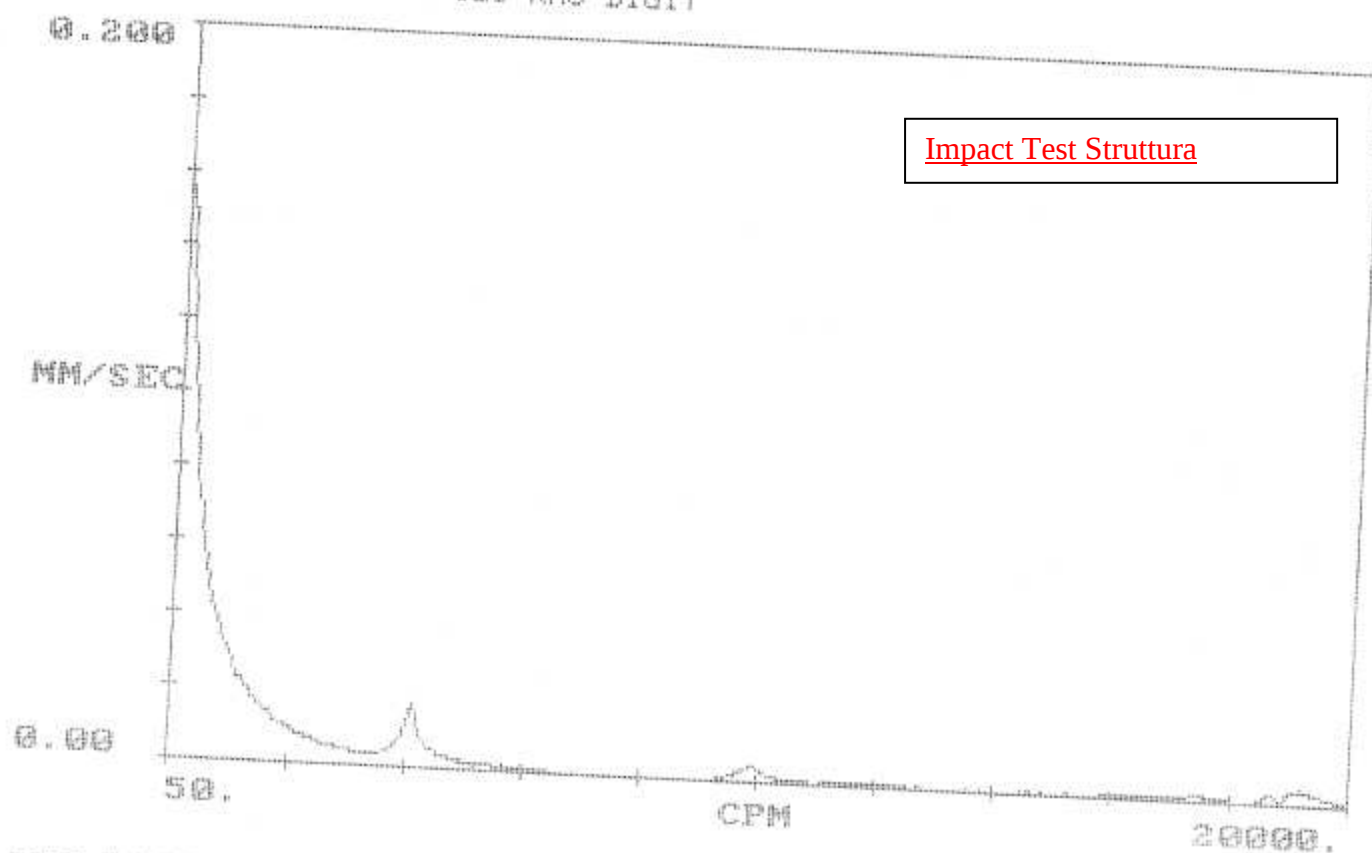

DATI DI FREQ.

111.9	.01843
1963.	.01280
2288.	.00976
2600.	.00633
2700.	.00570

DATI DI FREQ.

2738.	.00682
2813.	.00649
3038.	.00551
3100.	.00457
3313.	.00486

DATI DI FREQ.

3488.	.00449
3750.	.00496
4163.	.02109
4525.	.00531
4650.	.00422

DATI DI FREQ.

4738.	.00463
9938.	.00578
19100.	.00430
19175.	.00434
19213.	.00513