




Date/Time 16/01/2019 14:45:20

Page 1 of 2

Data e ora della misurazione 20/12/2018 15:35:45

REM\MONDOPLASTICO\POMPA 4 MANDATA ACQUA UTILIZZI\MOTORE\M1V\m1v.srveas

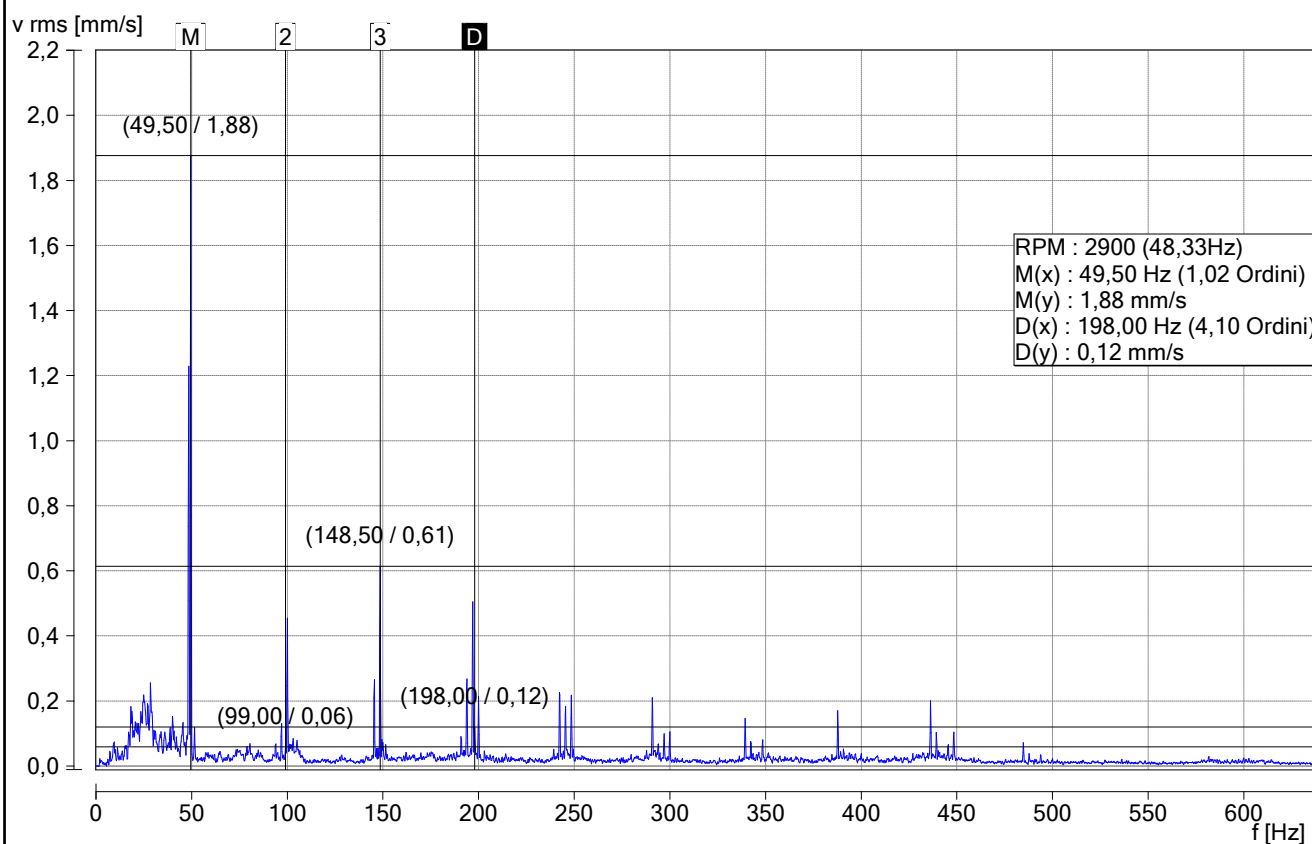

Cursore	X [Hz]	= 49,50
Principale	Y [mm/s]	= 1,88
Cursore delta	X [Hz]	= 198,00
	Y [mm/s]	= 0,12
RPM		= 2900
RMS	Y [mm/s]	= 2,73



Date/Time

16/01/2019 14:45:20

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	49,50	1,88
2	48,50	1,23
3	148,50	0,61
4	197,00	0,51
5	100,00	0,45
6	194,00	0,27
7	145,50	0,27
8	28,50	0,26
9	242,25	0,23
10	25,00	0,22