




Date/Time 16/01/2019 15:13:29

Page 1 of 2

Data e ora della misurazione 20/12/2018 15:39:10

REM\MONDOPLASTICO\POMPA 4 MANDATA ACQUA UTILIZZI\MOTORE\M2H\m2h.sracea

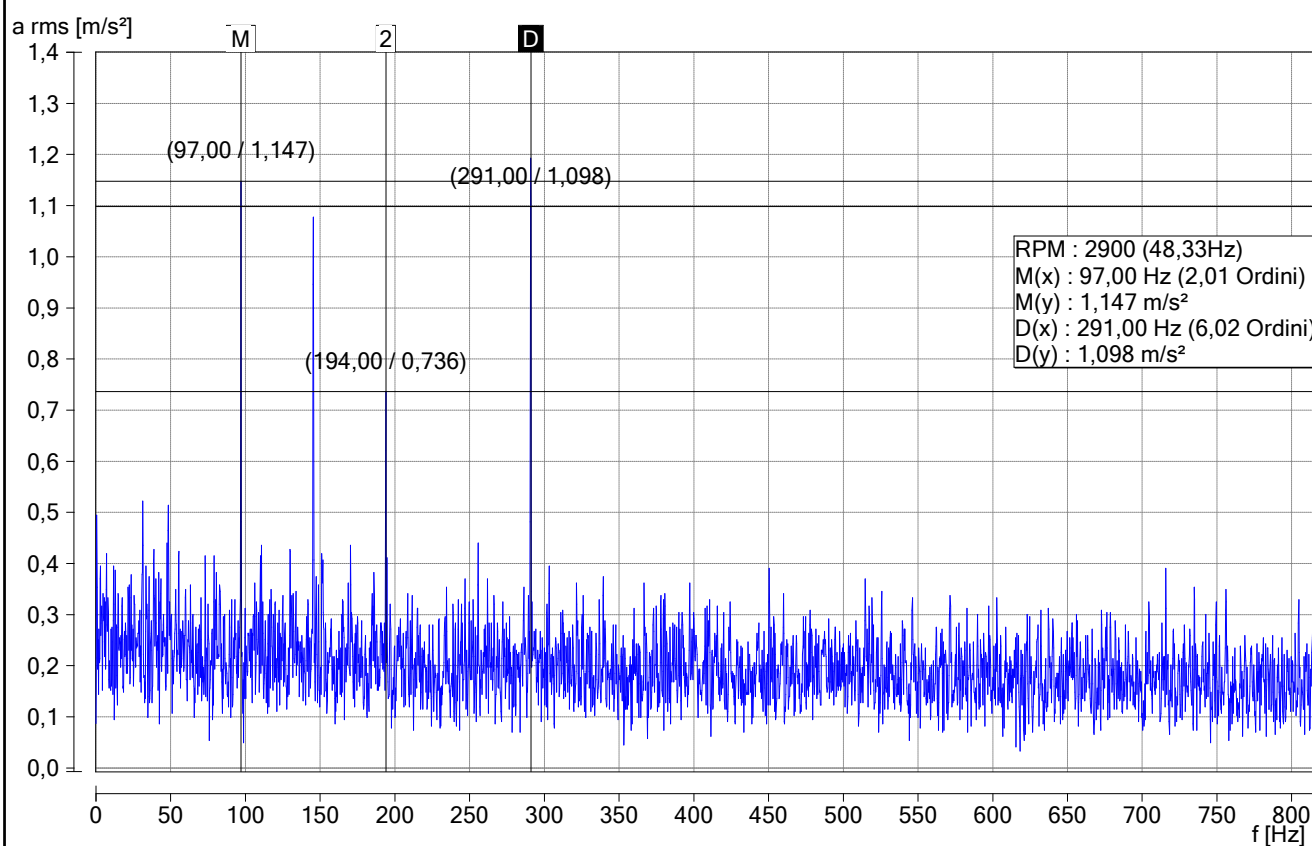

Cursore	X [Hz]	= 97,00
Principale	Y [m/s ²]	= 1,147
Cursore delta	X [Hz]	= 291,00
	Y [m/s ²]	= 1,098
RPM		= 2900
RMS	Y [m/s ²]	= 9,53



Date/Time

16/01/2019 15:13:29

Page 2 of 2

Canale #	A	
	X [Hz]	Y [m/s ²]
1	290,75	1,193
2	97,00	1,147
3	145,50	1,078
4	194,00	0,736
5	31,25	0,522
6	48,50	0,514
7	0,50	0,494
8	47,50	0,440
9	255,75	0,440
10	110,75	0,436