




Date/Time 16/01/2019 16:15:47

Page 1 of 2

Data e ora della misurazione 08/01/2019 12:24:12

REM\MONDOPLASTICO\POMPA OLIO CALDAIA EPC2500\POMPA\P1H\p1h.srcea

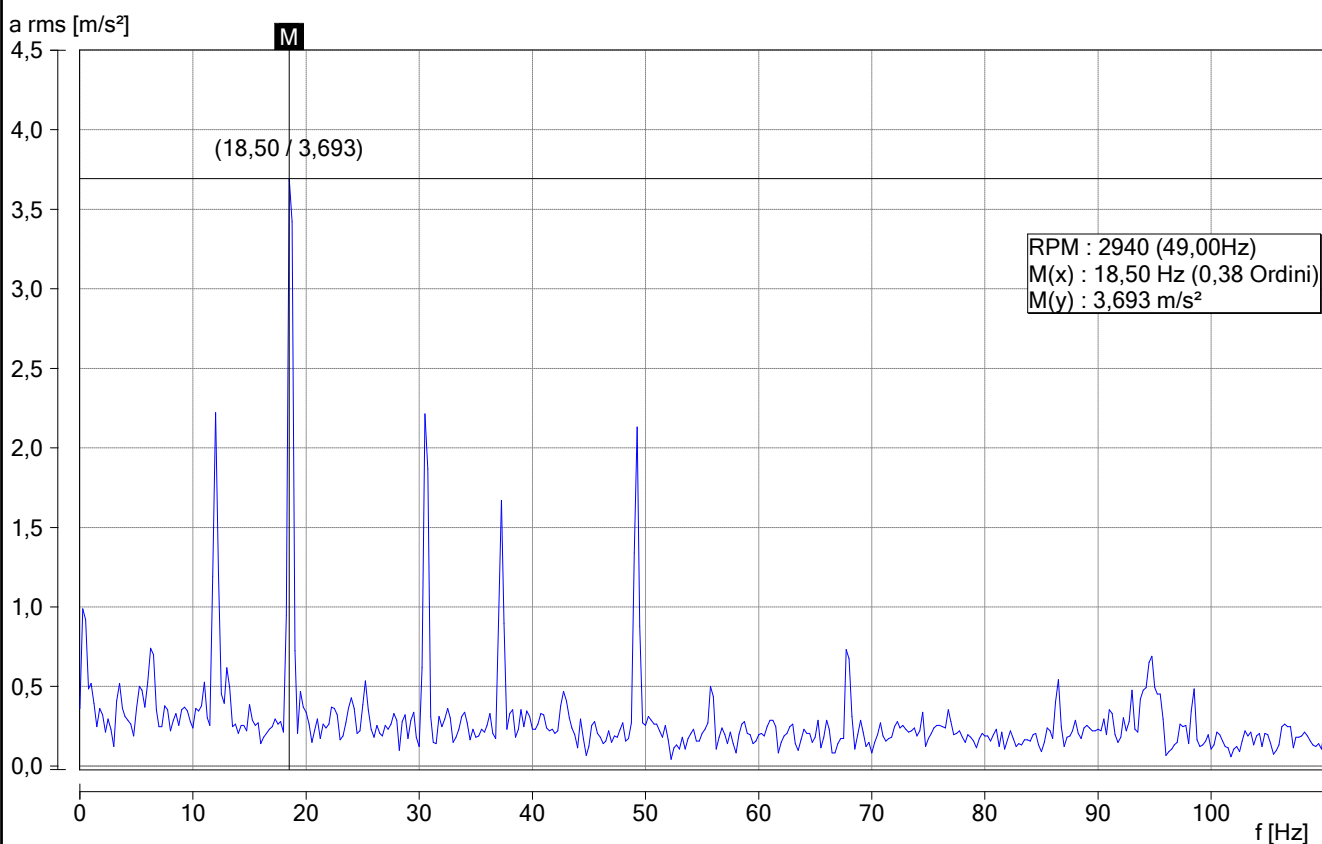

Cursore X [Hz] = 18,50

Principale

Y [m/s²] = 3,693

Cursore delta X [Hz] = Non Attivo

Y [m/s²] = Non Attivo

RPM = 2940

RMS Y [m/s²] = 8,13



Date/Time

16/01/2019 16:15:47

Page 2 of 2

Canale #	A	
	X [Hz]	Y [m/s ²]
1	18,50	3,693
2	12,00	2,221
3	30,50	2,213
4	49,25	2,130
5	37,25	1,670
6	0,25	0,989
7	6,25	0,740
8	67,75	0,732
9	94,75	0,691
10	13,00	0,617