




Date/Time 16/01/2019 15:37:43

Page 1 of 2

Data e ora della misurazione 08/01/2019 10:01:11

REM\MONDOPLASTICO\POMPA PRIMO STACCO\POMPA\P1H\p1h.sracea

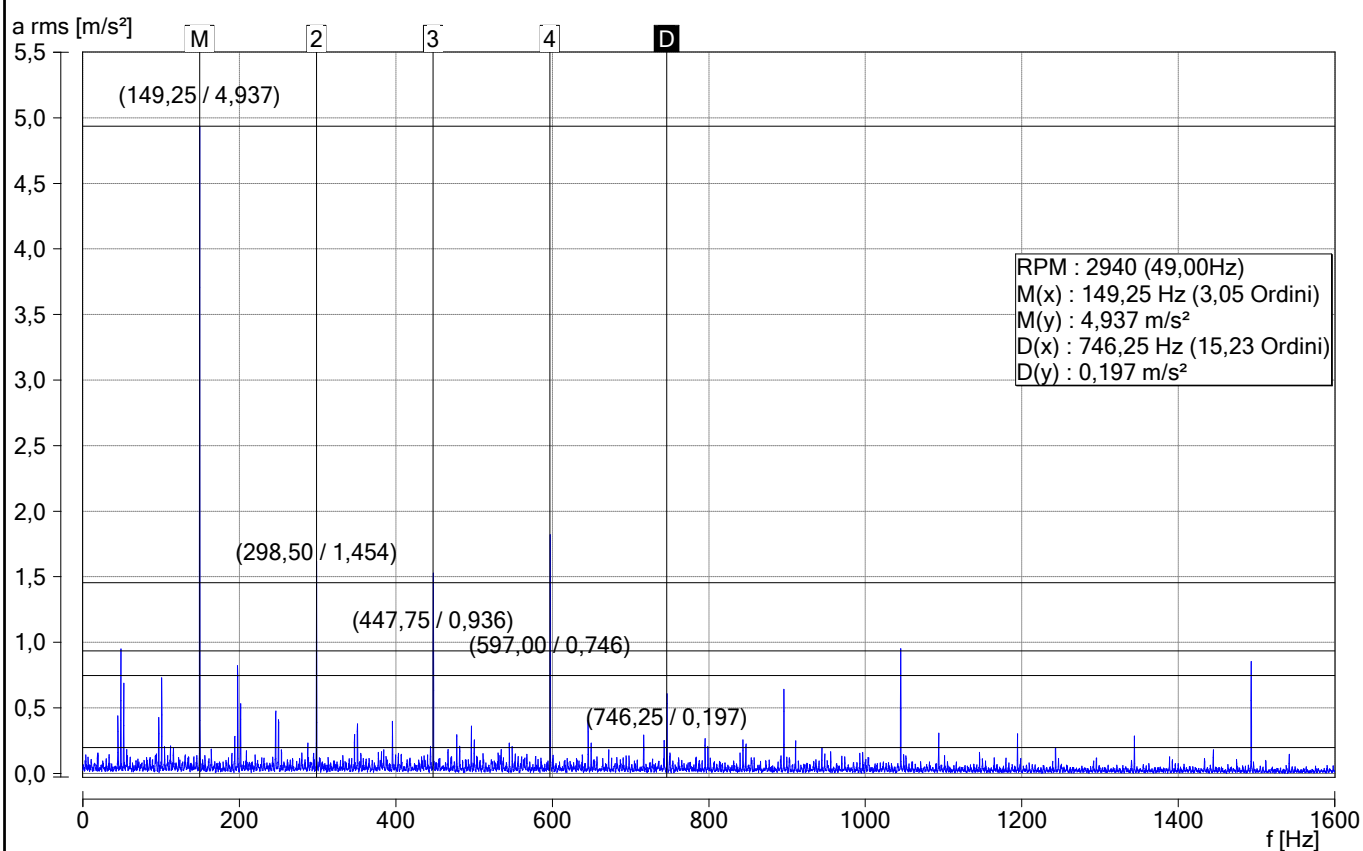

Cursore Principale	X [Hz]	= 149,25
	Y [m/s ²]	= 4,937
Cursore delta	X [Hz]	= 746,25
	Y [m/s ²]	= 0,197
RPM		= 2940
RMS	Y [m/s ²]	= 6,89



Date/Time

16/01/2019 15:37:43

Page 2 of 2

Canale #	A	
	X [Hz]	Y [m/s ²]
1	149,25	4,937
2	597,25	1,820
3	298,75	1,620
4	448,00	1,528
5	1045,25	0,952
6	48,50	0,948
7	1493,25	0,853
8	197,75	0,822
9	100,75	0,730
10	52,25	0,687