




Date/Time 04/01/2021 11:04:20

Page 1 of 2

Data e ora della misurazione 28/12/2020 08:50:03

REM\MONDOPLASTICO\COMPRESSORE 1 M77\MOTOREM2V\1020 SPETTRO MACCHINA 400 HZ

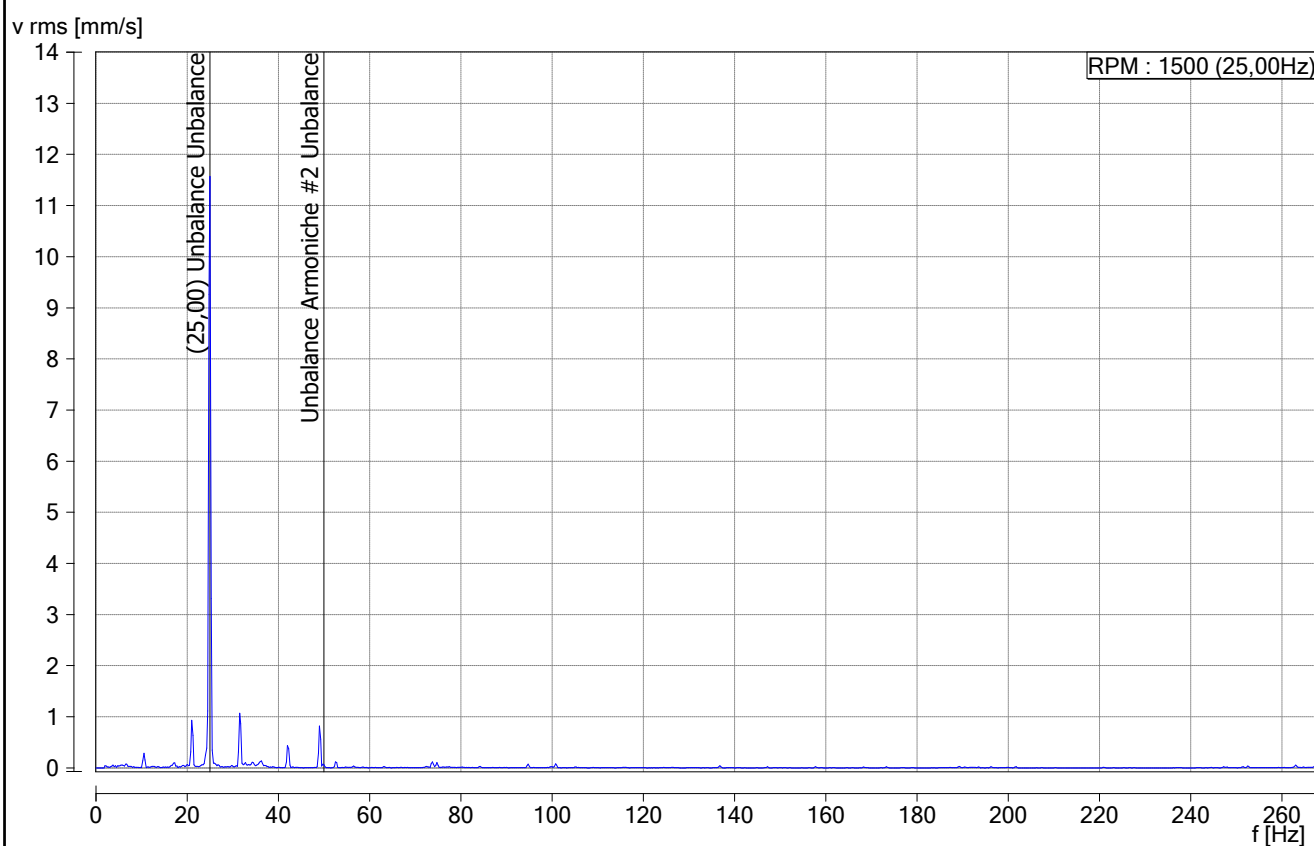

Cursore Principale	X [Hz]	= Non Attivo	(25,00) Unbalance Unbalance
	Y [mm/s]	= Non Attivo	
Cursore delta	X [Hz]	= Non Attivo	
	Y [mm/s]	= Non Attivo	
RPM		= 1500	
RMS	Y [mm/s]	= 11,72	



Date/Time

04/01/2021 11:04:21

Page 2 of 2

Canale #	A	
	X [Hz]	Y [mm/s]
1	25,00	11,57
2	31,50	1,07
3	21,00	0,93
4	49,00	0,82
5	42,00	0,44
6	294,25	0,41
7	883,00	0,34
8	10,50	0,29
9	1177,25	0,26
10	36,25	0,14