


Data e ora della misurazione30/05/2024 13:47:25

VETRECO\REPARTO MACINAZIONE\VIBRATORE 410 B INFERIORE\MOTORE\M2V\1004 ENVELOPE
SPETTRO ACC

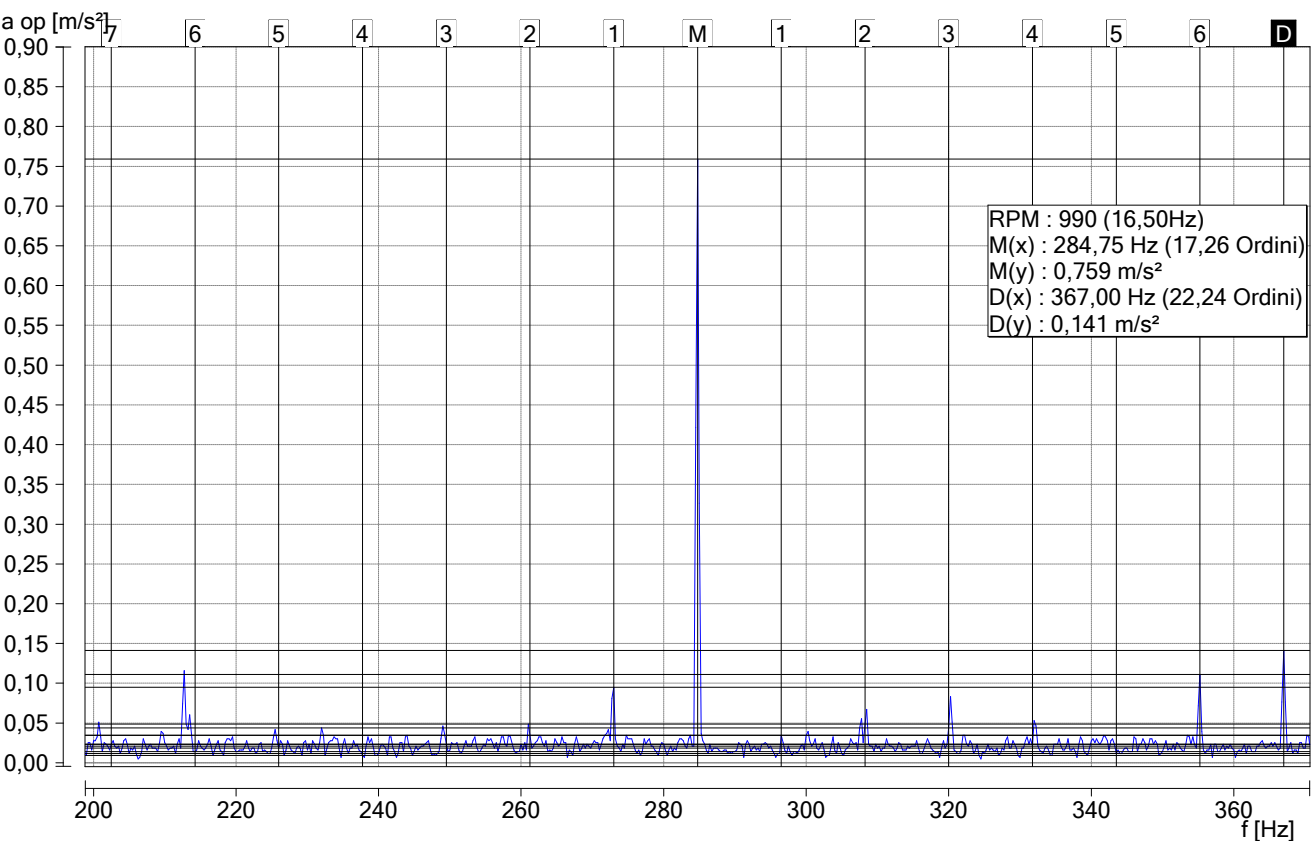

Cursore	X [Hz]	= 284,75	(100,000) Elect.100 Hz
Principale	Y [m/s²]	= 0,759	(50,000) Elect.50 Hz
Cursore delta	X [Hz]	= 367,00	(16,50) Unbalance
	Y [m/s²]	= 0,141	(16,50) 1.Align
RPM		= 990	(33,00) 2.Align
RMS	Y [m/s²]	= 1,17	

Canale #	A	
	X [Hz]	Y [m/s²]
1	284,75	0,759
2	402,50	0,574
3	11,75	0,405
4	687,25	0,377
5	1089,75	0,363
6	805,00	0,347
7	378,75	0,220
8	47,50	0,181
9	414,50	0,150
10	497,50	0,146