


Data e ora della misurazione30/05/2024 14:17:16

VETRECO\REPARTO MACINAZIONE\VIBRATORE 440 A SUPERIORE\MOTORE\M1V\1004 ENVELOPE
SPETTRO ACC

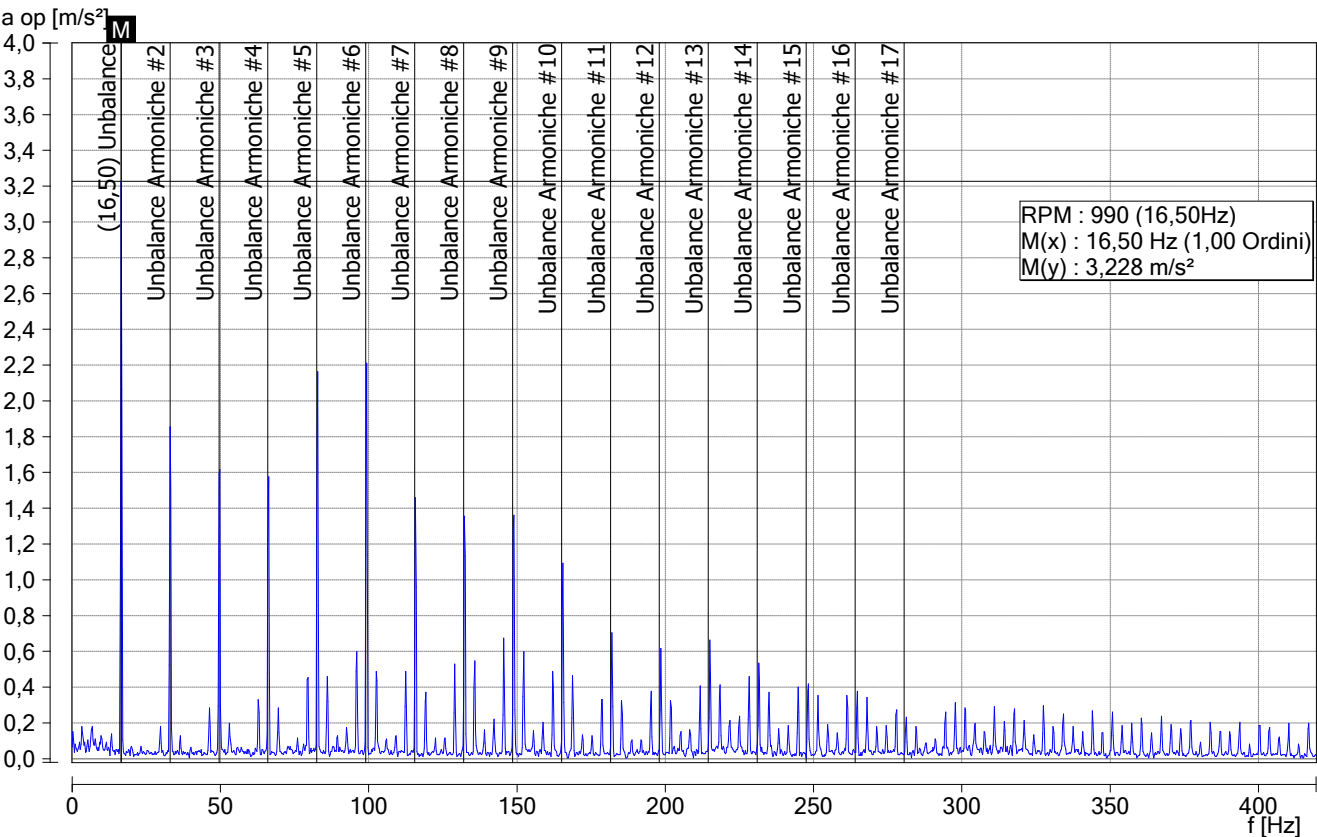

Cursore Principale	X [Hz]	= 16,50	(16,50) Unbalance
	Y [m/s ²]	= 3,228	
Cursore delta	X [Hz]	= Non Attivo	
	Y [m/s ²]	= Non Attivo	
RPM		= 990	
RMS	Y [m/s ²]	= 4,96	

Canale #	A	
	X [Hz]	Y [m/s ²]
1	16,50	3,228
2	99,25	2,210
3	82,75	2,164
4	33,00	1,855
5	49,75	1,617
6	66,25	1,576
7	115,75	1,460
8	149,00	1,361
9	132,25	1,355
10	165,50	1,093