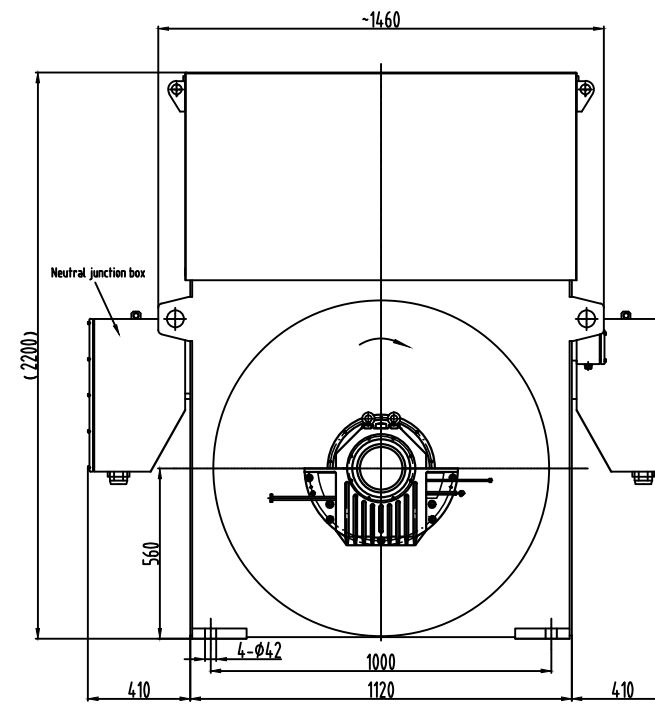


Diagram illustrating the 30-Position Rack Assay setup. The rack contains 30 positions, numbered 1 through 30. The positions are grouped into four sets of eight positions each, corresponding to the bottles B1 through B8, B9 through B16, B17 through B24, and B25 (which is positioned above the last two positions, 29 and 30).

Legend:

- B1-B8: Inhibitor of PGC
- B9-B16: B5, B5 V, B3, B6 V, B7-B8: Inhibitor of PGC (B7 for B5, B8 for B6)
- B9: Healer

THIS DOCUMENT CONTAINS PROPRIETARY AND
CONFIDENTIAL INFORMATION AND MAY NOT BE
DISCLOSED TO OTHERS FOR ANY PURPOSE OR
USED FOR MANUFACTURING PURPOSES WITHOUT
WRITTEN PERMISSION FROM SEIPEE SPA

1	1	P	MOTOR			A4	2320KW 6000V 50Hz IP55 IC611 IMB3 2982RPM			BOOK NO.		
ITEM NO.	PCS PER UNIT	SC	PART NAME			DWG SIZE	SPECIFICATION			ALL DIMENSION IN MM DO NOT SCALE DRAWING		
7							STANDARD TOLERANCE ISO 2768-m IF NOT OTHERWISE SPECIFIED X. =+/- .25 X.X =+/- .12 X.XX =+/- .06 X.XXX =+/- .03 ANGLE +/- 1DEGR	Quality Achieve Your Success				
6												
5								A4	21-02-02012	0		
4												
3												
2												
1					CHK'D BY:	DATE:						
NO.	REVISION			BY	DATE	BY:	DATE:02-02-21					