

FN080-SDS.6N.V7 163705

Beschreibung / Description

3~ 400V ±10% D/Y 50Hz P1 1,8/1,15kW
3,9/2,2A DI=5% 900/700rpm COSY 0,68 65°C
IP55 THCL 155 Special impregnation HV.
ErP conform 2015
N=41,5
statA=36,8%


Messaufbau / Assembling:

Ventilator montiert in Volldüse ohne saugseitigem Berührschutzgitter.
Fan measured in full bell mouth without guard grille on suction side.

Legende / Legend

- A) 3~ 400V 50Hz D [ID]
- B) 3~ 300V 50Hz D [ID]
- C) 3~ 230V 50Hz D [ID]
- D) 3~ 190V 50Hz D [ID]
- E) 3~ 145V 50Hz D [ID]
- Gemessen mit üblichen Toleranzen / Measured with normal tolerances

1. Diagramm / Chart : Volumenstrom - Druckerhöhung - elektr. Leistungsaufnahme / Airflow - Pressure - Electr. Power Input

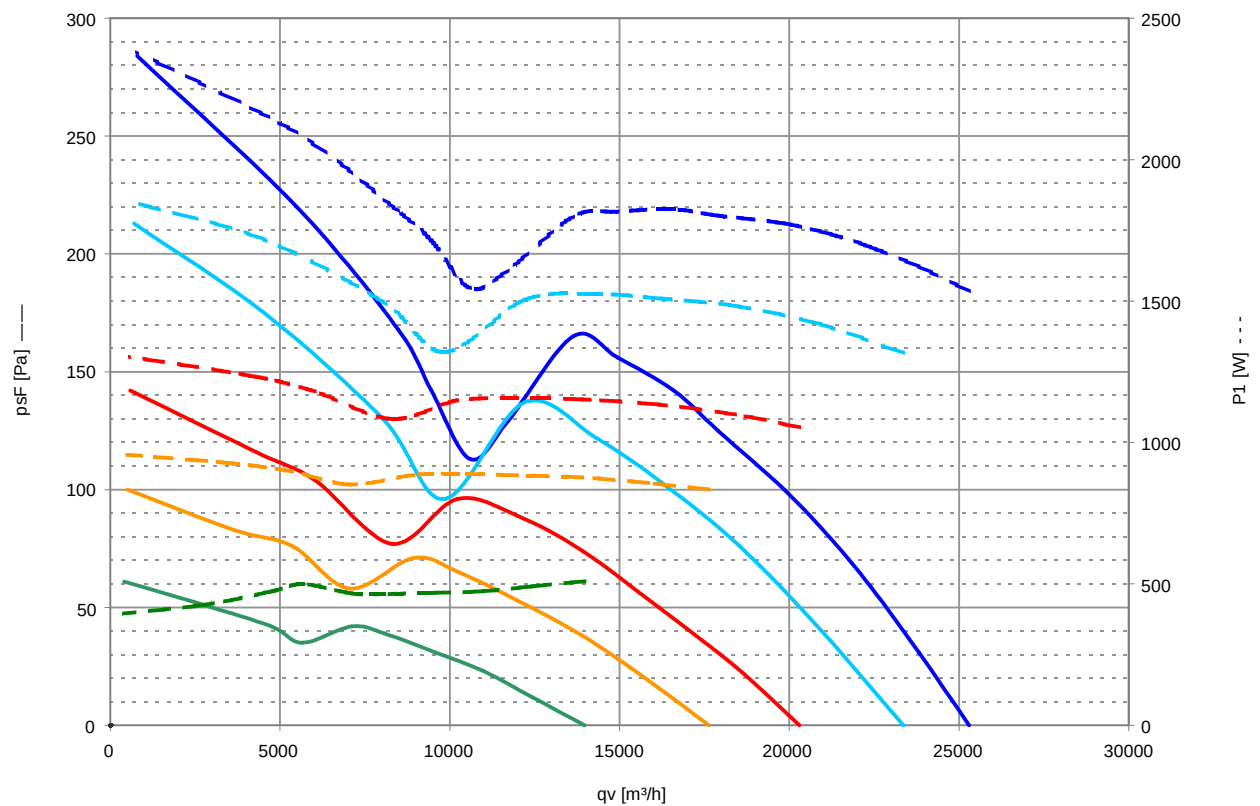

2. Diagramm / Chart : Volumenstrom - Akustik / Airflow - Acoustics

