




Date/Time 29/11/2017 12:33:25

Page 1 of 1

Data e ora della misurazione 17/11/2015 14:28:22 , 10/05/2016 12:23:08 , 02/11/2016 15:53:18 , 22/11/2017 11:38:07

Siniat\Formatura\Filtro Scoring - x\Motore con ventilatore\Punto 2\103 Mach. spectr. >600

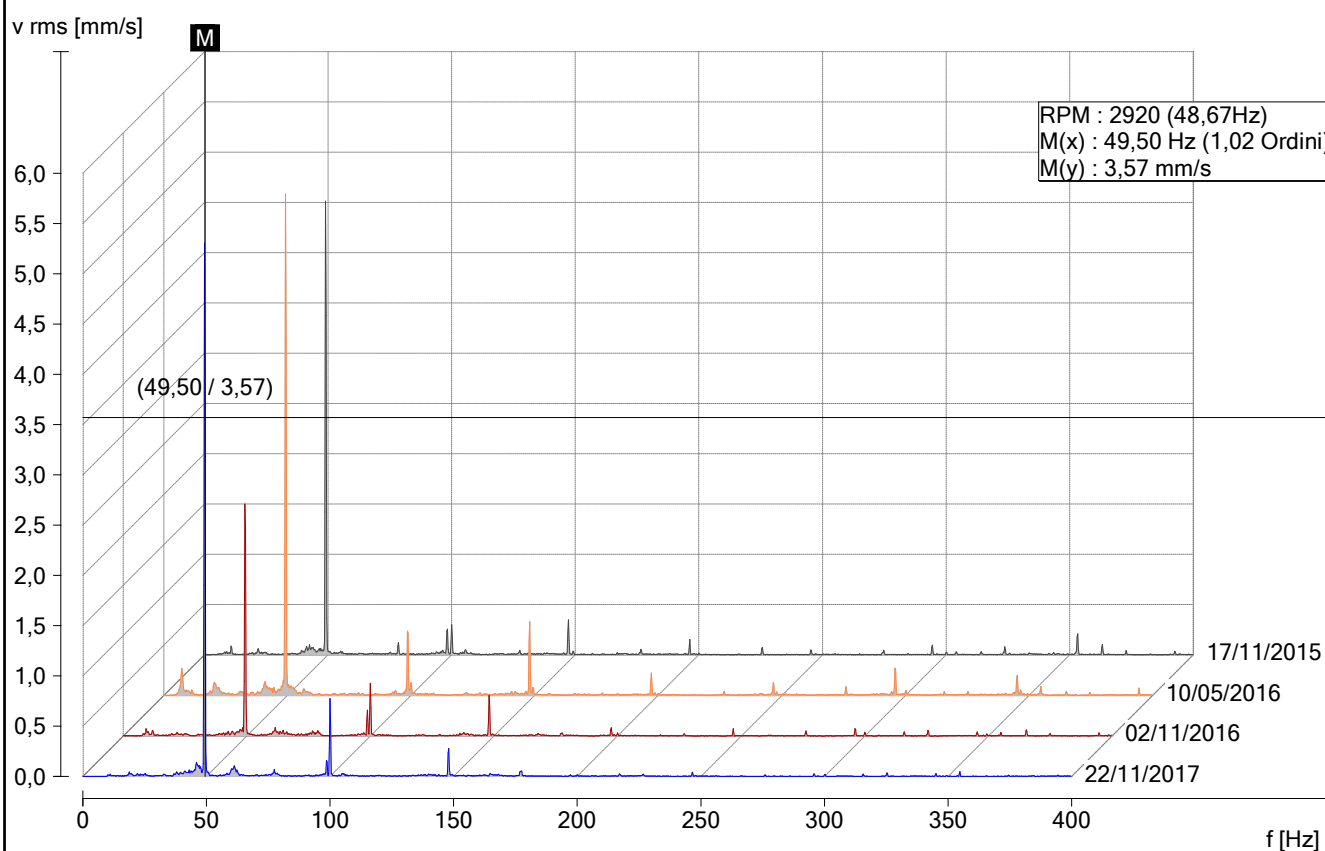

Cursore Principale	X [Hz]	= 49,50	(173,64) BPFO 6206 (SKF)
	Y [mm/s]	= 3,57	(264,36) BPFI 6206 (SKF)
	X [Hz]	= Non Attivo	(224,94) RPF 6206 (SKF)
	Y [mm/s]	= Non Attivo	(19,27) FTF 6206 (SKF)

Data	Ora	Evento	Commento
24/11/2017	12:15:47	Misura mancante	Misura mancante.
23/11/2017	17:15:39	Misura mancante	Misura mancante.
21/11/2017	17:38:41	Misura mancante	Misura mancante.