




Date/Time 29/11/2017 15:28:33

Page 1 of 2

Data e ora della misurazione 24/11/2017 11:07:44

Siniat\Area Molino\ventilatore filtro di raffreddamento\motore\M2H\m2h.sracea

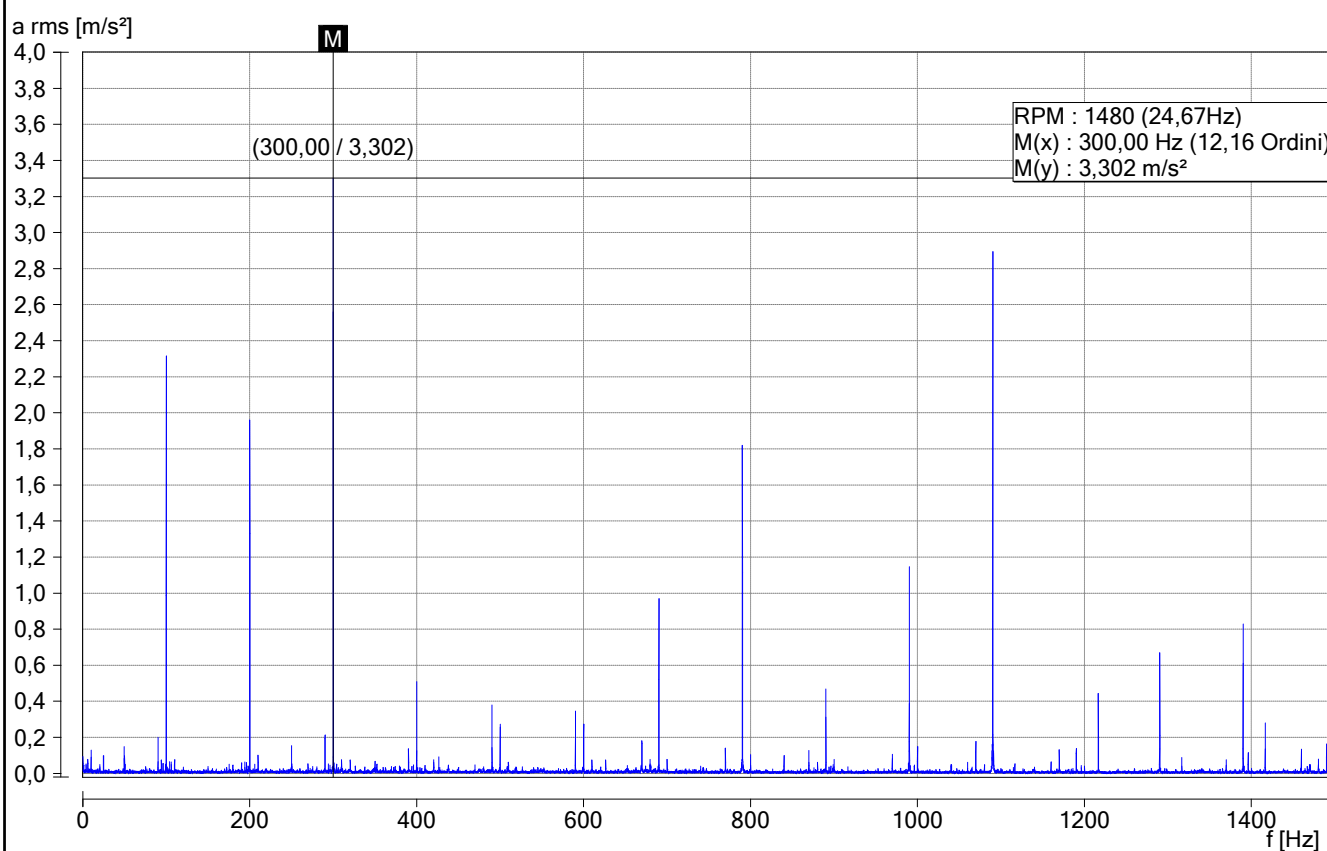

Cursore X [Hz] = 300,00

Principale

Y [m/s²] = 3,302

Cursore delta

X [Hz] = Non Attivo

Y [m/s²] = Non Attivo

RPM = 1480

RMS Y [m/s²] = 6,15



Date/Time

29/11/2017 15:28:33

Page 2 of 2

Canale #	A	
	X [Hz]	Y [m/s ²]
1	300,00	3,302
2	1090,20	2,893
3	100,00	2,315
4	200,00	1,960
5	790,20	1,820
6	990,20	1,147
7	690,20	0,968
8	1390,30	0,829
9	1290,30	0,668
10	400,00	0,510